


AS SEEN FROM REAR.

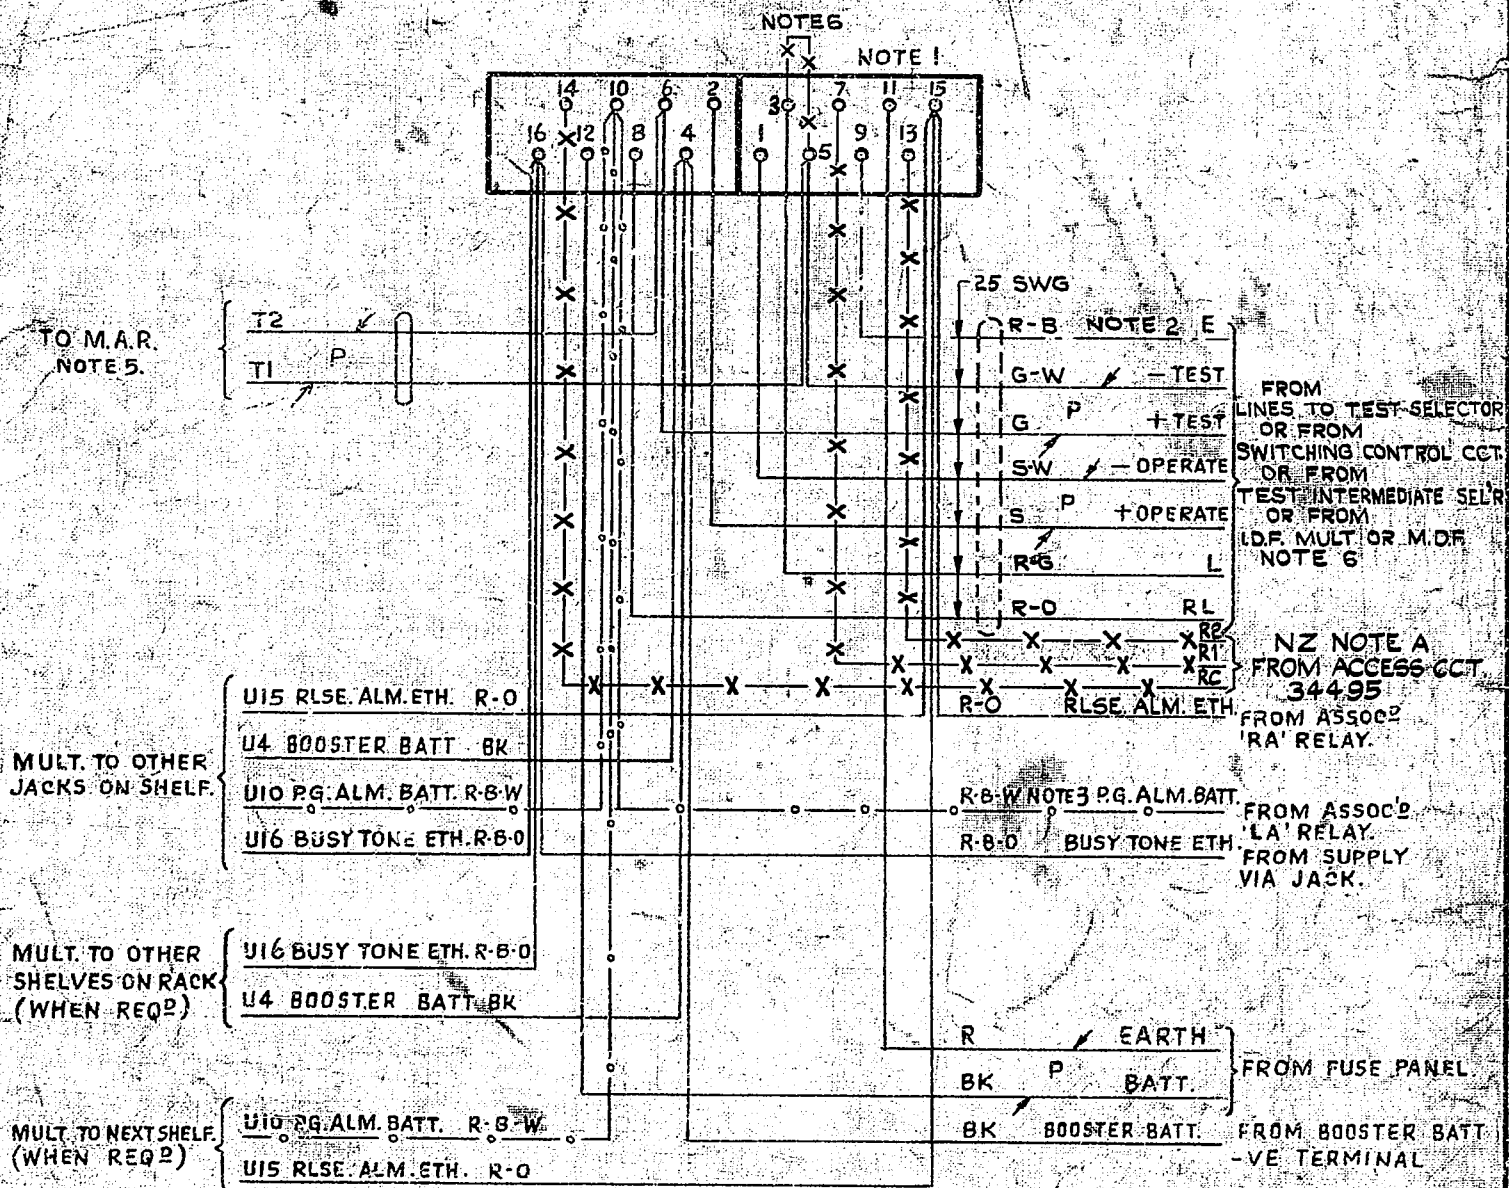

N.Z. NOTES  
A. PROVIDE LEADS INDICATED THUS X-X ONLY WHEN ASSOCIATED WITH 34495.

- NOTES.
- U9 & U11 TO MAKE CONTACT WHEN SELECTOR IS REMOVED.
  - CONNECTIONS SHOWN THUS ——— REQUIRED ONLY WHEN TEST SELECTOR IS CONNECTED VIA SWITCHING CONTROL CIRCUIT OR TEST INTERMEDIATE SELECTOR.
  - CONNECTIONS SHOWN THUS —○—○— REQUIRED ONLY WHEN TEST SELECTOR TERMINATES A JUNCTION.
  - ALL WIRING TO BE 22 SWG UNLESS OTHERWISE SPECIFIED.
  - THESE LEADS REQUIRED ONLY WHEN NO LOCAL ACCESS TO TEST SELECTOR IS PROVIDED.
  - WHEN CIRCUIT IS PRECEDED BY TEST INTERMEDIATE SELECTOR, I/C LEADS ARE CONNECTED AS FOLLOWS: - 2+(TEST), B, - 2+(OPERATE), RL FROM -, +, P, V, R, Z RESPECTIVELY OF INTERMEDIATE SELECTOR. IN THIS CASE ADD STRAP BETWEEN U3 AND U5.

N.Z. NOTE A AMENDED	(7925)	4B	24.2.68	
N.Z. NOTE A ADDED TO COVER Z1 LEAD	(81736)	4A	27.11.67	
NOTE 2 REF TO INTERMEDIATE SELECTOR ADDED	(14655)	4	27.10.58	
NOTE 6 2 ALTERNATIVE I/C WIRING ADDED	(14655)	3	27.10.58	
GBU10461 ADDED TO DIAGRAM NUMBER	(31667)	2	5.5.54	
		1	14.9.49	
AMENDMENT PARTICULARS	ISSUE	DATE	APPROV	
N.Z. PO.				
DRAWN	CHECKED	WIRING	CIRCUIT	

TEST SELECTOR.

GBU 10460  
10461

P. 2

5 Centimetres

10

15

20

25

30