


AS SEEN FROM REAR.

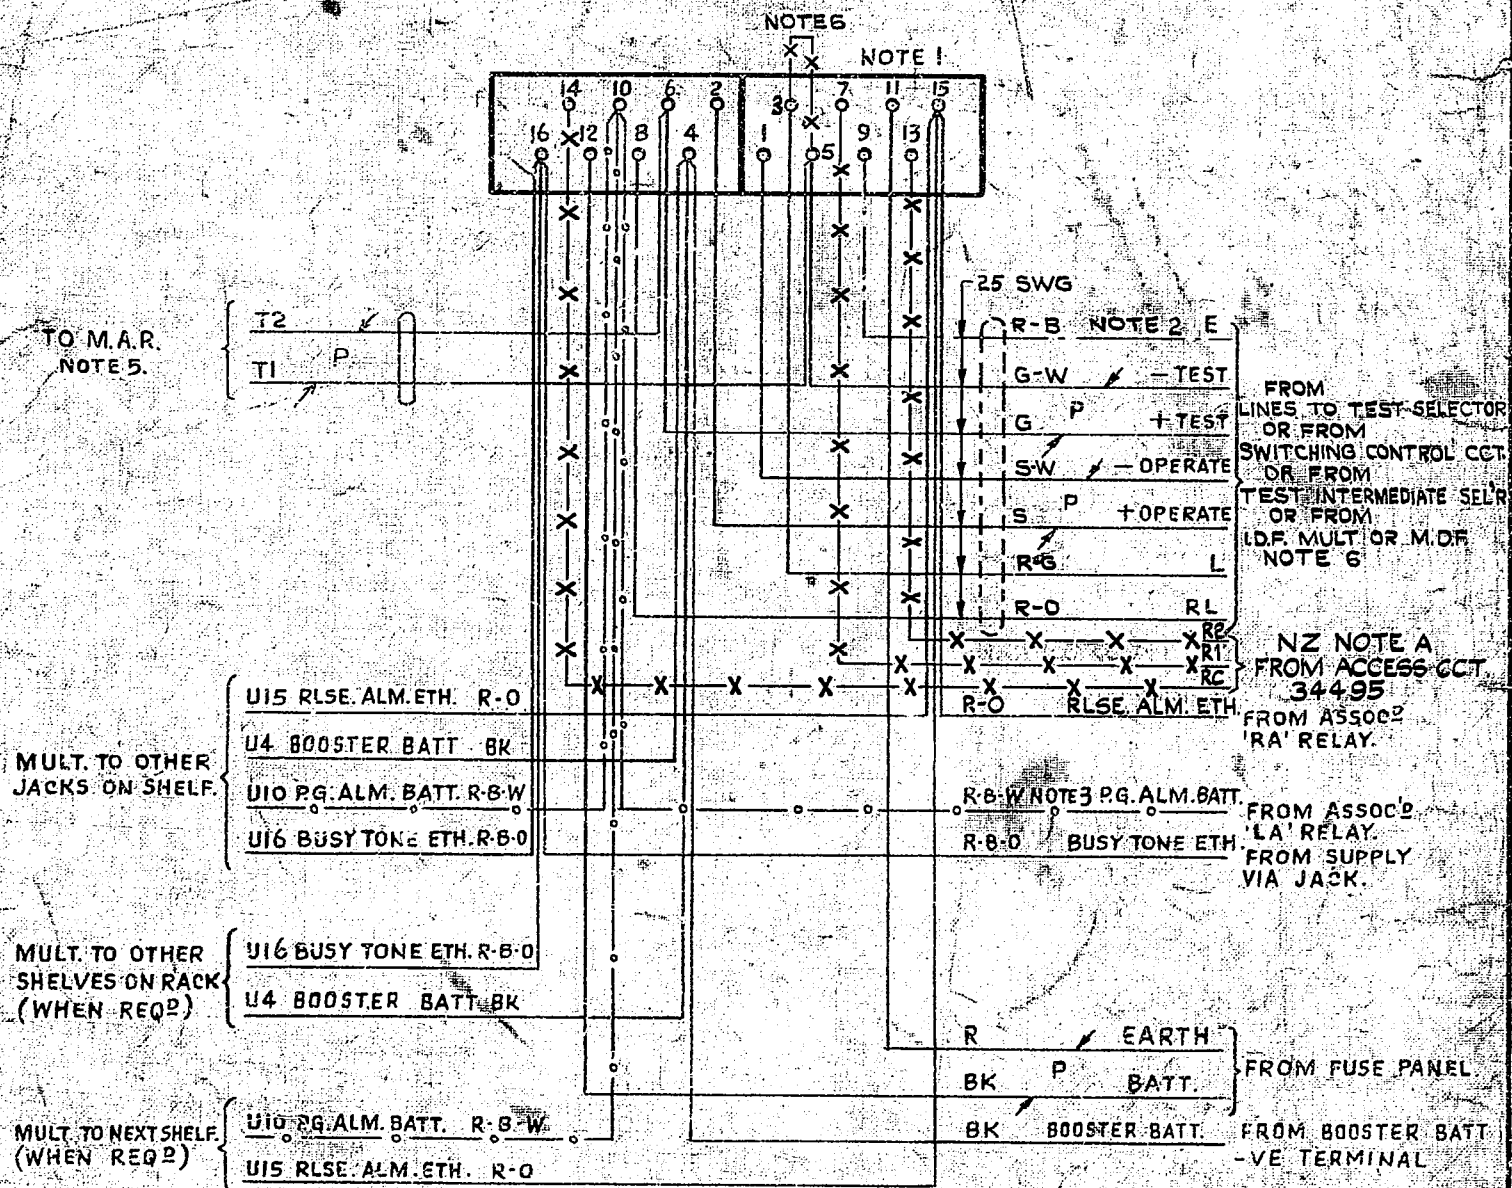

N.Z. NOTES
A. PROVIDE LEADS INDICATED THUS X-X ONLY WHEN ASSOCIATED WITH 34495.

NOTES.

- U9 & U11 TO MAKE CONTACT WHEN SELECTOR IS REMOVED.
- CONNECTIONS SHOWN THUS ——— REQUIRED ONLY WHEN TEST SELECTOR IS CONNECTED VIA SWITCHING CONTROL CIRCUIT OR TEST INTERMEDIATE SELECTOR.
- CONNECTIONS SHOWN THUS —○—○— REQUIRED ONLY WHEN TEST SELECTOR TERMINATES A JUNCTION.
- ALL WIRING TO BE 22 SWG UNLESS OTHERWISE SPECIFIED.
- THESE LEADS REQUIRED ONLY WHEN NO LOCAL ACCESS TO TEST SELECTOR IS PROVIDED.
- WHEN CIRCUIT IS PRECEDED BY TEST INTERMEDIATE SELECTOR, I/C LEADS ARE CONNECTED AS FOLLOWS: - 2+(TEST), B, - 2+(OPERATE), RL FROM -, +, P, V, R, Z RESPECTIVELY OF INTERMEDIATE SELECTOR. IN THIS CASE ADD STRAP BETWEEN U3 AND U5.

N.Z. NOTE A AMENDED	(7925)	4B	24.2.68	<i>[Signature]</i>
N.Z. NOTE A ADDED TO COVER Z1 LEAD	(81736)	4A	27.11.67	<i>[Signature]</i>
NOTE 2 REF TO INTERMEDIATE SELECTOR ADDED	(14655)	4	27.10.58	<i>[Signature]</i>
NOTE 6 & ALTERNATIVE I/C WIRING ADDED	(14655)	3	27.10.58	<i>[Signature]</i>
GBU10461 ADDED TO DIAGRAM NUMBER	(31667)	2	5.5.54	<i>[Signature]</i>
		1	14.9.49	<i>[Signature]</i>

TEST SELECTOR.

AMENDMENT PARTICULARS		ISSUE	DATE	APPROVED	V	E
N.Z. PO.	<i>[Signature]</i>	<i>[Signature]</i>	27/1/49	<i>[Signature]</i>		
DRAWN CHECKED WIRING CIRCUIT				GBU 10460 10461		

5 Centimetres

10

15

20

25

30