
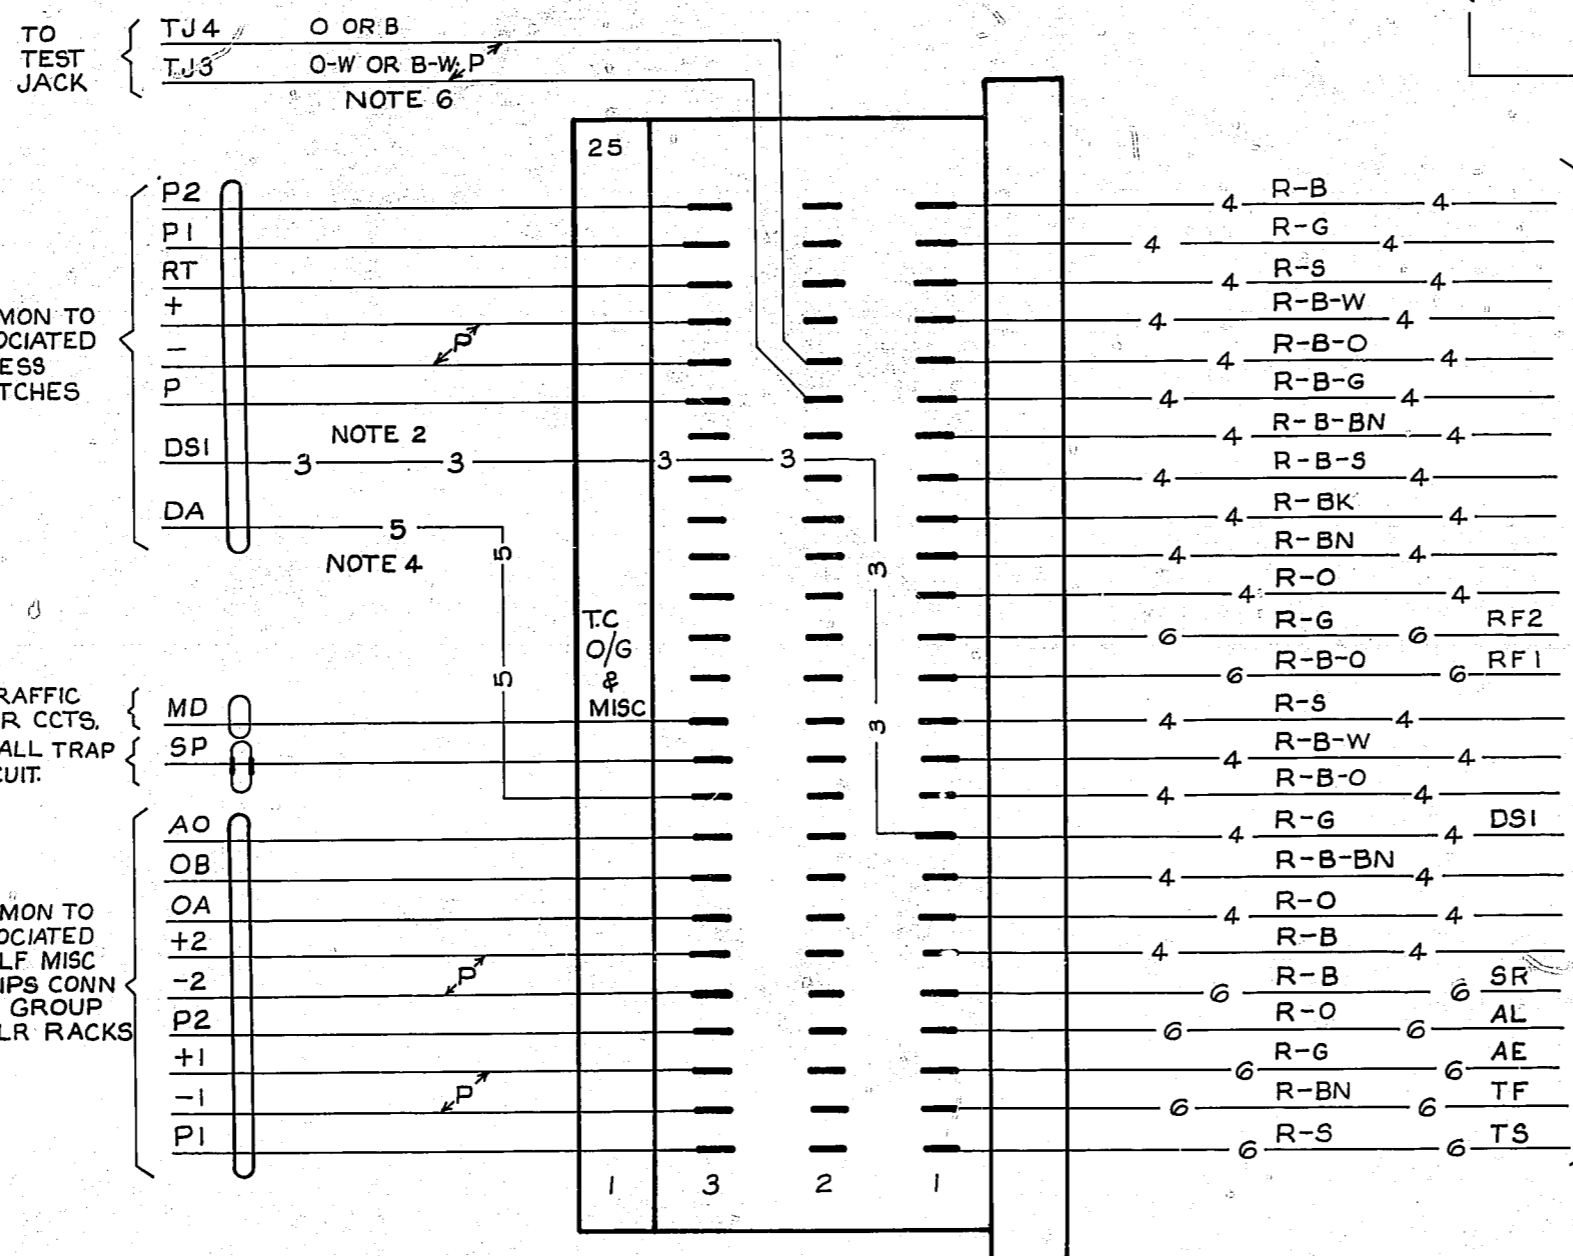


Ø SUPY LEADS VIA RACK MISC. STRIP CONN (GBW 11560 OR EQUIV)

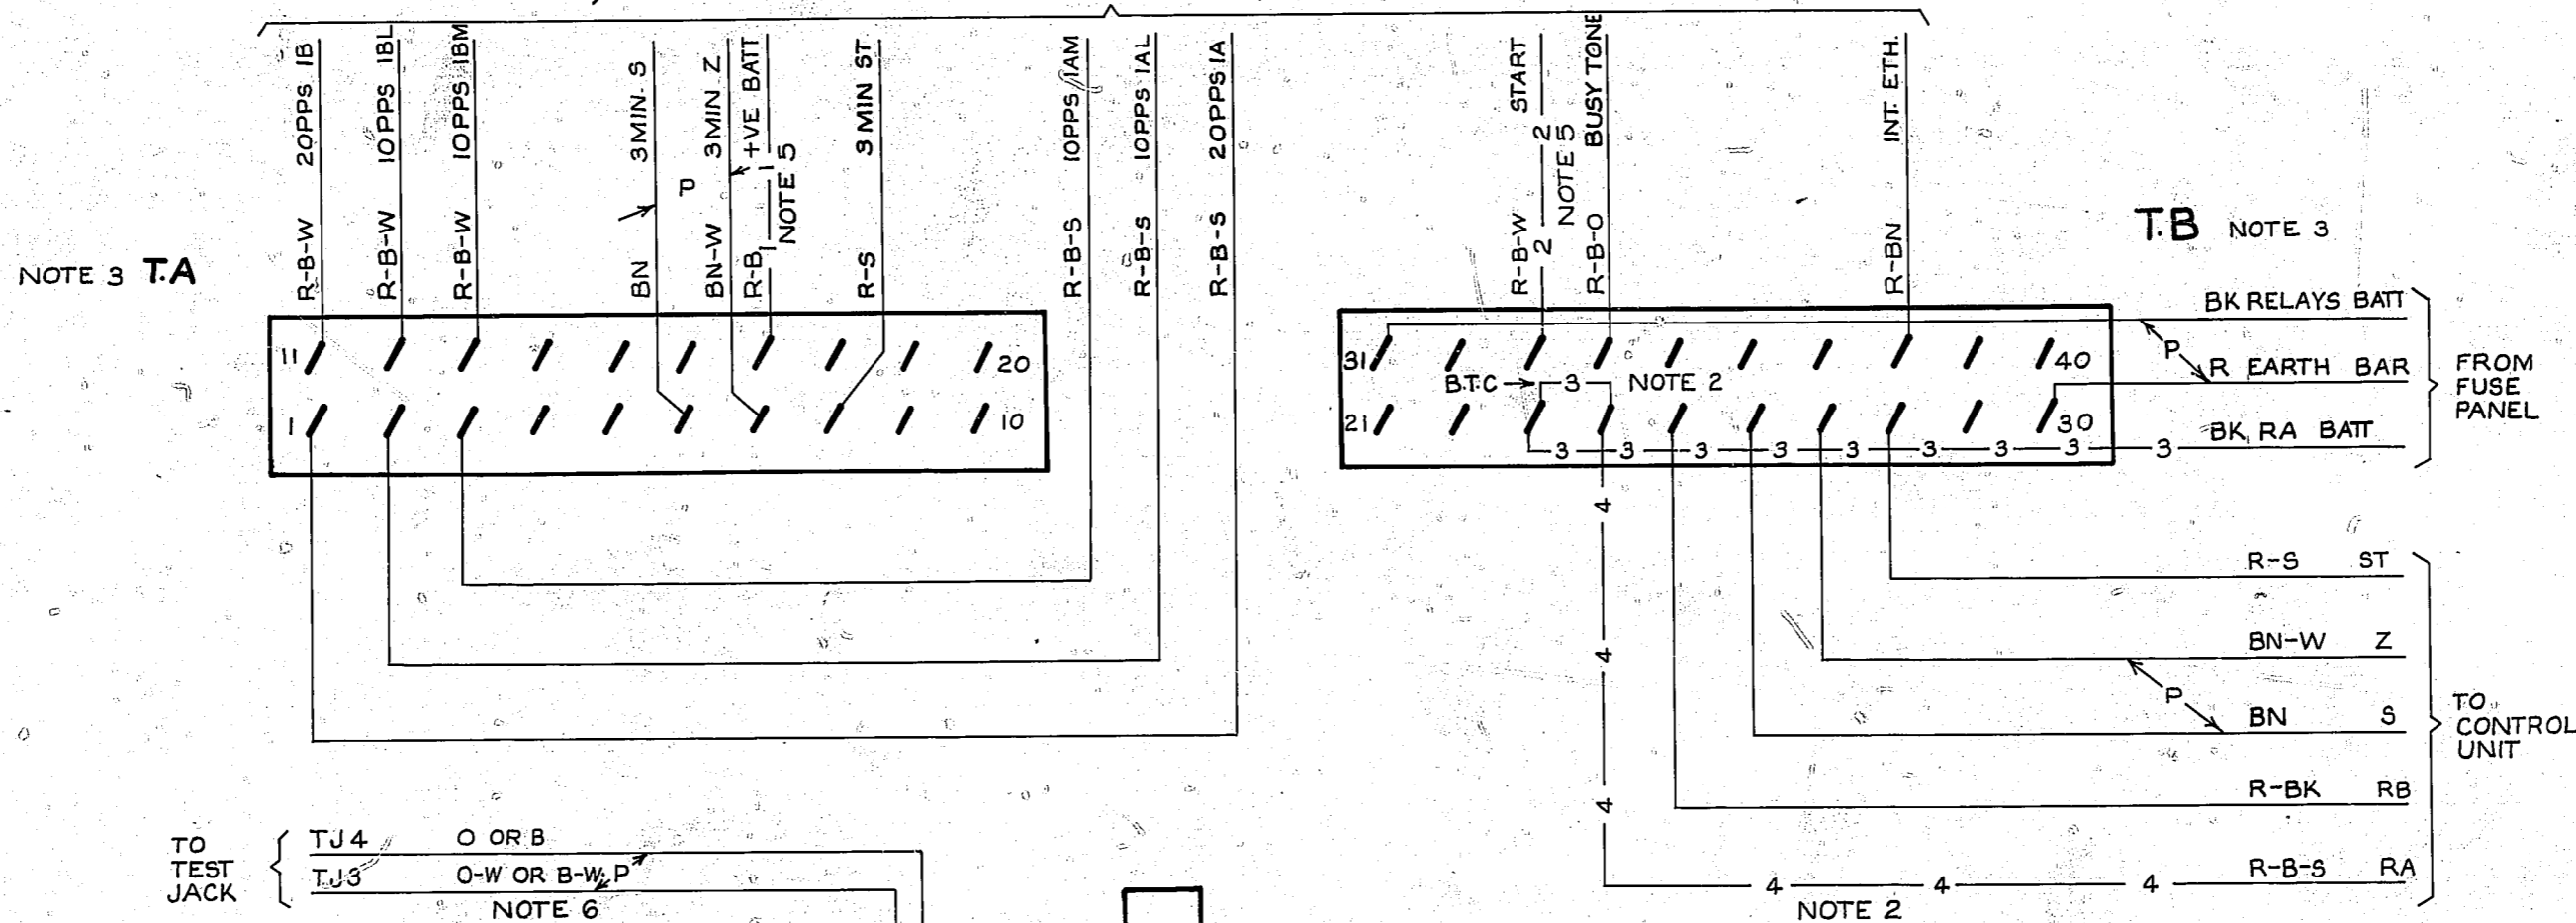

NOTES

- 1. ALL WIRING UNLESS OTHERWISE SPECIFIED TO BE 0.7mm
- 2. WHEN TEST UNIT IS USED IN CONJUNCTION WITH-
 - (A) UNISELECTOR ACCESS EQUIP (GBW 16320 OR EQUIV) ADD WIRING SHOWN -3-3- AND -6-6- AND OMIT WIRING SHOWN -4-4-
 - (B) TWO MOTION ACCESS EQUIP (GBW 11230 OR EQUIV) ADD WIRING SHOWN -4-4- AND -6-6- AND OMIT WIRING SHOWN -3-3-
 THE LEADS IN USE ARE INDICATED ON GBW 11220 OR EQUIV.
- 3. TERMINALS ON TERMINAL STRIPS TA AND TB ARE AS SEEN FROM FRONT OF RACK.
- 4. ON SOME EQUIPMENTS TO GBW 11220 TAG TC3/10 WAS CABLED TO 'DA' IN ACCESS SWITCH CIRCUIT SHOWN THUS -5-5-
- 5. WHEN POSITIVE BATTERY IS REQUIRED ADD WIRE SHOWN THUS -1-1-, WHEN POSITIVE BATTERY GENERATOR START IS REQUIRED ADD WIRE SHOWN -1-1- AND -2-2-
- 6. THE LEADS TO TEST JACKS, ARE, ON EQUIPMENT TO GBW 11220 & GBW 16790 O & O-W, AND ON EQUIPMENT TO GBW 11221 & GBW 11222 B & B-W.

PROOF

ROUTINER FOR GROUP SELRS				WITHOUT BUSY FLASH TO GBW 10760		
RETRACED	(183014)	GB	5-11-79	AD.G		
MD LEAD ADDED TO TERMINAL STRIP TC (122900)		GA	9-5-74	B.S.H		
DESIGNATIONS ON LEADS FROM FUSE PANEL AMD (46496)		6	24-8-66	H.B.B		
REDRAWN NOTES CHANGED 11222 ADDED IN TITLE BOX	(91249)	5	20-11-64	W.L		
AMENDMENT	PARTICULARS	ISSUE	DATE	APPD	REF	SIZE A2 50V 5
N.Z.P.O		DRAWN B.S	CHECKED H.B.B	WIRING H.B.B	CIRCUIT H.B.B	GBU 11220 11222 11221