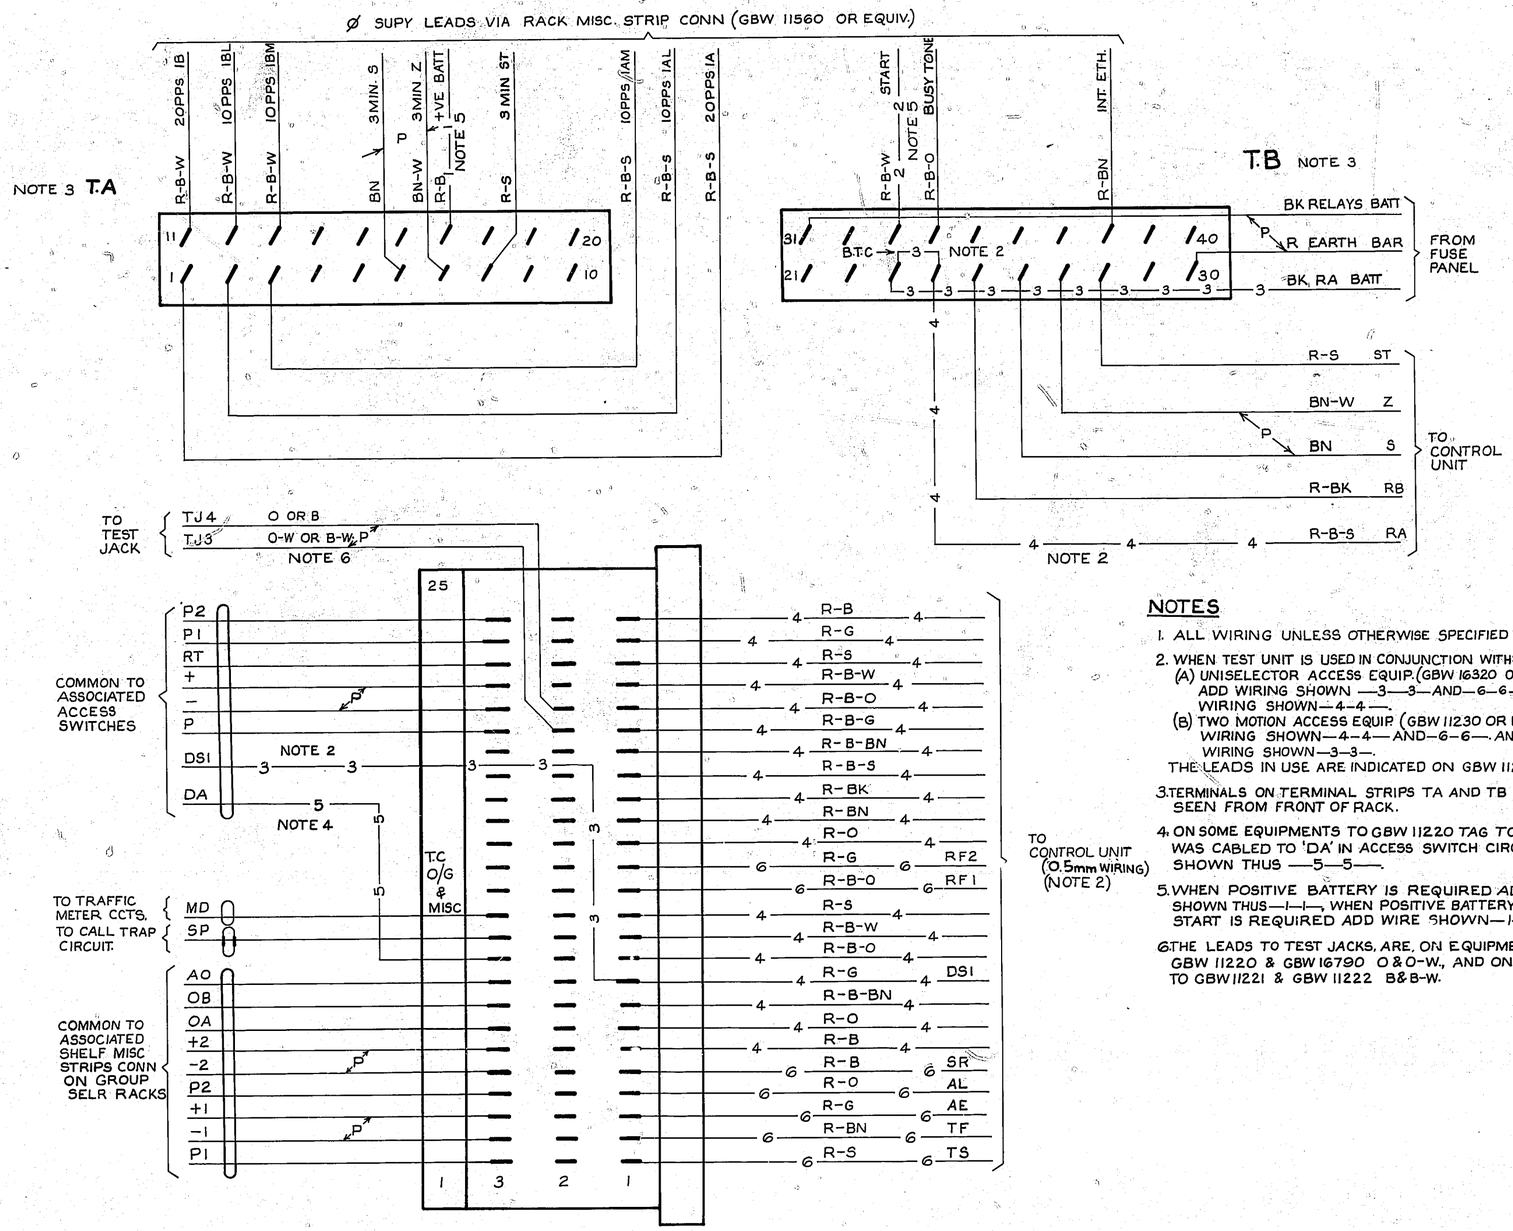

NOTES

1. ALL WIRING UNLESS OTHERWISE SPECIFIED TO BE 0.7mm
2. WHEN TEST UNIT IS USED IN CONJUNCTION WITH:-
   (A) UNISELECTOR ACCESS EQUIP. (GBW 16320 OR EQUIV) ADD WIRING SHOWN —3—3— AND —6—6— AND OMIT WIRING SHOWN —4—4—.
   (B) TWO MOTION ACCESS EQUIP (GBW 11230 OR EQUIV.) ADD WIRING SHOWN —4—4— AND —6—6—. AND OMIT WIRING SHOWN —3—3—.
   THE LEADS IN USE ARE INDICATED ON GBW 11220 OR EQUIV.
3. TERMINALS ON TERMINAL STRIPS TA AND TB ARE AS SEEN FROM FRONT OF RACK.
4. ON SOME EQUIPMENTS TO GBW 11220 TAG TC3/10 WAS CABLED TO 'DA' IN ACCESS SWITCH CIRCUIT SHOWN THUS —5—5—.
5. WHEN POSITIVE BATTERY IS REQUIRED ADD WIRE SHOWN THUS —1—1—, WHEN POSITIVE BATTERY GENERATOR START IS REQUIRED ADD WIRE SHOWN —1—1— AND —2—2—.
6. THE LEADS TO TEST JACKS, ARE, ON EQUIPMENT TO GBW 11220 & GBW 16790 O & O-W., AND ON EQUIPMENT TO GBW 11221 & GBW 11222 B & B-W.

PROOF

AMENDMENT PARTICULARS	ISSUE	DATE	APPD
RETRACED (183014)	6B	5-11-79	A.D.G
MD LEAD ADDED TO TERMINAL STRIP TC (122900)	6A	9-5-74	B.S.H
DESIGNATIONS ON LEADS FROM FUSE PANEL AMD (46496)	6	24-8-66	H.B.B
REDRAWN NOTES CHANGED 11222 ADDED IN TITLE BOX (91249)	5	20-11-64	W.L

ROUTINER FOR GROUP SELRS WITHOUT BUSY FLASH TO GBW 10760
TEST UNIT
2000 TYPE

REF: SIZE A2 | 50V | S

N.Z.P.O			DRAWN	CHECKED	WIRING	CIRCUIT
			B.S	H.B.B	H.B.B	H.B.B

GBU 11220 11222 11221