
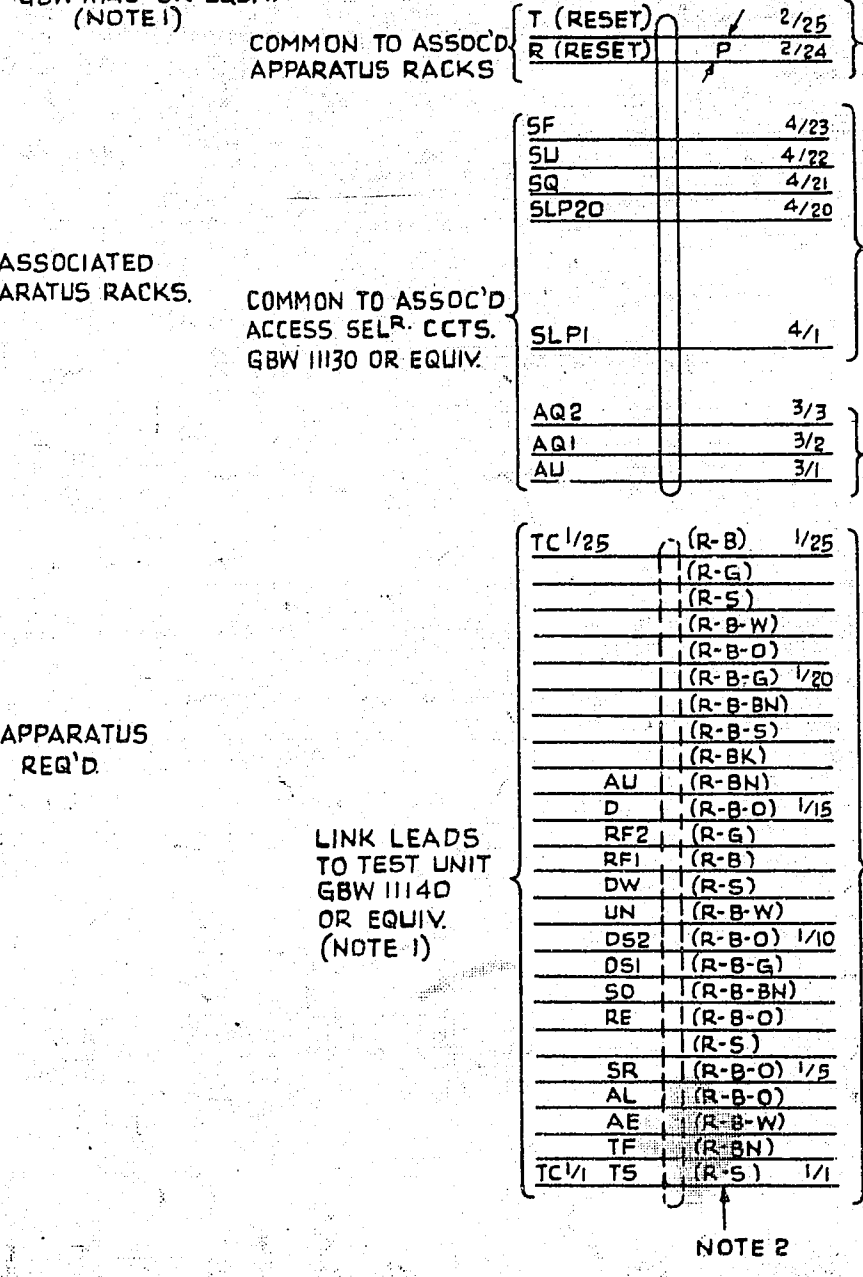
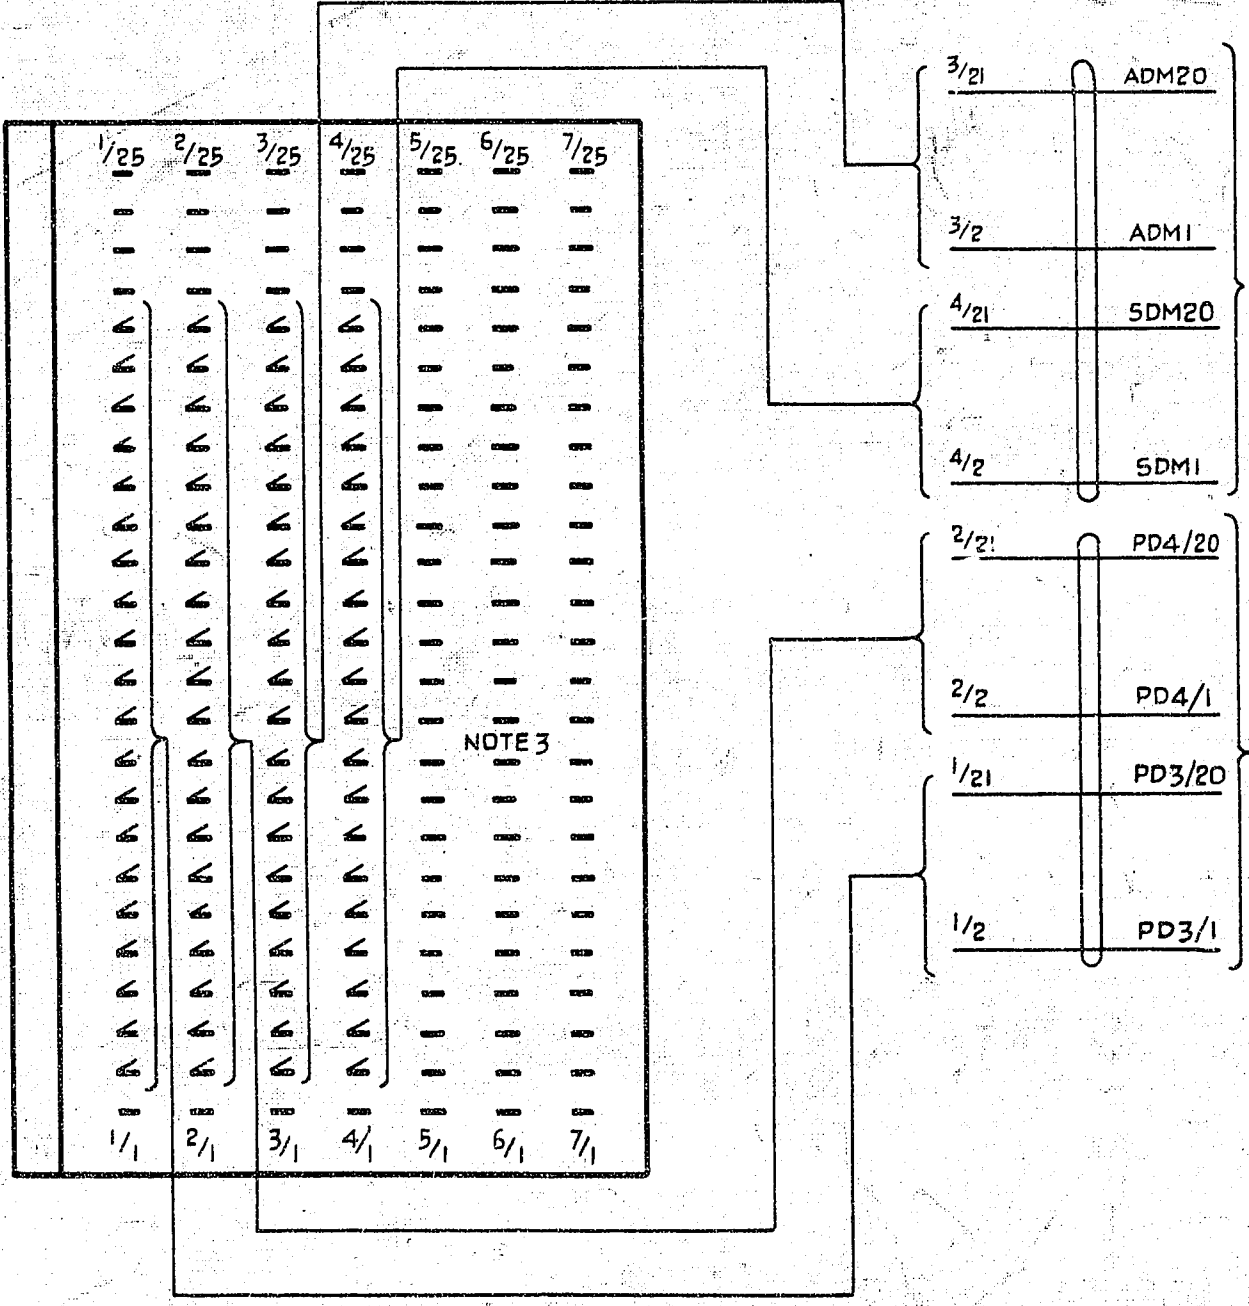


0  
5 Centimetres  
10  
15  
20  
25  
30

SLIPY. LEADS VIA RACK MISC. STRIP CONN.  
SEE GBW 11560 OR EQUIV.

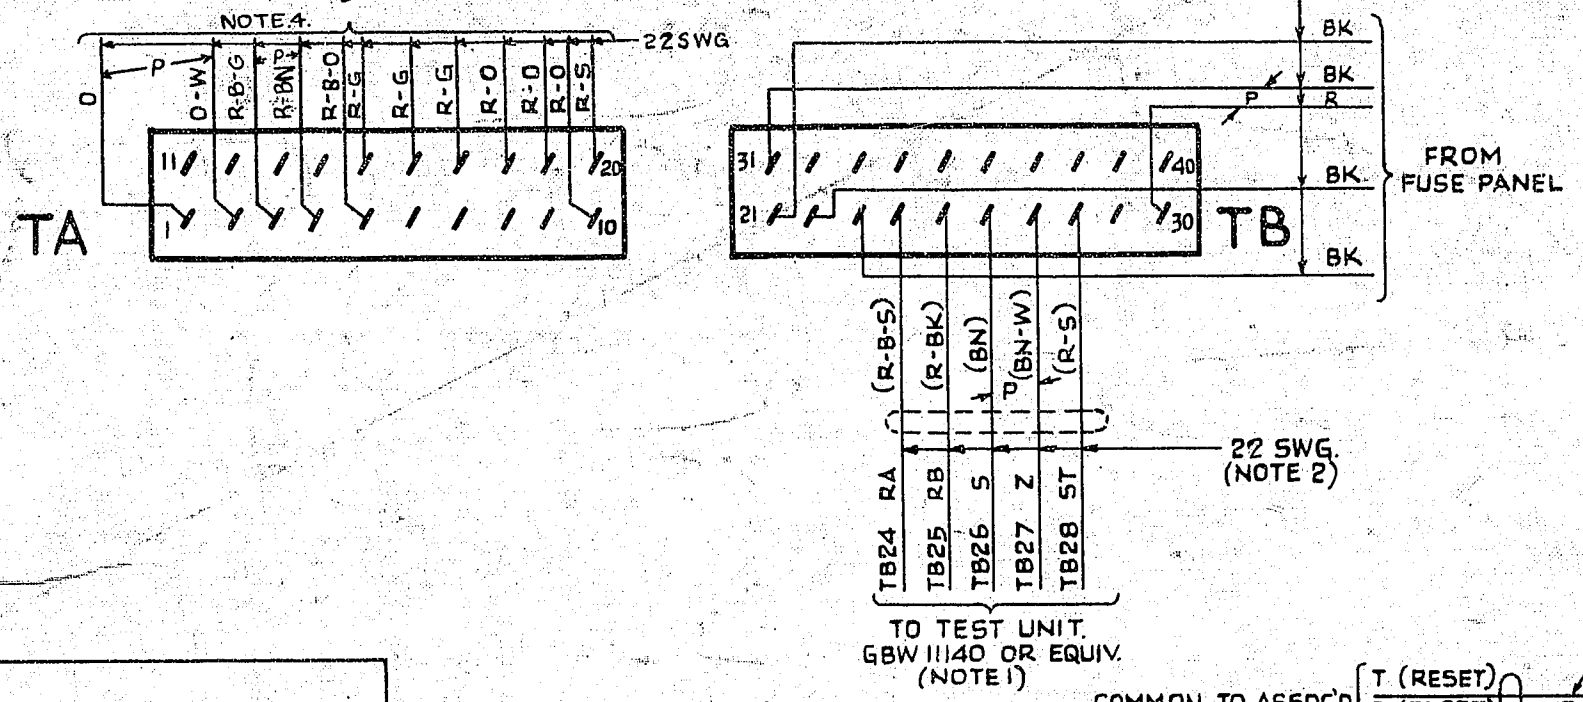

**NOTES**

- ALL LEADS WIRED TO TEST UNIT. THOSE ACTUALLY IN SERVICE ARE INDICATED BY DESIGNATION ON THE GBW DIAGRAM OF THE RELEVANT TEST UNIT.
- COLOR CODES SHOWN IN BRACKETS ARE USED ONLY WITH FORMED CABLE. WIRE TO BE 22 SWG UNLESS OTHERWISE SPEC'D.
- TAGS IN TD6 TO BE STRAPPED TO TD7 IF EQUIPPED OR TO TD5 IF UNEQUIPPED.
- ON SOME EARLY EQUIPMENTS THE CONNECTIONS FROM TA3 & 4 ARE IN A G & G-W PAIR.

NOTE 4 ADDED, WIRE GAUGES REVISED (91441)	2	2-12-64	MS
(31667)	1	5-5-54	CLB
AMENDMENT PARTICULARS			ISSUE DATE APP'D
N.Z. P.O.	DRAWN	CHECKED	WIRING ENGINEER
		9/1/55	

**ROUTINER ACCESS CONTROL FOR ACCESS SELECTORS (UNISEL<sup>RS</sup>) WITH SECONDARY DISTRIBUTOR 2000 TYPE**

**GBU 11490**