


IRVFP IPR/20  
WIRED BY INSTALLER

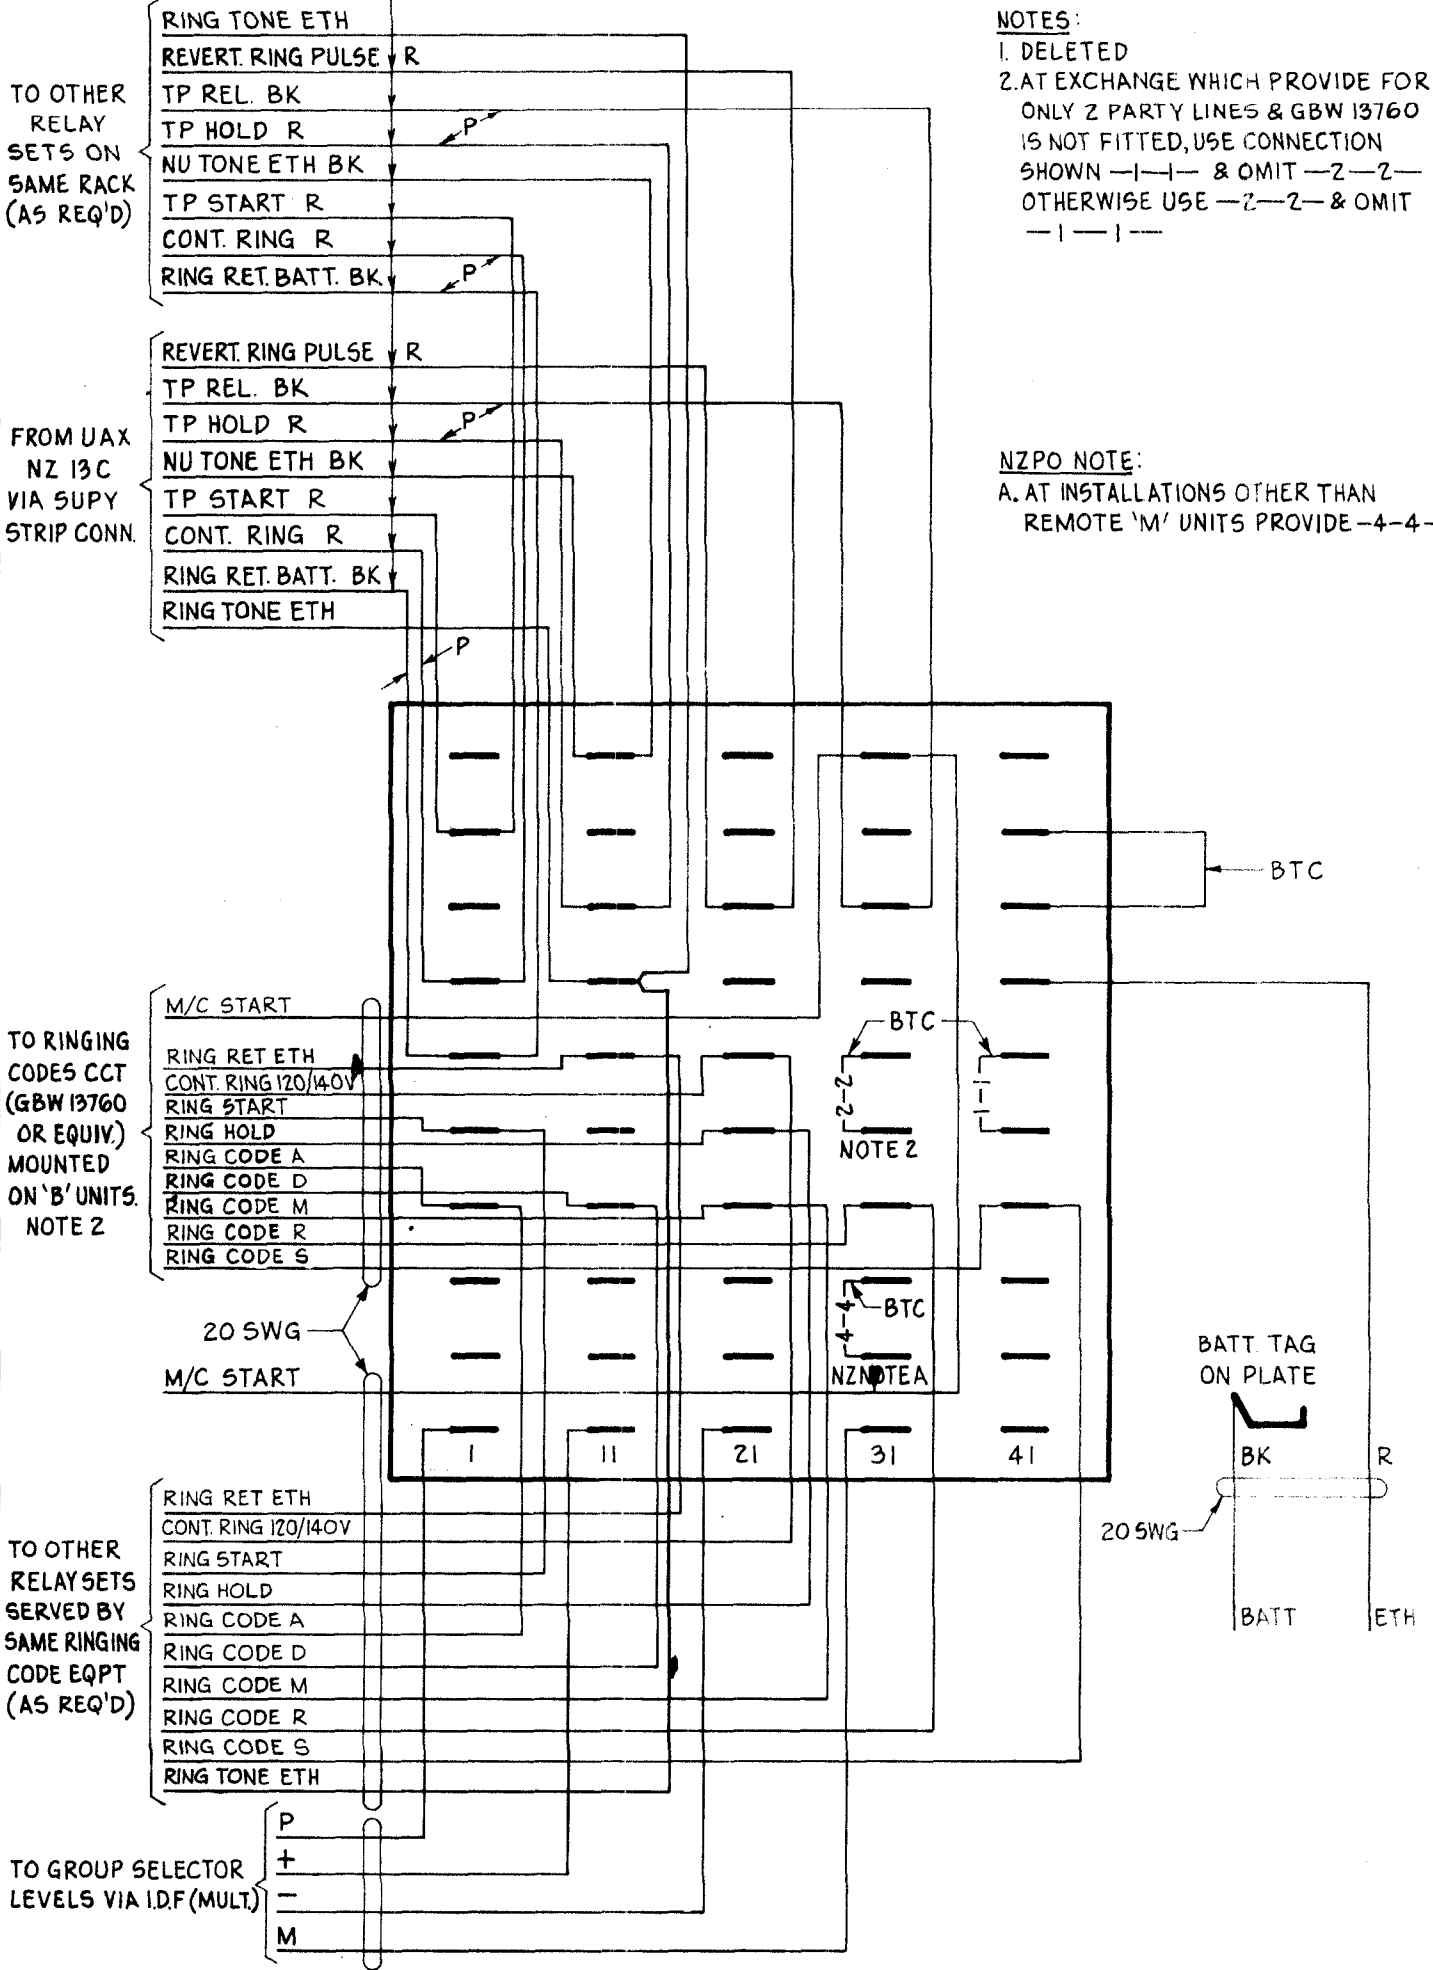

NOTES:  
1. DELETED  
2. AT EXCHANGE WHICH PROVIDE FOR ONLY 2 PARTY LINES & GBW 13760 IS NOT FITTED, USE CONNECTION SHOWN -1-1- & OMIT -2-2- OTHERWISE USE -2-2- & OMIT -1-1-

NZPO NOTE:  
A. AT INSTALLATIONS OTHER THAN REMOTE 'M' UNITS PROVIDE -4-4-

UAX NZ 13  
REVERTIVE CALL RELAY SET  
FOR 2 PARTY & 5 PARTY LINES  
(FOR USE WITH NEC LRS)

PREPARED FROM GBU 13770 ISS. 7A OF 5-6-69 (55944) A 5-5-76 CJW

AMENDMENT PARTICULARS ISS DATE APD 50V C

SIZE F

GBU 13770 MOD A

NZPO