

COMMON SERVICES

MULT TO OTHER CCT. ON RACK AS REQ'D


TO ROUTE DISCRIMG. OR RESTRICTG. CCTS. GBW 13920, GBW 13940 OR EQUIV.

TO ROUTE DISCRIMG. OR RESTRICTG. CCTS (CCTS 1-8) GBW 13920, GBW 13940 OR EQUIV.


TO ROUTE DISCRIMG. OR RESTRICTING. CCTS (CCTS 9-32) GBW 13920, GBW 13940 OR EQUIV. WHEN REQ'D.

6 SEC. ETH. PULSE

SC50

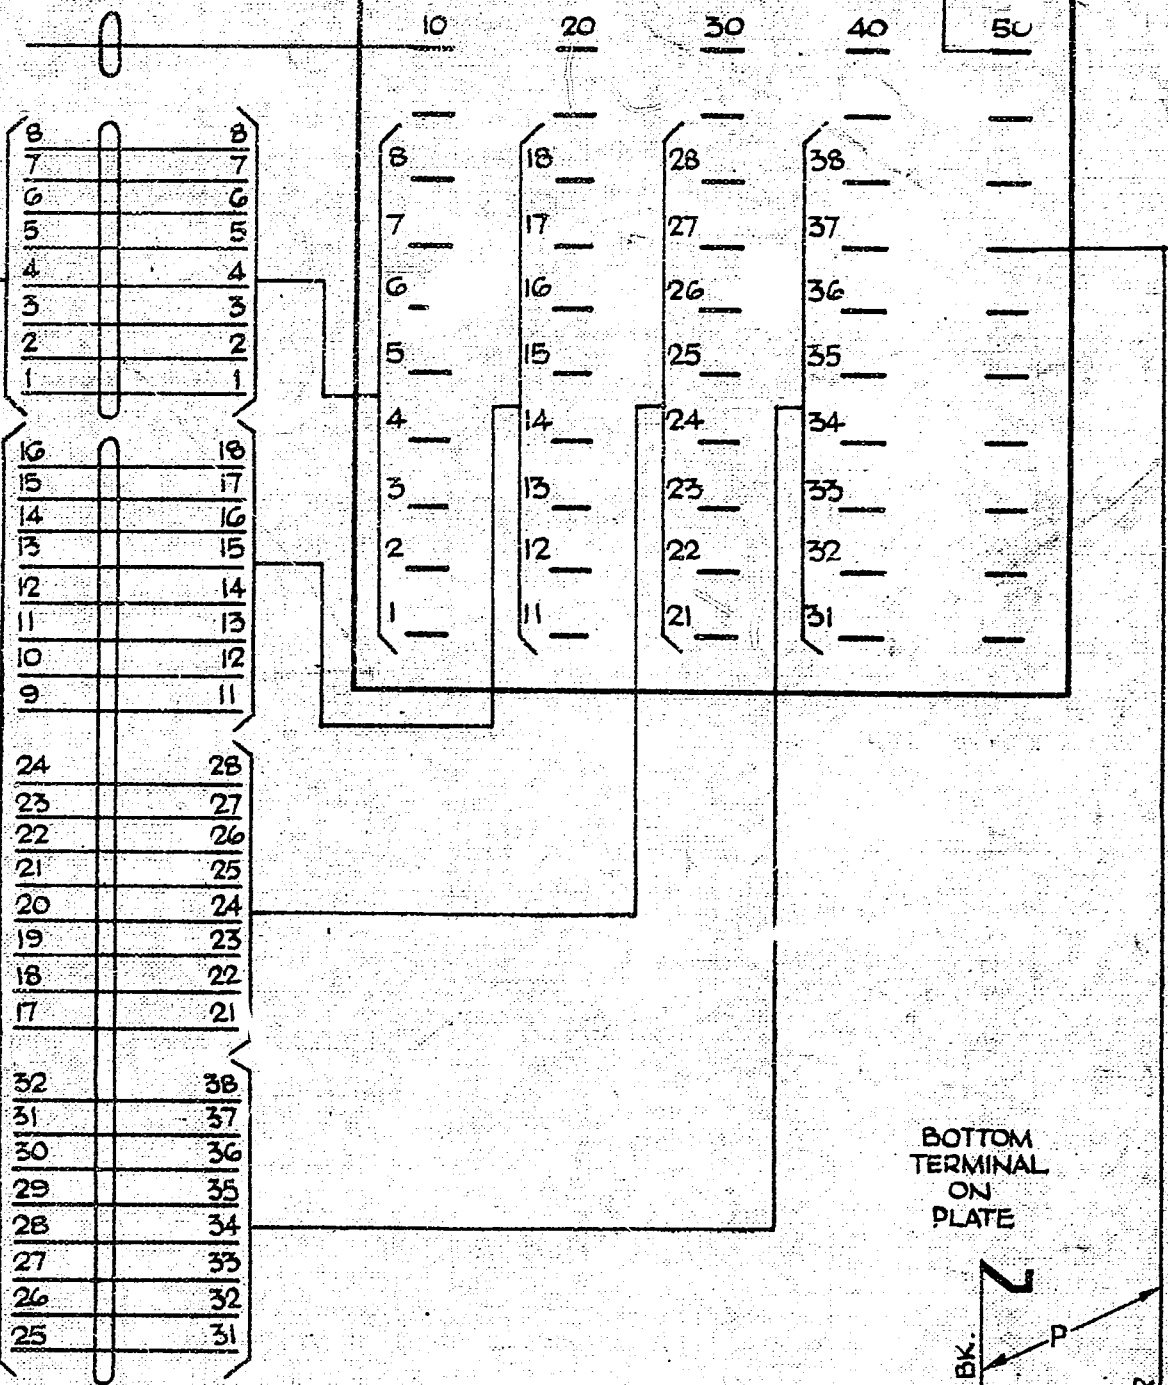

BOTTOM TERMINAL ON PLATE



FROM FUSE PANEL

- NOTES:~  
 1. ALL WIRING TO BE 22 SWG. UNLESS OTHERWISE SPECIFIED.

U.A.X. No. NZ 13  
 6 SEC. TIME PULSE  
 DISTRIBUTION RELAYS.

PIP-PIP-TONE STARTS DELETED FROM SC30.(74884)	2	28-8-63	OSH
(30770)	1	20-12-54	USH

AMENDMENT PARTICULARS	ISSUE	DATE	APP'D	REF:-	50x	14
-----------------------	-------	------	-------	-------	-----	----

N.Z.P.O.	DRAWN	CHECKED	WIRING	CIRCUIT
	DMO:			

**GBU 14020**