


0  
5 Centimetres  
10  
15  
20  
25  
30

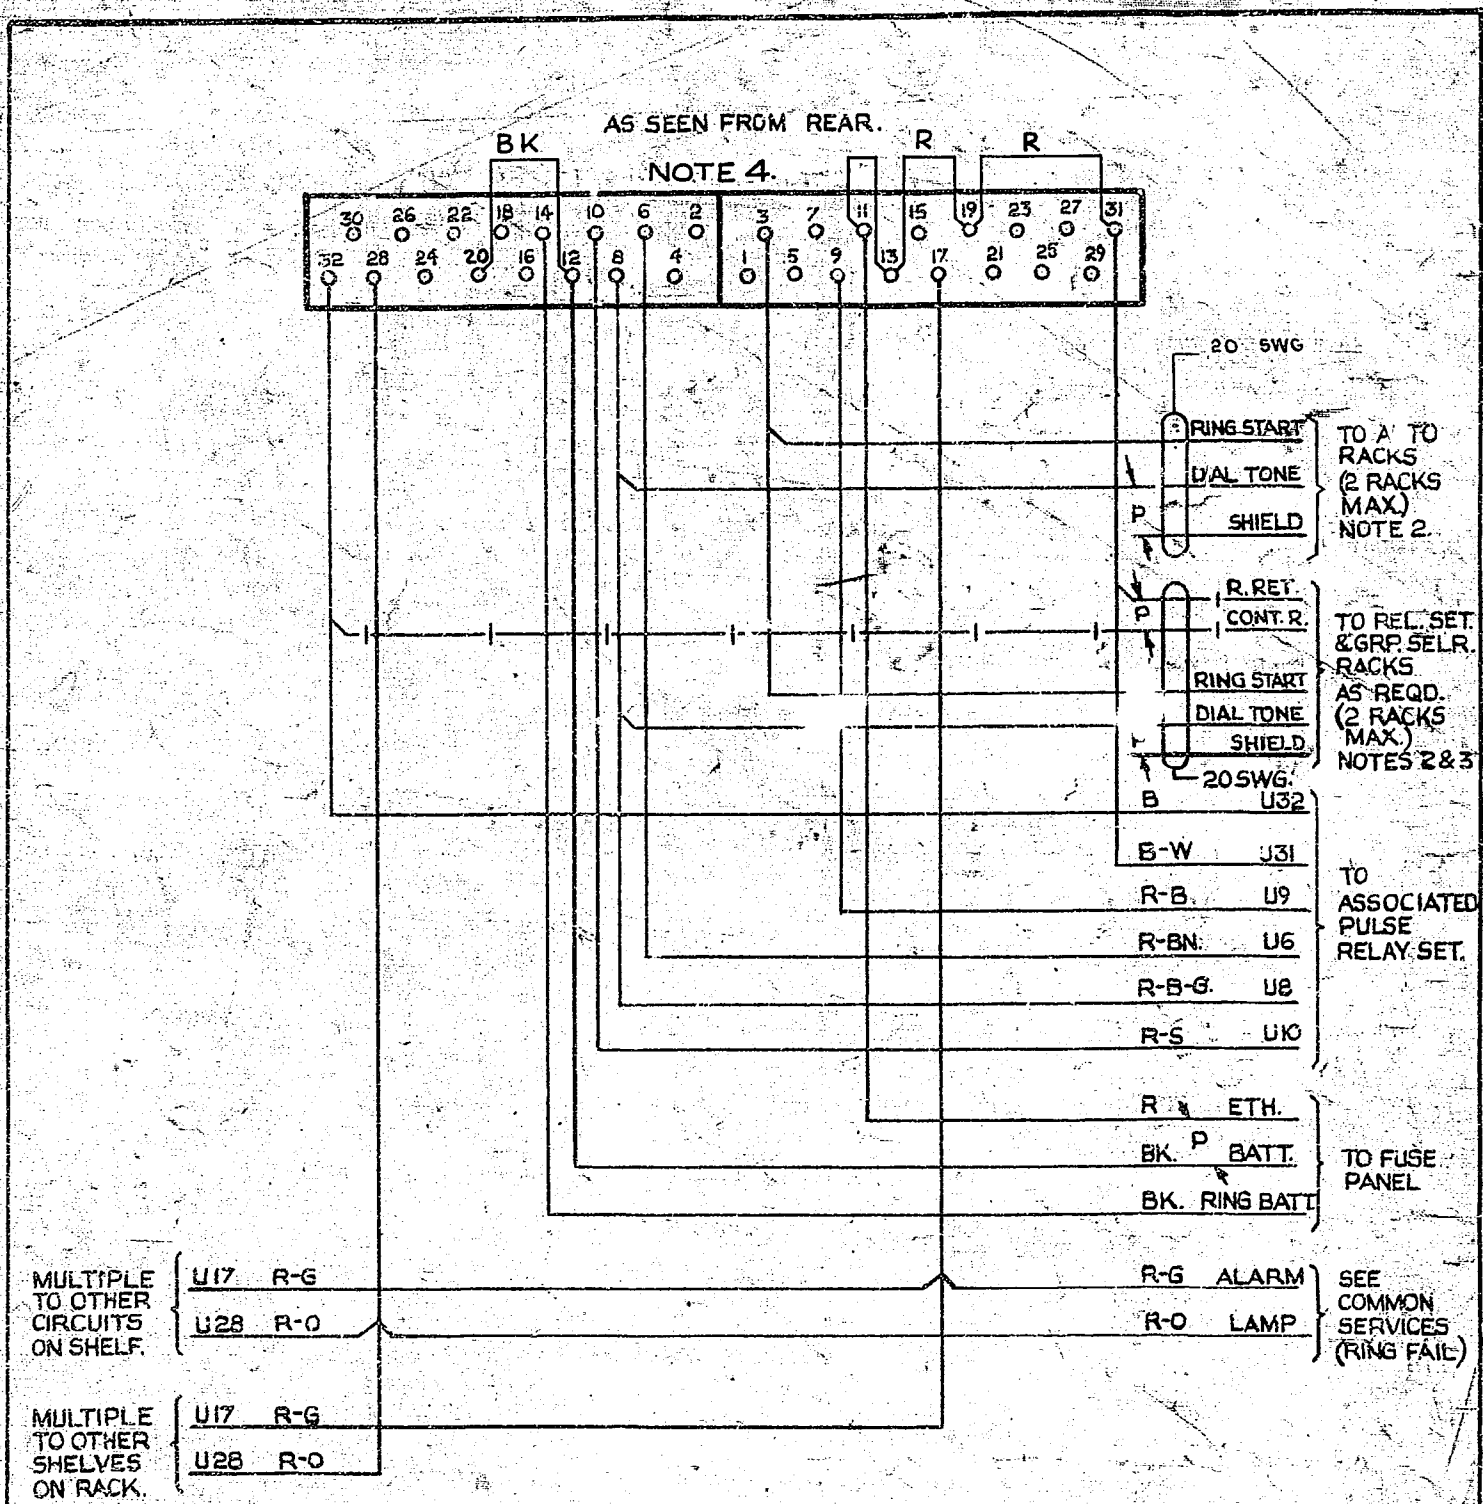

MULTIPLE TO OTHER CIRCUITS ON SHELF.

MULTIPLE TO OTHER SHELVES ON RACK.

U17 R-G

U28 R-O

U17 R-G

U28 R-O

TO A TO RACKS (2 RACKS MAX) NOTE 2.

TO REL. SET. & GRP. SELR. RACKS AS REQD. (2 RACKS MAX.) NOTES 2 & 3

TO ASSOCIATED PULSE RELAY SET.

TO FUSE PANEL

SEE COMMON SERVICES (RING FAIL)

NOTES.

1. ALL WIRING BEARING A COLOUR CODE TO BE 20 SWG. UNLESS OTHERWISE SHOWN.
2. IT IS IMPORTANT THAT EACH RELAY SET SHALL SERVE THE SAME RACK OR RACKS AS THE ASSOCIATED PULSE RELAY SET.
3. CONNECTIONS SHOWN ARE NOT NORMALLY REQUIRED.
4. STRAPS UI2-20 AND UI1-13-19-31 ENABLE RELAY SET TO GBW.16761 TO BE USED IN THIS SHELF JACK.

<b>RINGING &amp; TONES CIRCUIT.</b>				<b>50/1200 LINE P.A.B.X.</b>	
NOTE 4 & STRAPS ADDED. NZ. NOTE A. DEL. (8248)	3	2.12.71	R.J.C.		
NZ. NOTE A ADDED. (8426)	2A	22.4.71	G.F.E.		
LEADS FROM U7 TO AUTO, G.S. & R.S. RACKS DELETED. (68313)	2	11.12.56			
(65404)	1	5.8.55			
AMENDMENT PARTICULARS	ISSUE	DATE	APPD.	50Y	W
<b>GBU. 14130</b>					
NZ P.O.	DRAWN M.B.	CHECKED	WIRING	CIRCUIT	