


AS SEEN FROM REAR

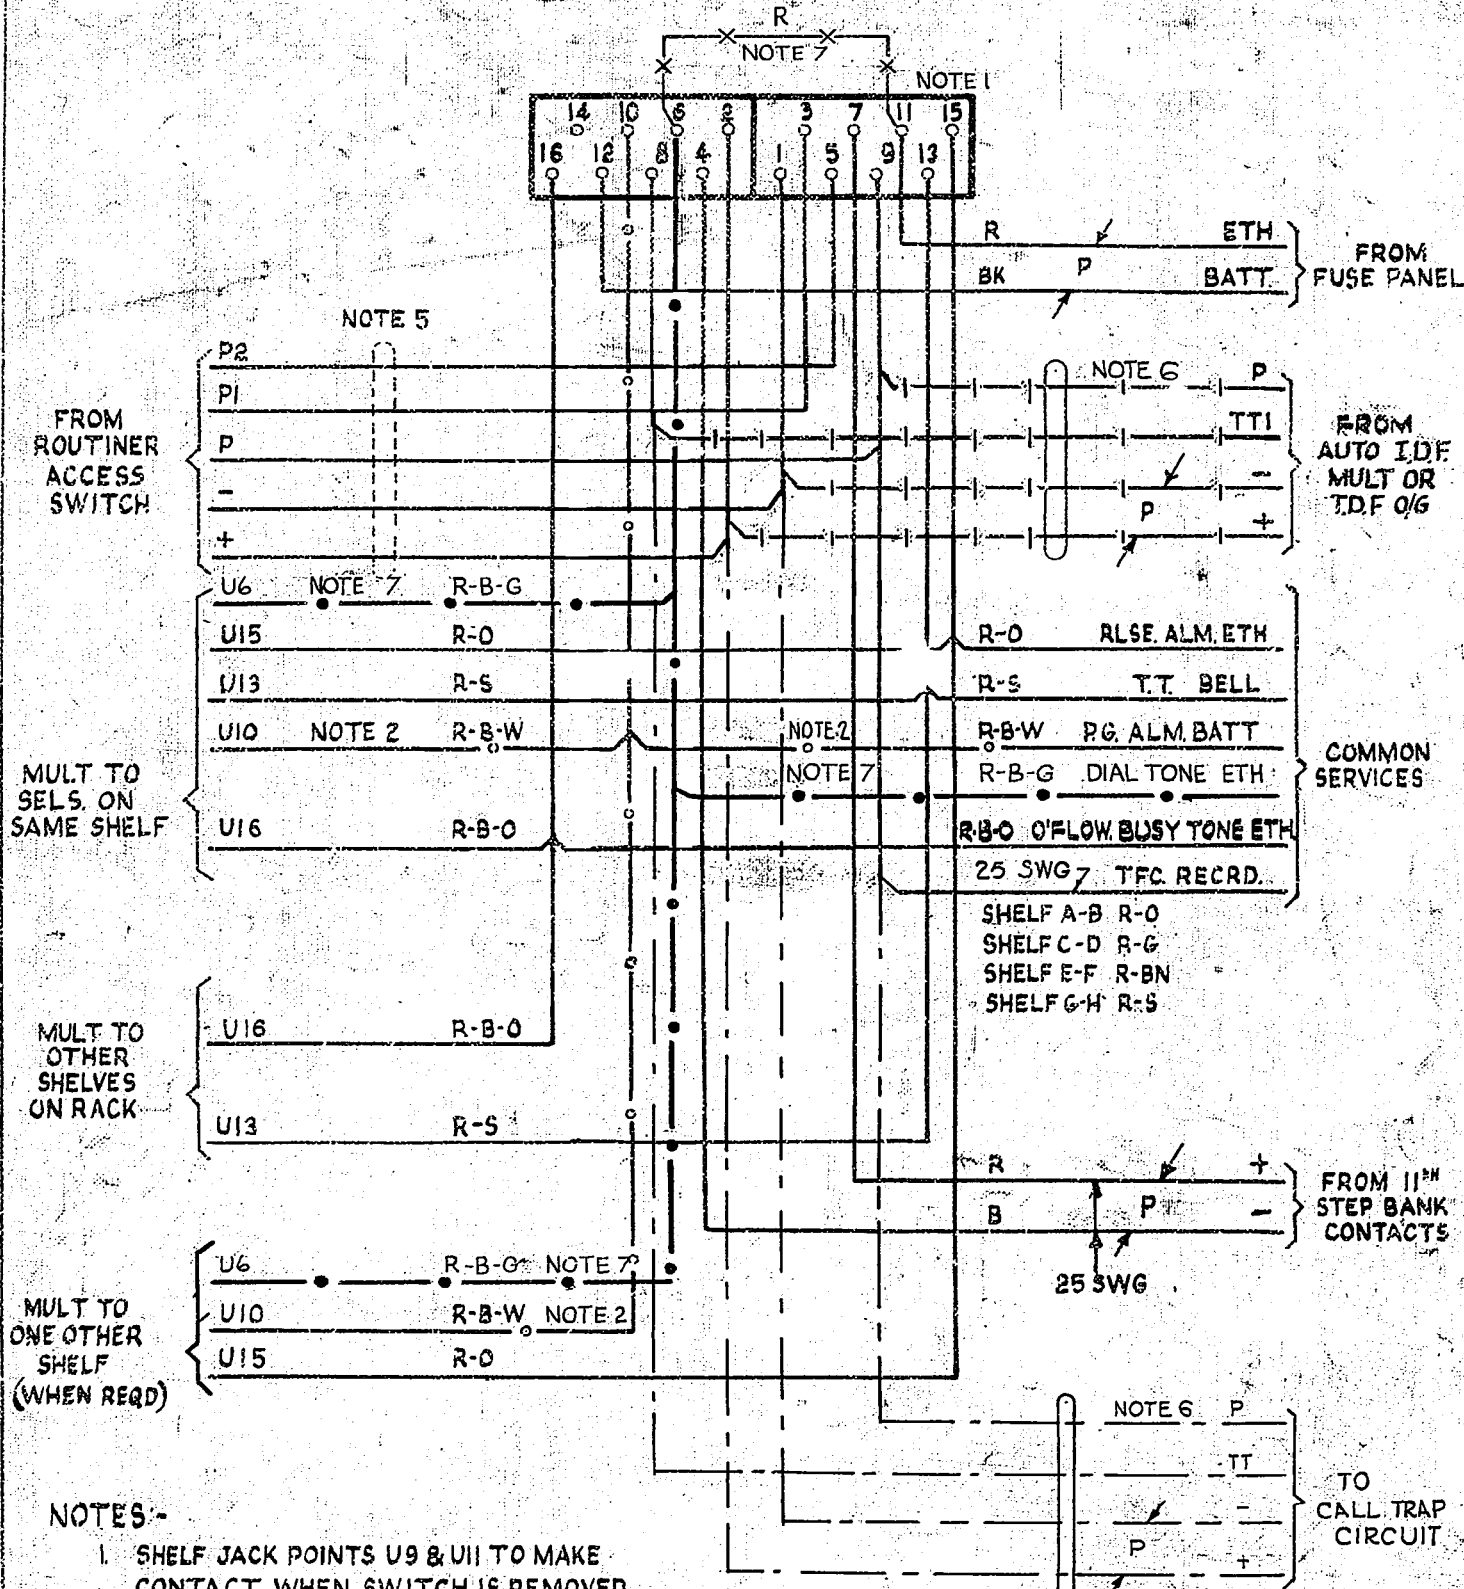

NOTES -

1. SHELF JACK POINTS U9 & U11 TO MAKE CONTACT WHEN SWITCH IS REMOVED
2. PG ALM. BATT TO BE PROVIDED ON INCOMING & FIRST SELECTORS ONLY
3. ALL WIRING TO BE 22SWG. UNLESS OTHERWISE SPECIFIED
4. DELETED
5. WHEN IN LOCAL CABLE SEE ASSOCIATED ROUTINER ACCESS DIAGRAM FOR WIRING
6. WHEN DIRECTLY CONNECTED TO CALL TRAP CIRCUIT ADD WIRING SHOWN THUS AND DELETE WIRING SHOWN THUS
7. ON EARLY EQUIPMENT U6 IS CONNECTED TO EARTH AT U11. FOR NEW WORK EARTH IS DERIVED FROM DIAL TONE EARTH DISTRIBUTION

| | | | |
|---|------------|---------------------|------------|
| NOTE 7 ADDED WIRING TO U6 MODIFIED (94491) | 6 | 26-1-66 | VEL |
| REF TO DIAL TONE & PG OVERLOAD ALARM DELETED (72509) | 5 | 25-3-64 | DBH |
| GBU 14581 ADDED (70888) | 4 | 14-1-63 | DBH |
| ALT VF WIRING TO CALL TRAP CCT & NOTE 6 ADDED (26108) | 3 | 26-2-59 | CK |
| REF TO IDF TERMINATION MODIFIED (67625) | 2 | 9-8-56 | CLP |
| | 1 | 9-8-56 | CLP |
| AMENDMENT PARTICULARS | ISSUE | DATE | APPO |
| N.Z.P.O. | DRAWN G.S. | CHECKED KKL 22/4/55 | WIRING KKL |

VF
TOLL LINE SELECTOR
200 OUTLET
2000 TYPE

50Y H

GBU 14580
GBU 14581

