




AS SEEN FROM REAR

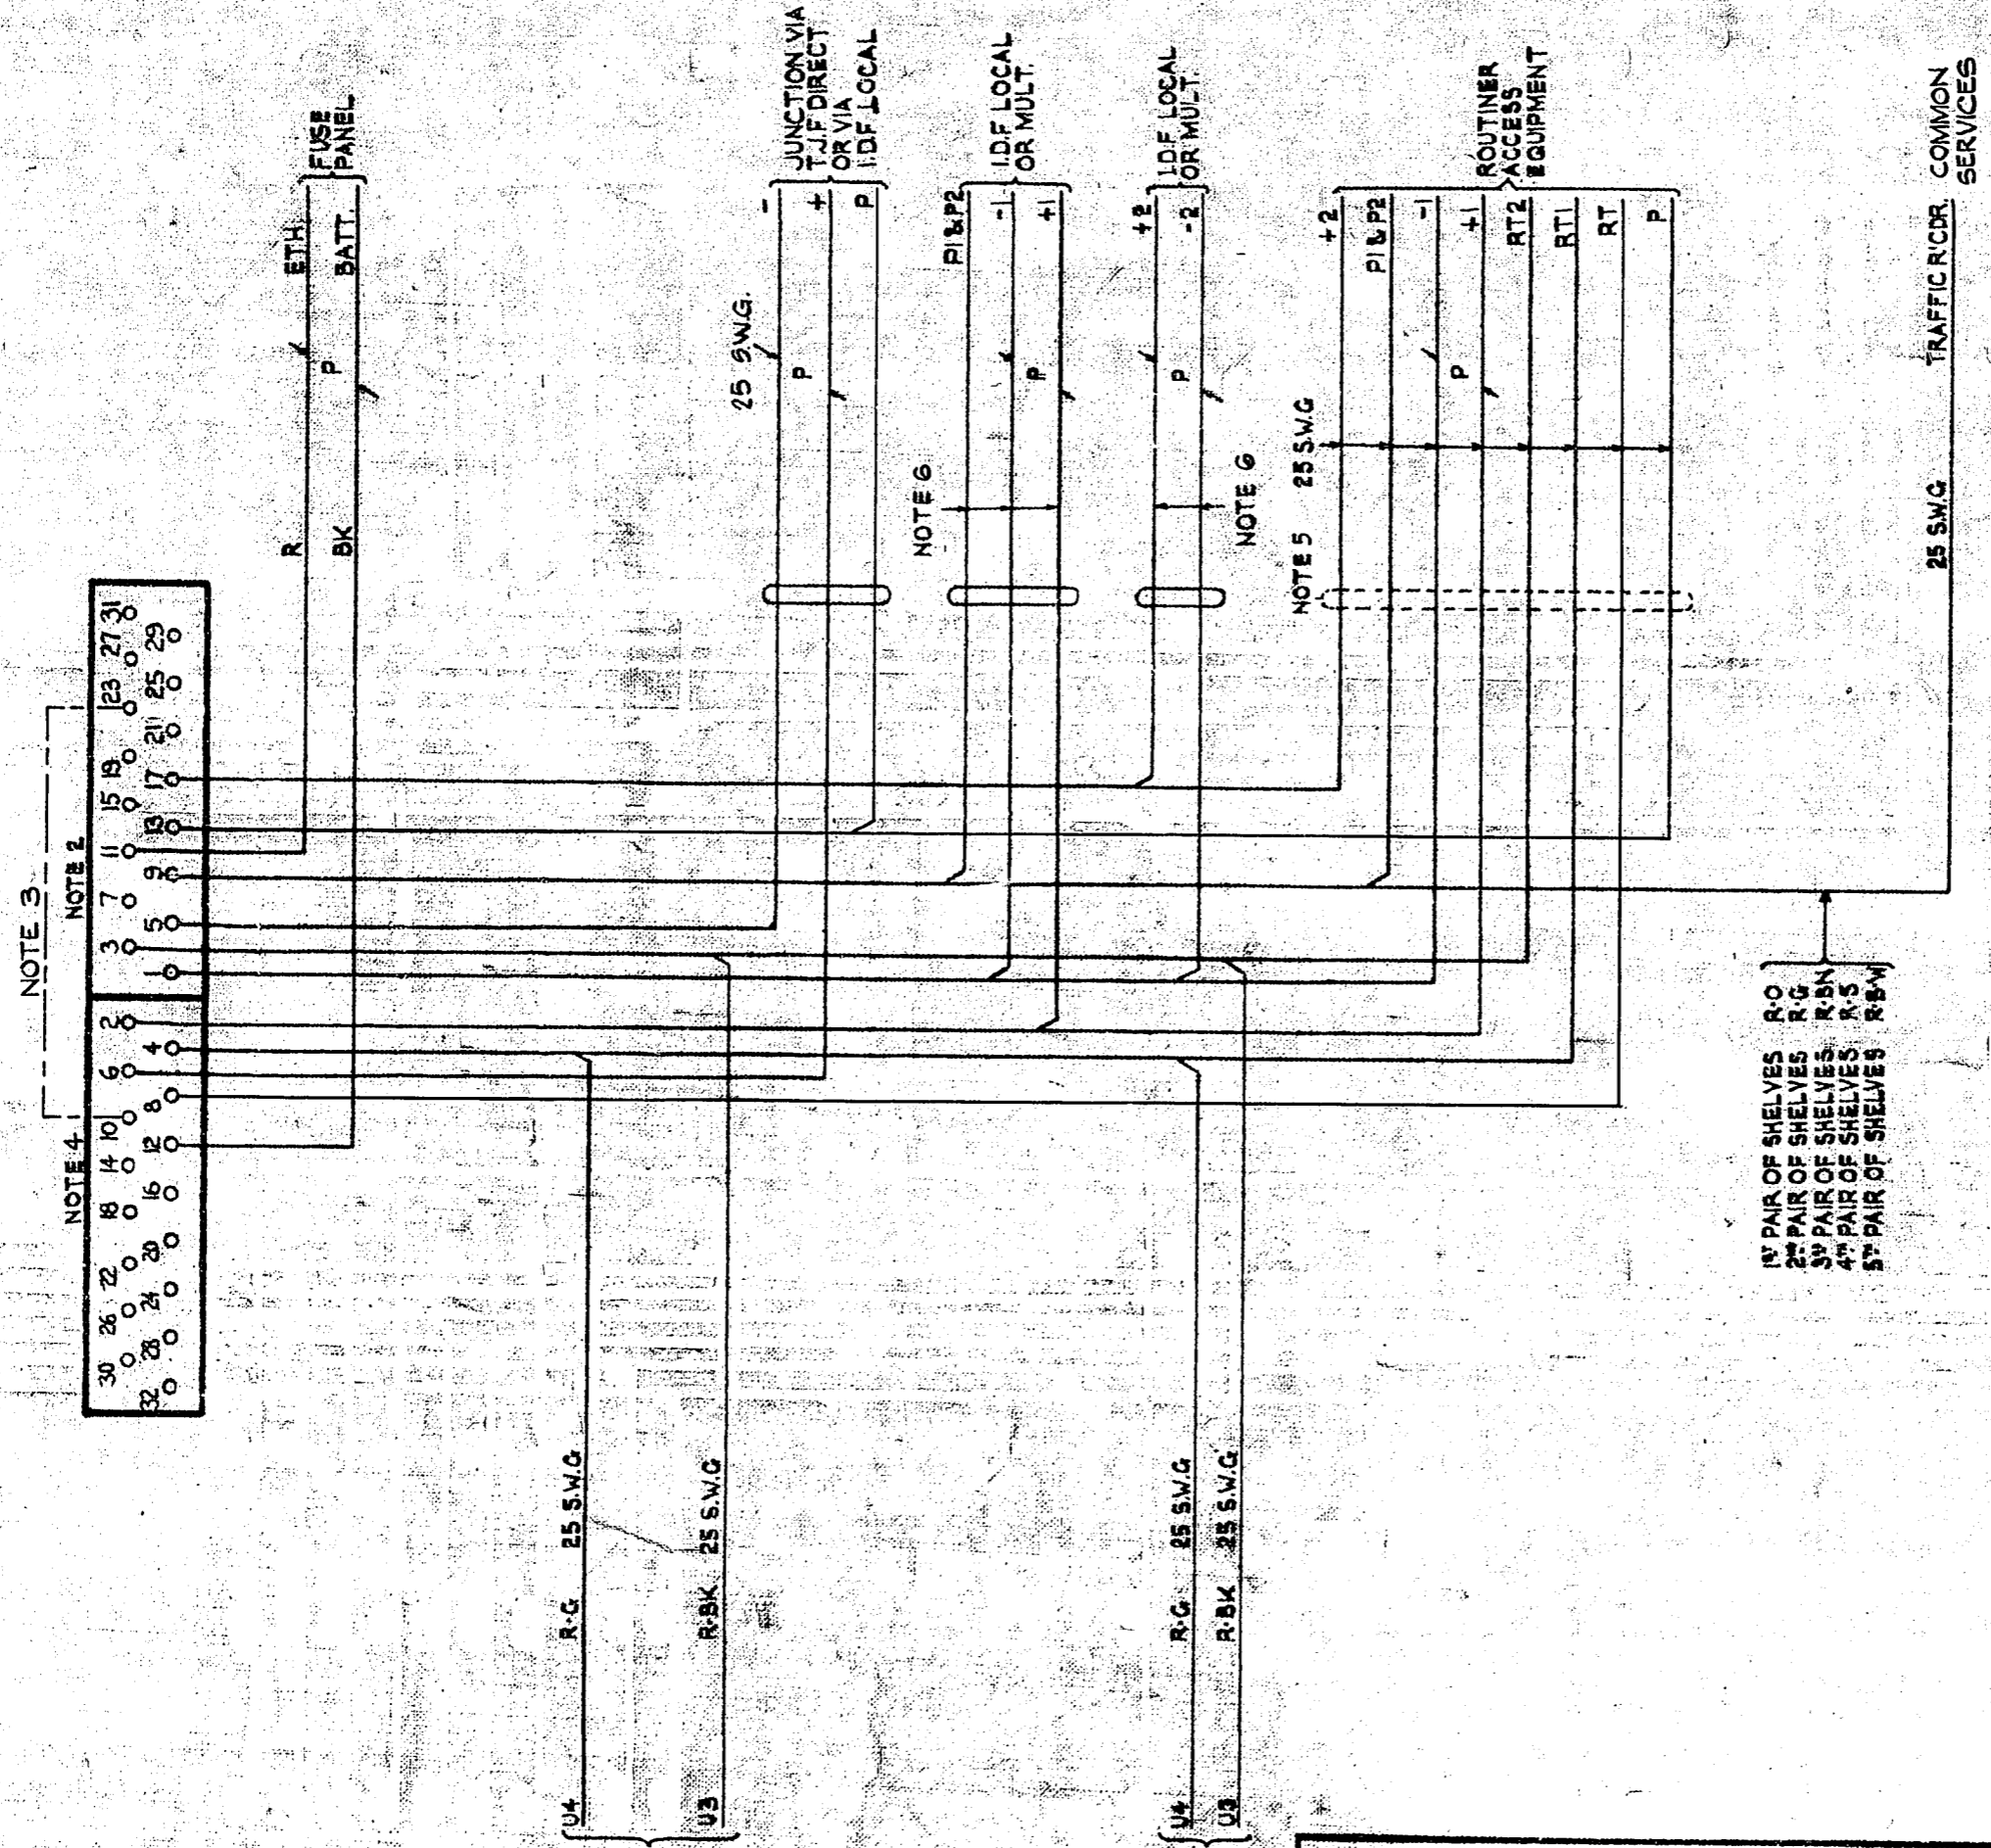

1st PAIR OF SHELVES RO
 2nd PAIR OF SHELVES RG
 3rd PAIR OF SHELVES RBN
 4th PAIR OF SHELVES RS
 5th PAIR OF SHELVES RBW

NOTES:

1. UNLESS OTHERWISE SPECIFIED ALL WIRING TO BE 22 S.W.G.
2. SHELF JACK 'U' POINTS 9 & 11 TO MAKE CONTACT WHEN RELAY SET IS REMOVED
3. STRAP BETWEEN U10 & U23 TO BE REMOVED WHEN THE JUNCTION RESISTANCE IS LESS THAN 200Ω.

4. THESE 'U' POINTS ARE NOT SPARE BUT ARE USED FOR BARRIETER ACCESS.
5. WHEN IN LOCAL CABLE SEE ASSOCIATED ROUTINER ACCESS DIAGRAM FOR COLOURS.
6. THESE LEADS ARE CABLED TO THE IDF EXCEPT UNDER FULL AVAILABILITY CONDITIONS WHEN THE TERMINALS ON THE IDF ARE REPLACED BY TERMINALS ON THE GRP. SELF BANK MULT. STRIP WHERE THERE ARE SEPARATE PI&P2 TERMINALS & 6 WIRE CUTS ARE CABLED DIRECT.

METERING EQUIP. REMOVED. RTE ACC. AMENDED. (7918)				A	10-1-69					
AMENDMENT PARTICULARS				ISSUE	DATE	APPD	REF.			
AUTO TO AUTO RELAY SET FIXED FEG WITH REPEAT METERING								BOY		14
GBU 15770 MOD. A										