AS SEEN FROM REAR

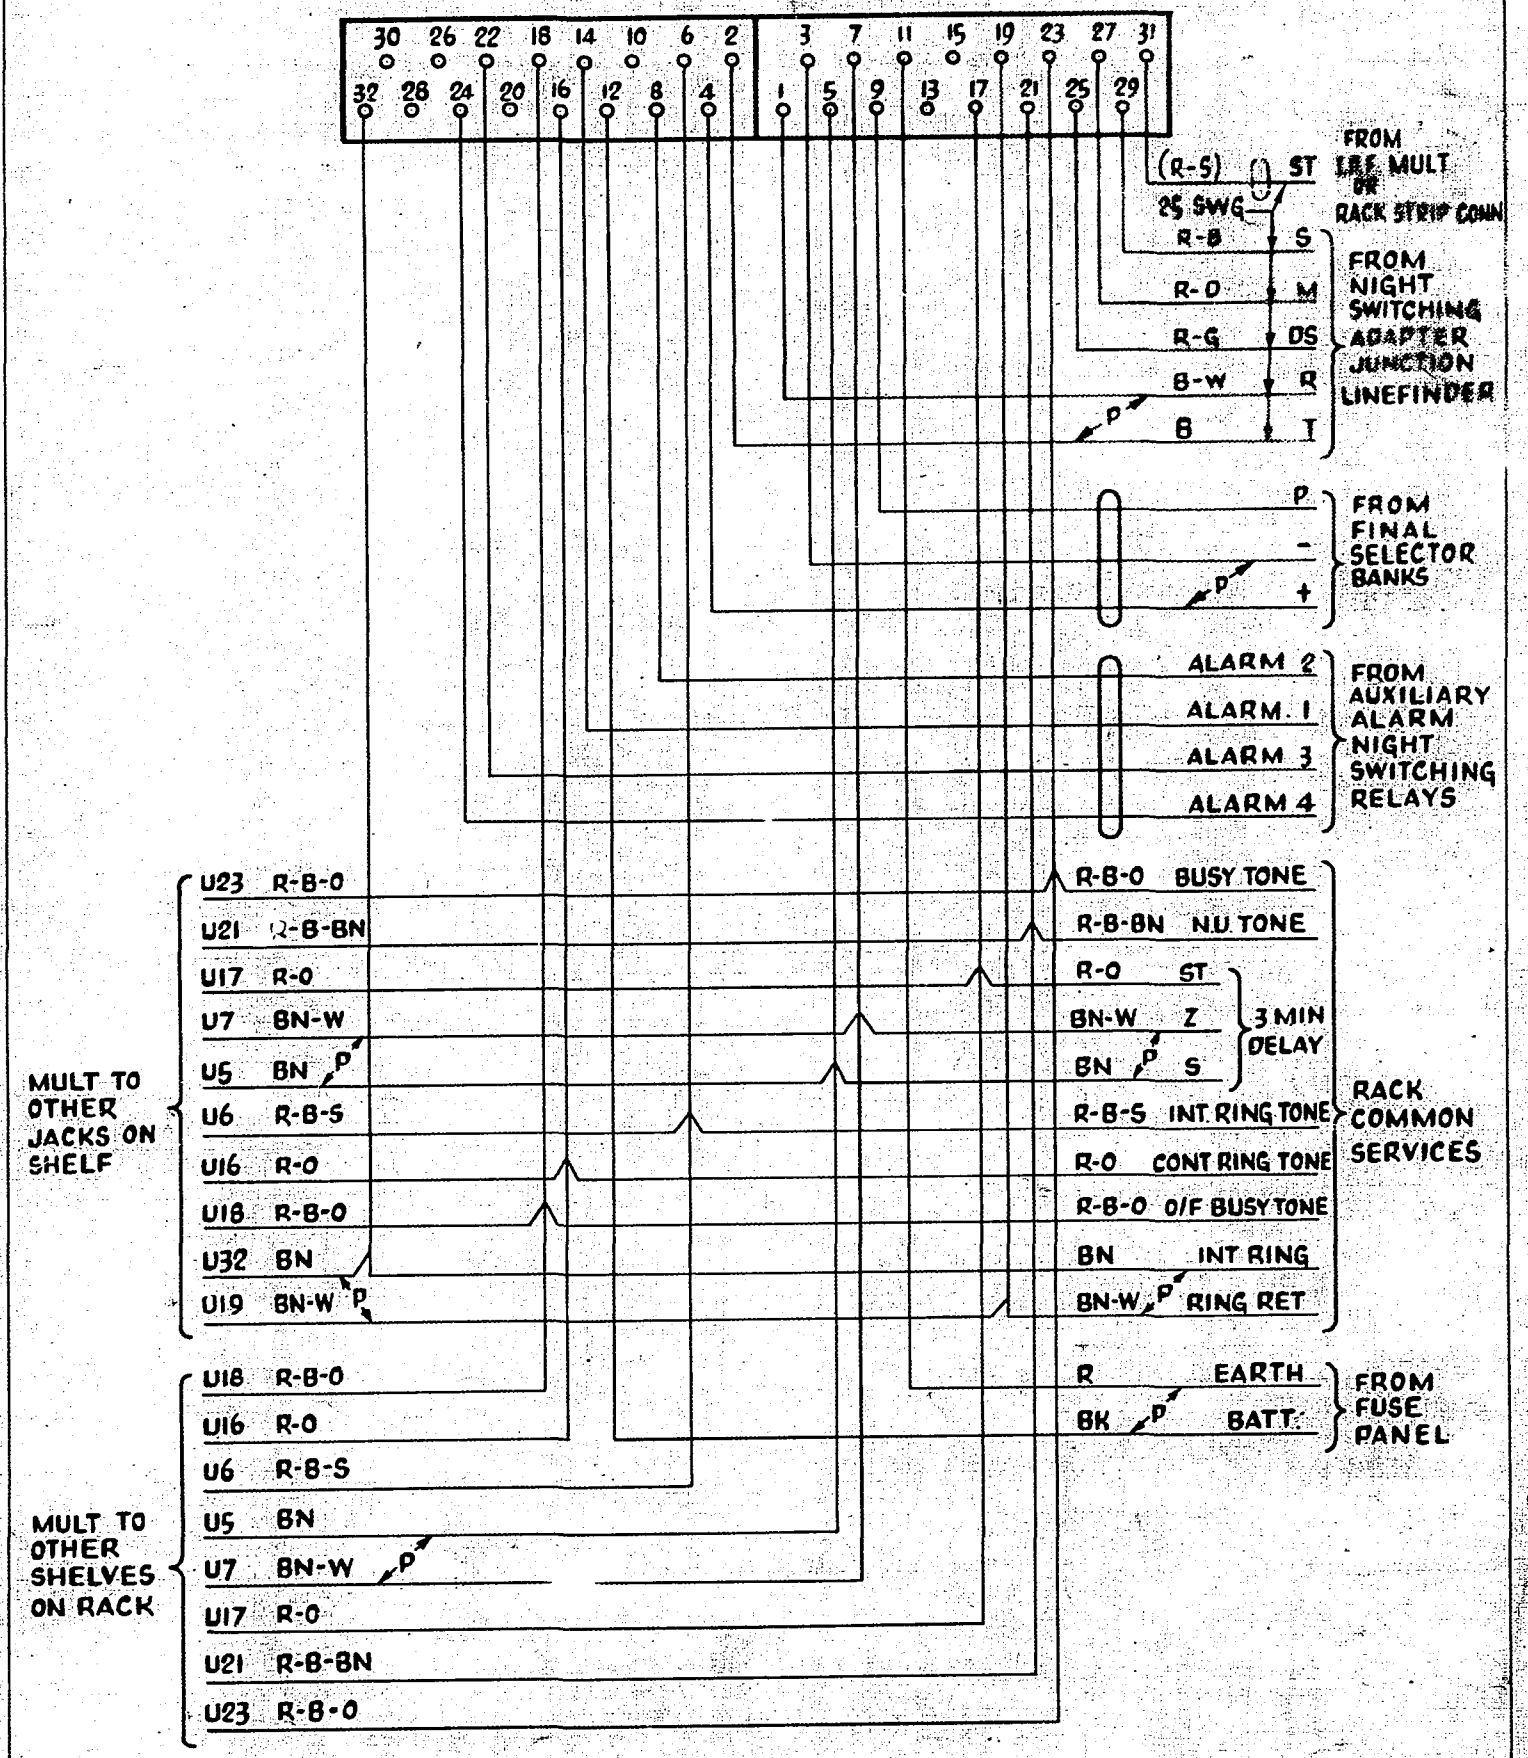

NOTES

1. ALL WIRING TO BE 22 SWG. UNLESS OTHERWISE SPECIFIED

AMENDMENT PARTICULARS	ISSUE	DATE	APP'D
(5G793)	1	26·2·62	

NIGHT SWITCHING
AUXILIARY ALARMS TRANSFER
CIRCUIT
DAY GROUP CENTRE TO TMX
2000 TYPE

REF:- ES117 SCHEME 'C' | 50Y | E

N.Z.P.O			DRAWN	CHECKED WIRING	CIRCUIT

GBU 15840