


5 Centimetres 10 15 20 25 30

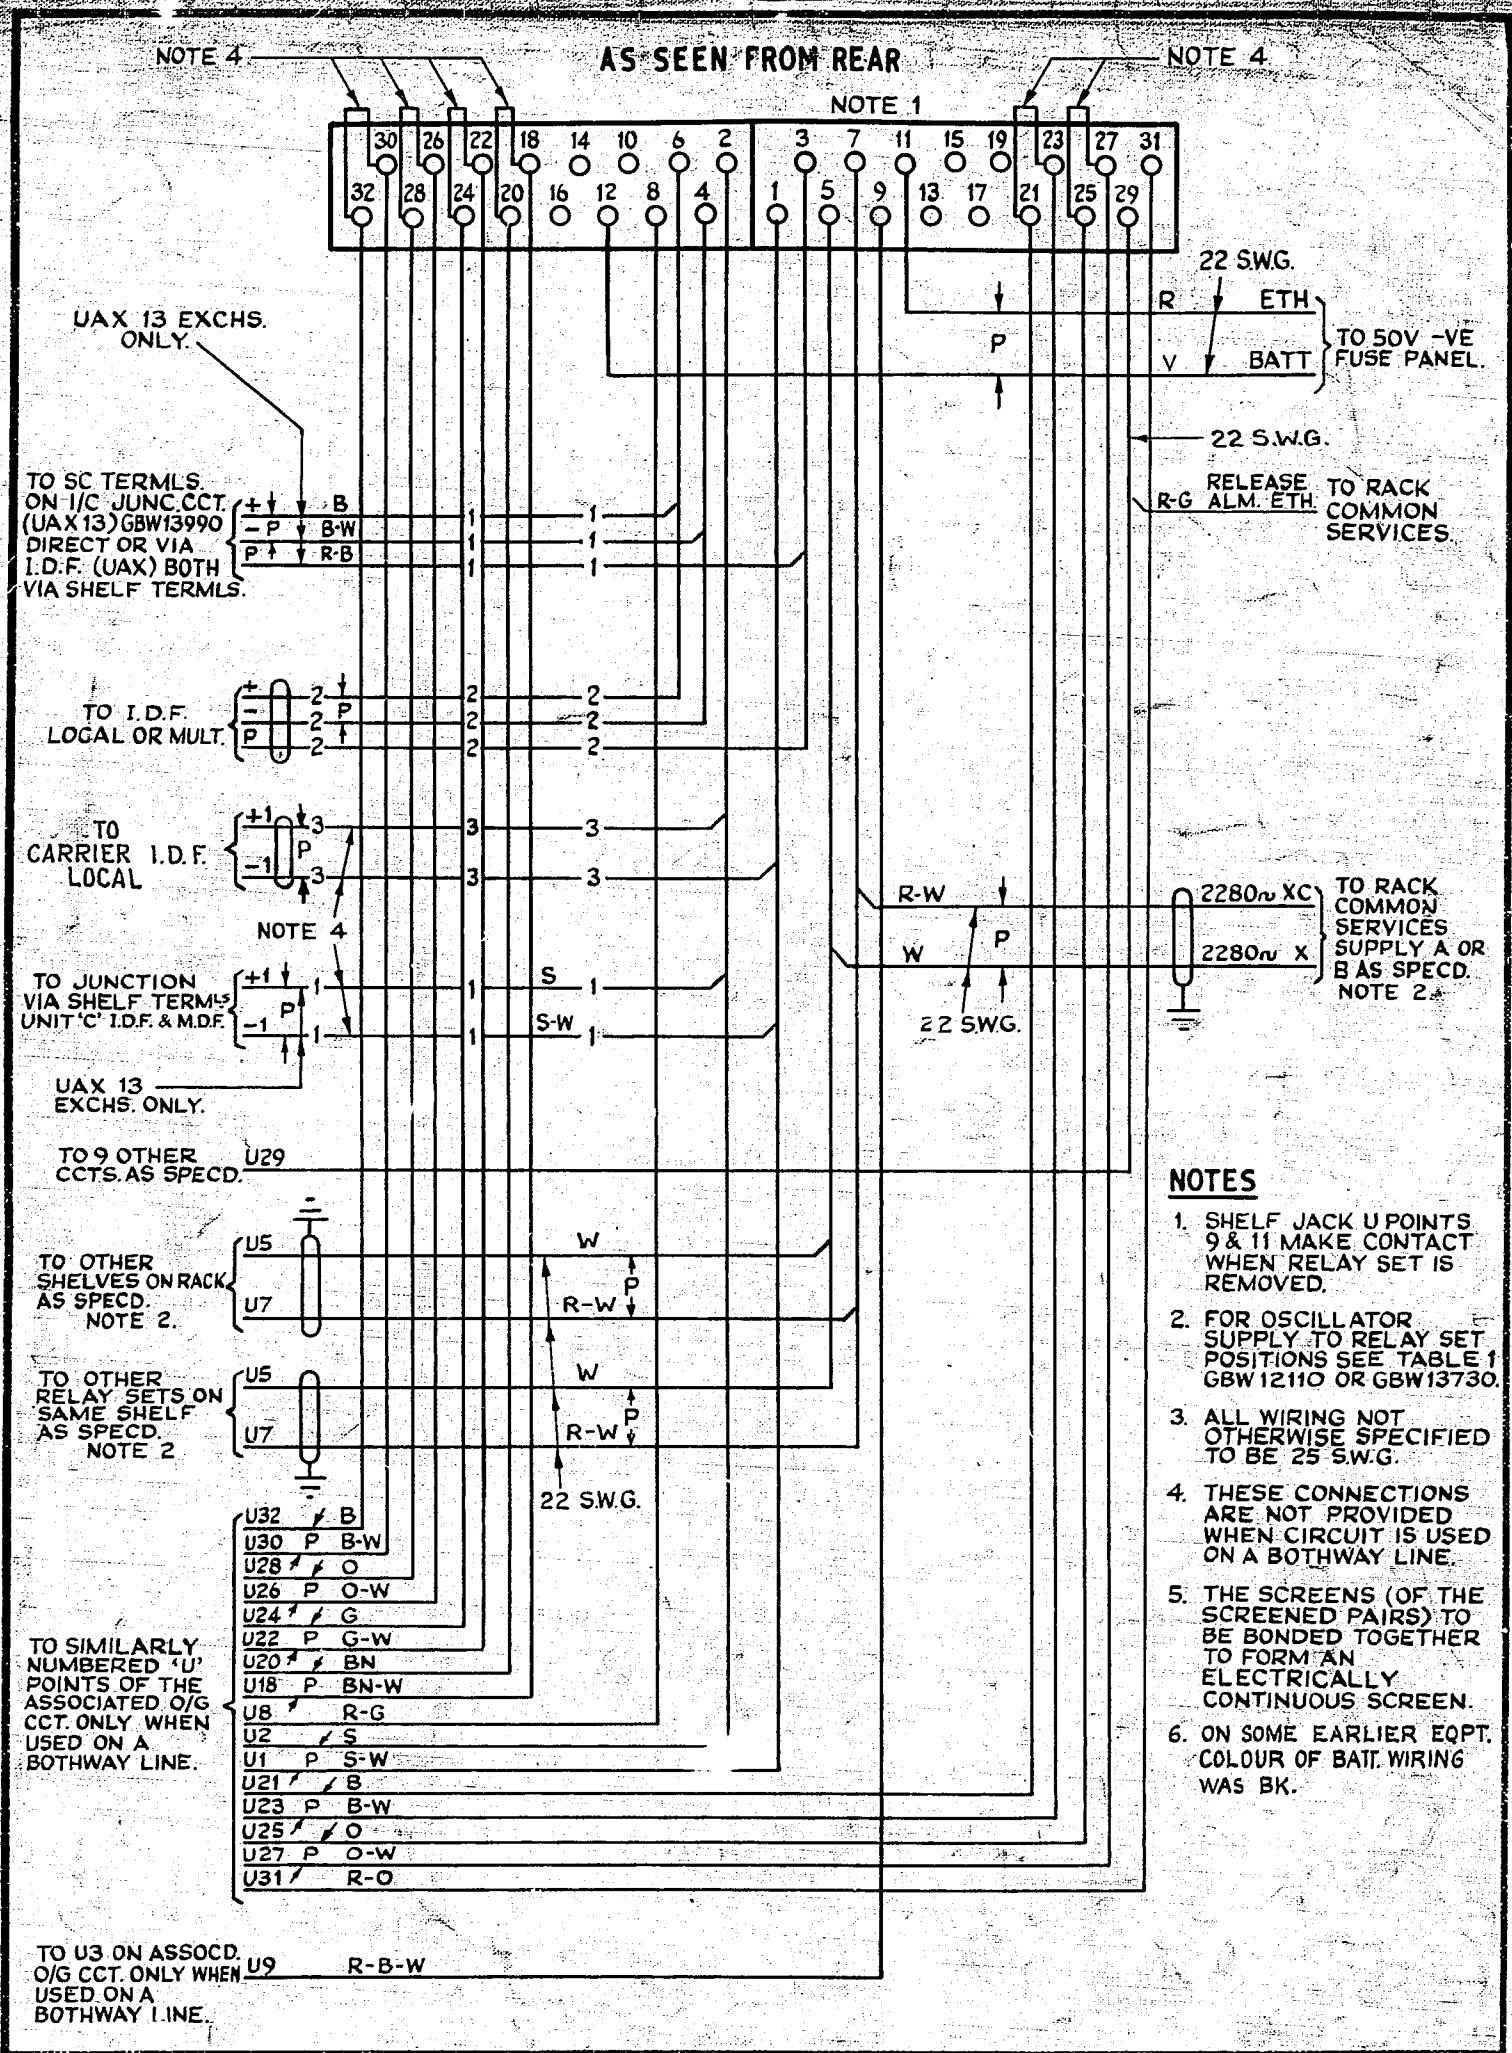

NOTE 6 ADDED (86374)				4	18-11-69	R/D	PARENT EXCHANGE 1/C LINE CIRCUIT FROM DEPENDENT EXCHANGE N.Z. S.S.A.C. No.3T.	50V S
CABLING OF ALTERNATIVE 3-PR. AMENDED (8735)				3	9-12-68	R/D		
REDRAWN TO ADD U.A.X. M.Z. 13 INCOMING CONNECTIONS (58053)				2	2-12-66	J/B		
				1				
AMENDMENT PARTICULARS				ISSUE	DATE	APP.	REF - I/VF	
N.Z.P.O.				DRAWN		CHECKED	WIRING	CIRCUIT
GBU 16500								