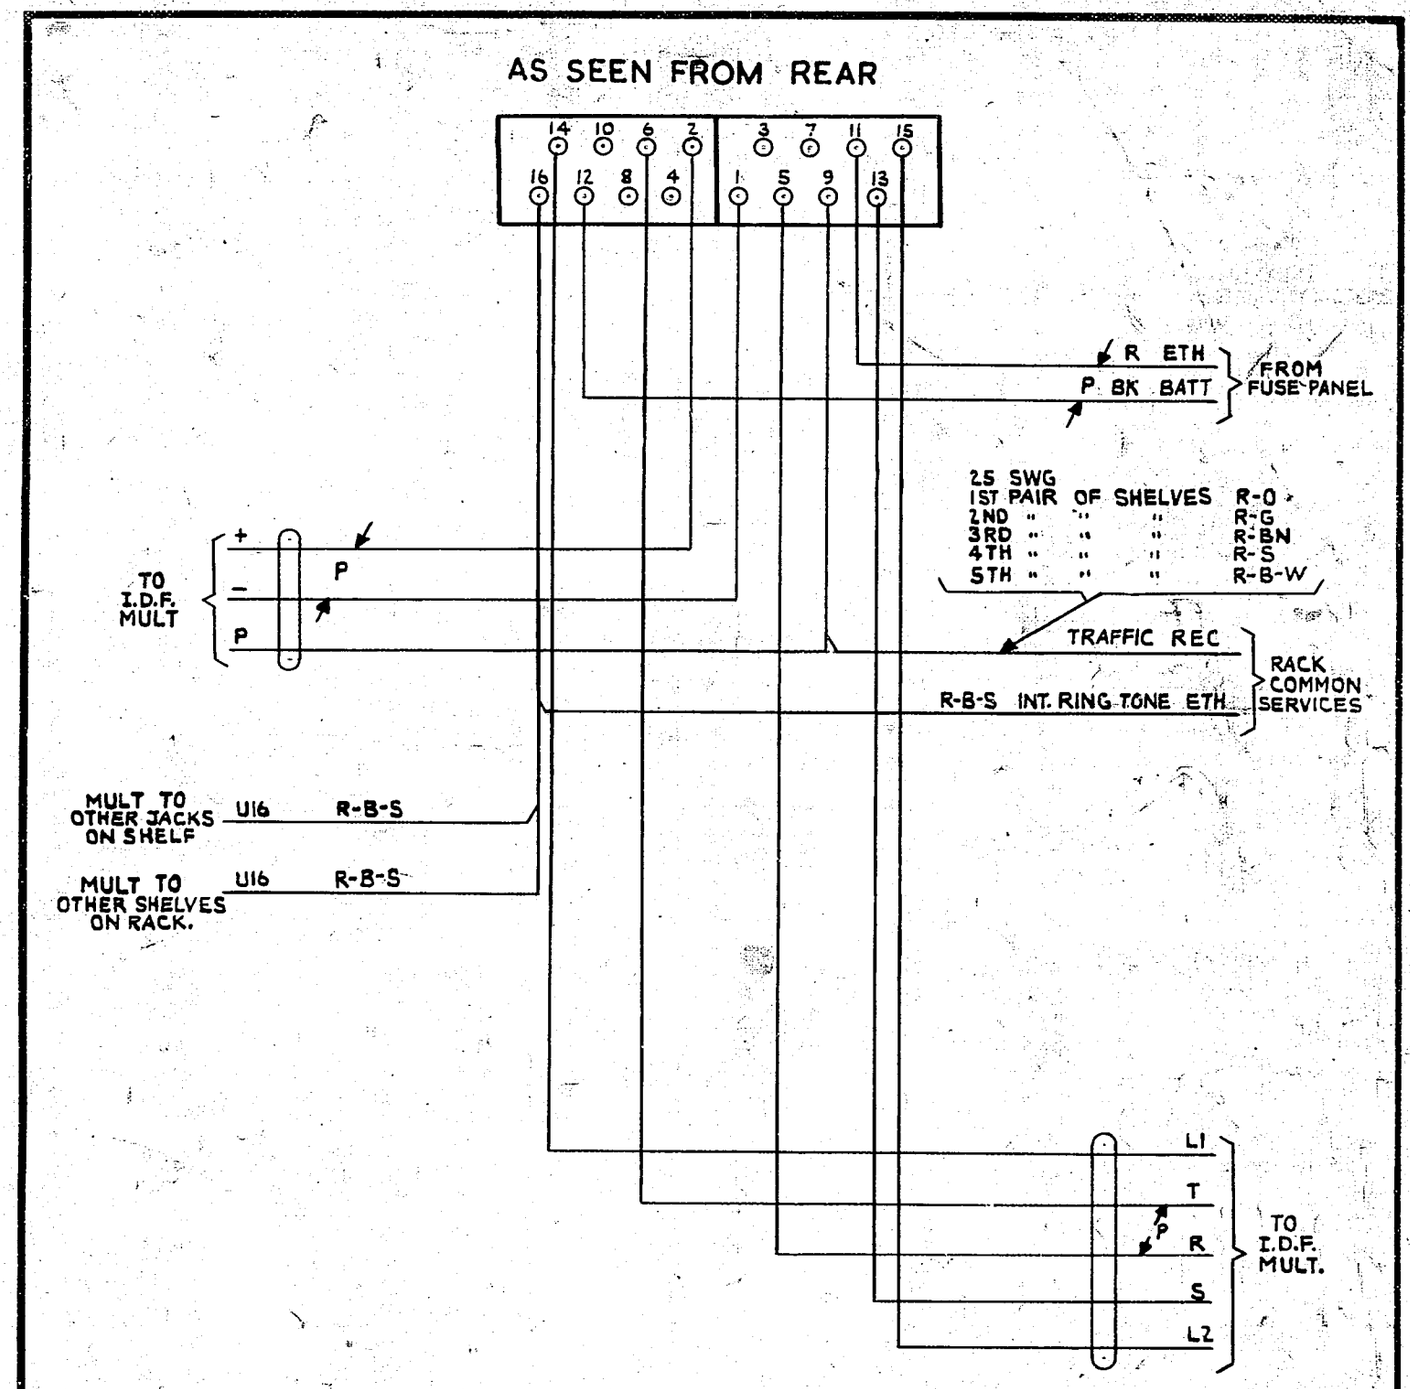

NOTES.

1. SHELF JACK UPTS U9 & U11 TO MAKE CONTACT WHEN RELAY SET IS REMOVED.
2. ALL WIRING TO BE 22 S.W.G. UNLESS OTHERWISE SPECIFIED.

AMENDMENT PARTICULARS	ISSUE	DATE	APP.
(91632)	1	18.1.65	

SELECTOR LEVEL
RELAY SET
SPECIAL SERVICES S.C.S.

REF. 50V S

16650 GBU

N.Z.P.O.	DRAWN H.B.B.	CHECKED	WIRING E.L.	CIRCUIT

A.B