


AS SEEN FROM REAR

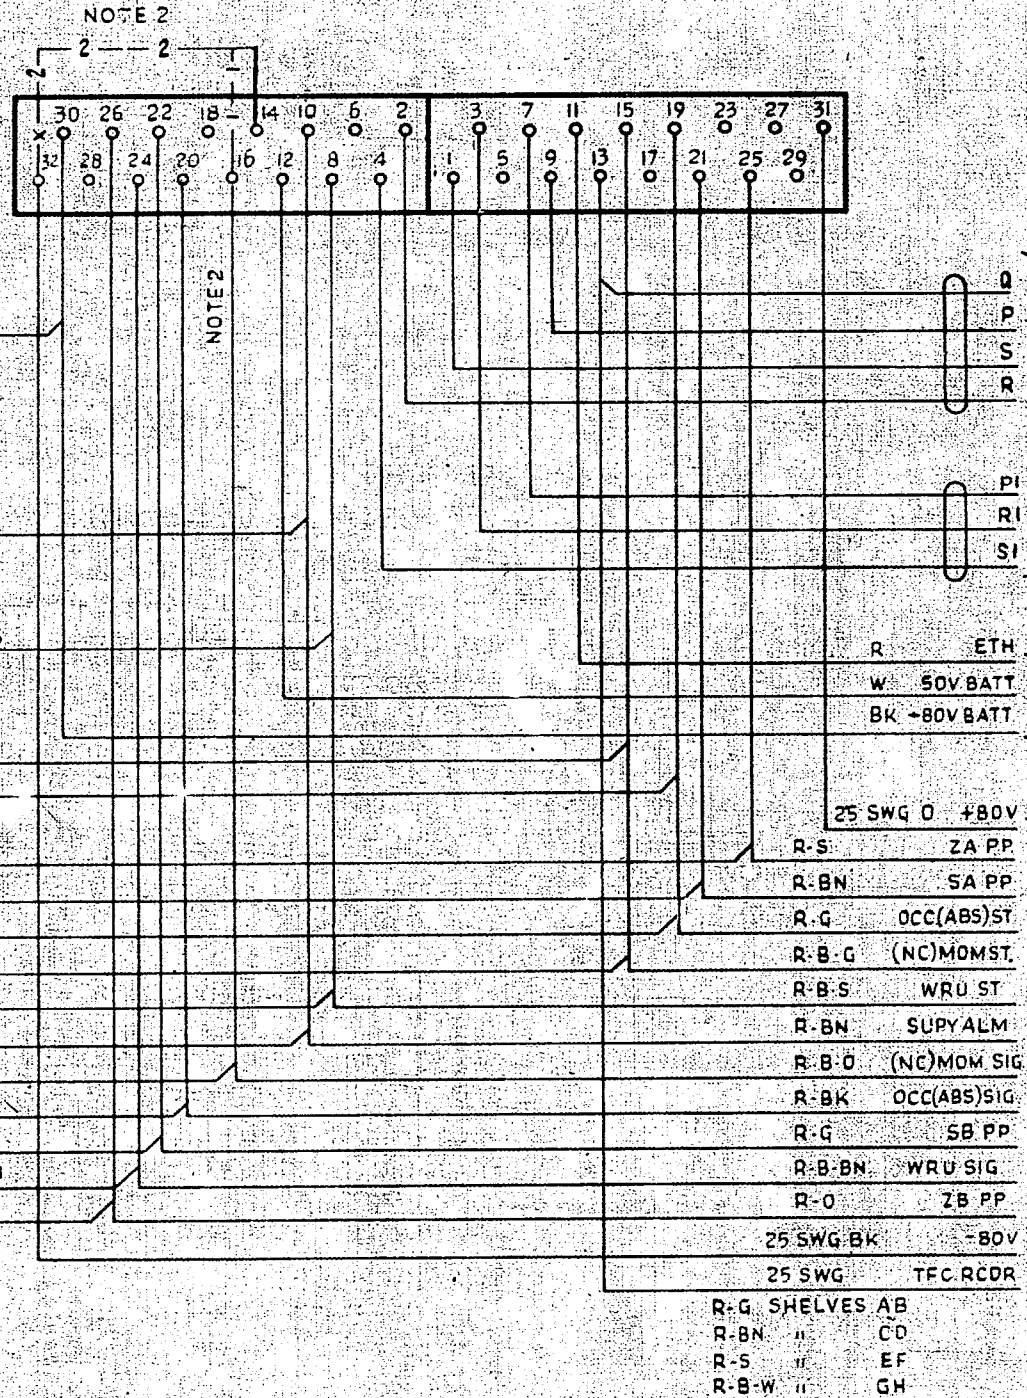

NOTES

- 1 SHELF JACK U POINTS 9 & 11 MAKE CONTACT WHEN RELAY SET IS REMOVED
- 2 WHEN RELAY SET IS USED TO SERVE TEST POSITIONS STRAP U14 TO U16. WHEN RELAY SET IS USED TO SERVE OTHER THAN TEST POSITIONS STRAP U14 TO U16 IS OMITTED AND U14 IS STRAPPED TO U32.
- 3 WIRING NOT OTHERWISE SPECIFIED TO BE 22 SWG.

				AUTOMATIC TELEX SYSTEM	
				LEVEL RELAY SET	
				OUTGOING TO SERVICE POSITION	
		(10503)	1	27-3-63	
AMENDMENT PARTICULARS		ISSUE DATE	APPRO.	50V	E
NZPO		DRAWN	CHECKED	WIRING	CIRCUIT
				GBU 17050	