


AS SEEN FROM REAR

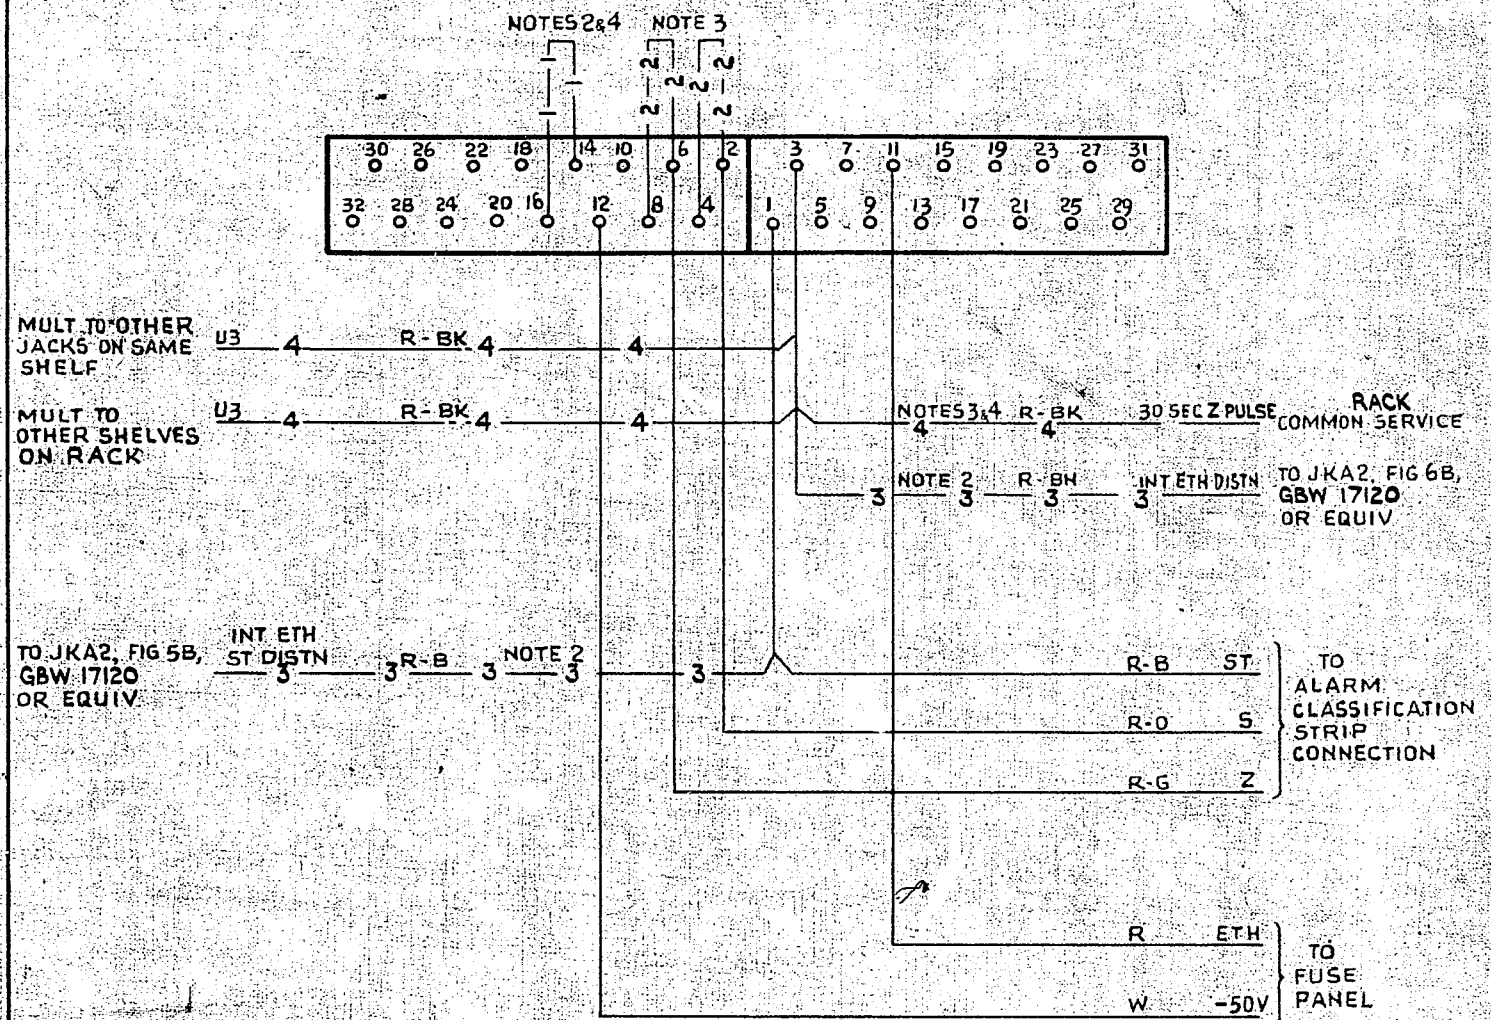

NOTES

1. ALL WIRING TO BE 22 SWG
2. FOR 9 SEC ALARM DELAY USE CONNECTIONS
3-3 AND 1-1
3. FOR 3 MIN ALARM DELAY USE CONNECTIONS
4-4 AND 2-2
4. FOR 6 MIN ALARM DELAY USE CONNECTIONS
4-4 AND 1-1
5. SHELF JACK U-POINTS 9 & 11 TO MAKE CONTACT WHEN RELAY SET IS REMOVED.

					AUTOMATIC TELEX SYSTEM DELAYED ALARM AND INTERRUPTED EARTH DISTRIBUTION	
(10503)					27-3-63	<i>lee</i>
AMENDMENT PARTICULARS			ISSUE	DATE	APPD	50V E
NZPO			DRAWN	CHECKED	WIRING	CIRCUIT
GBU 17120						

