
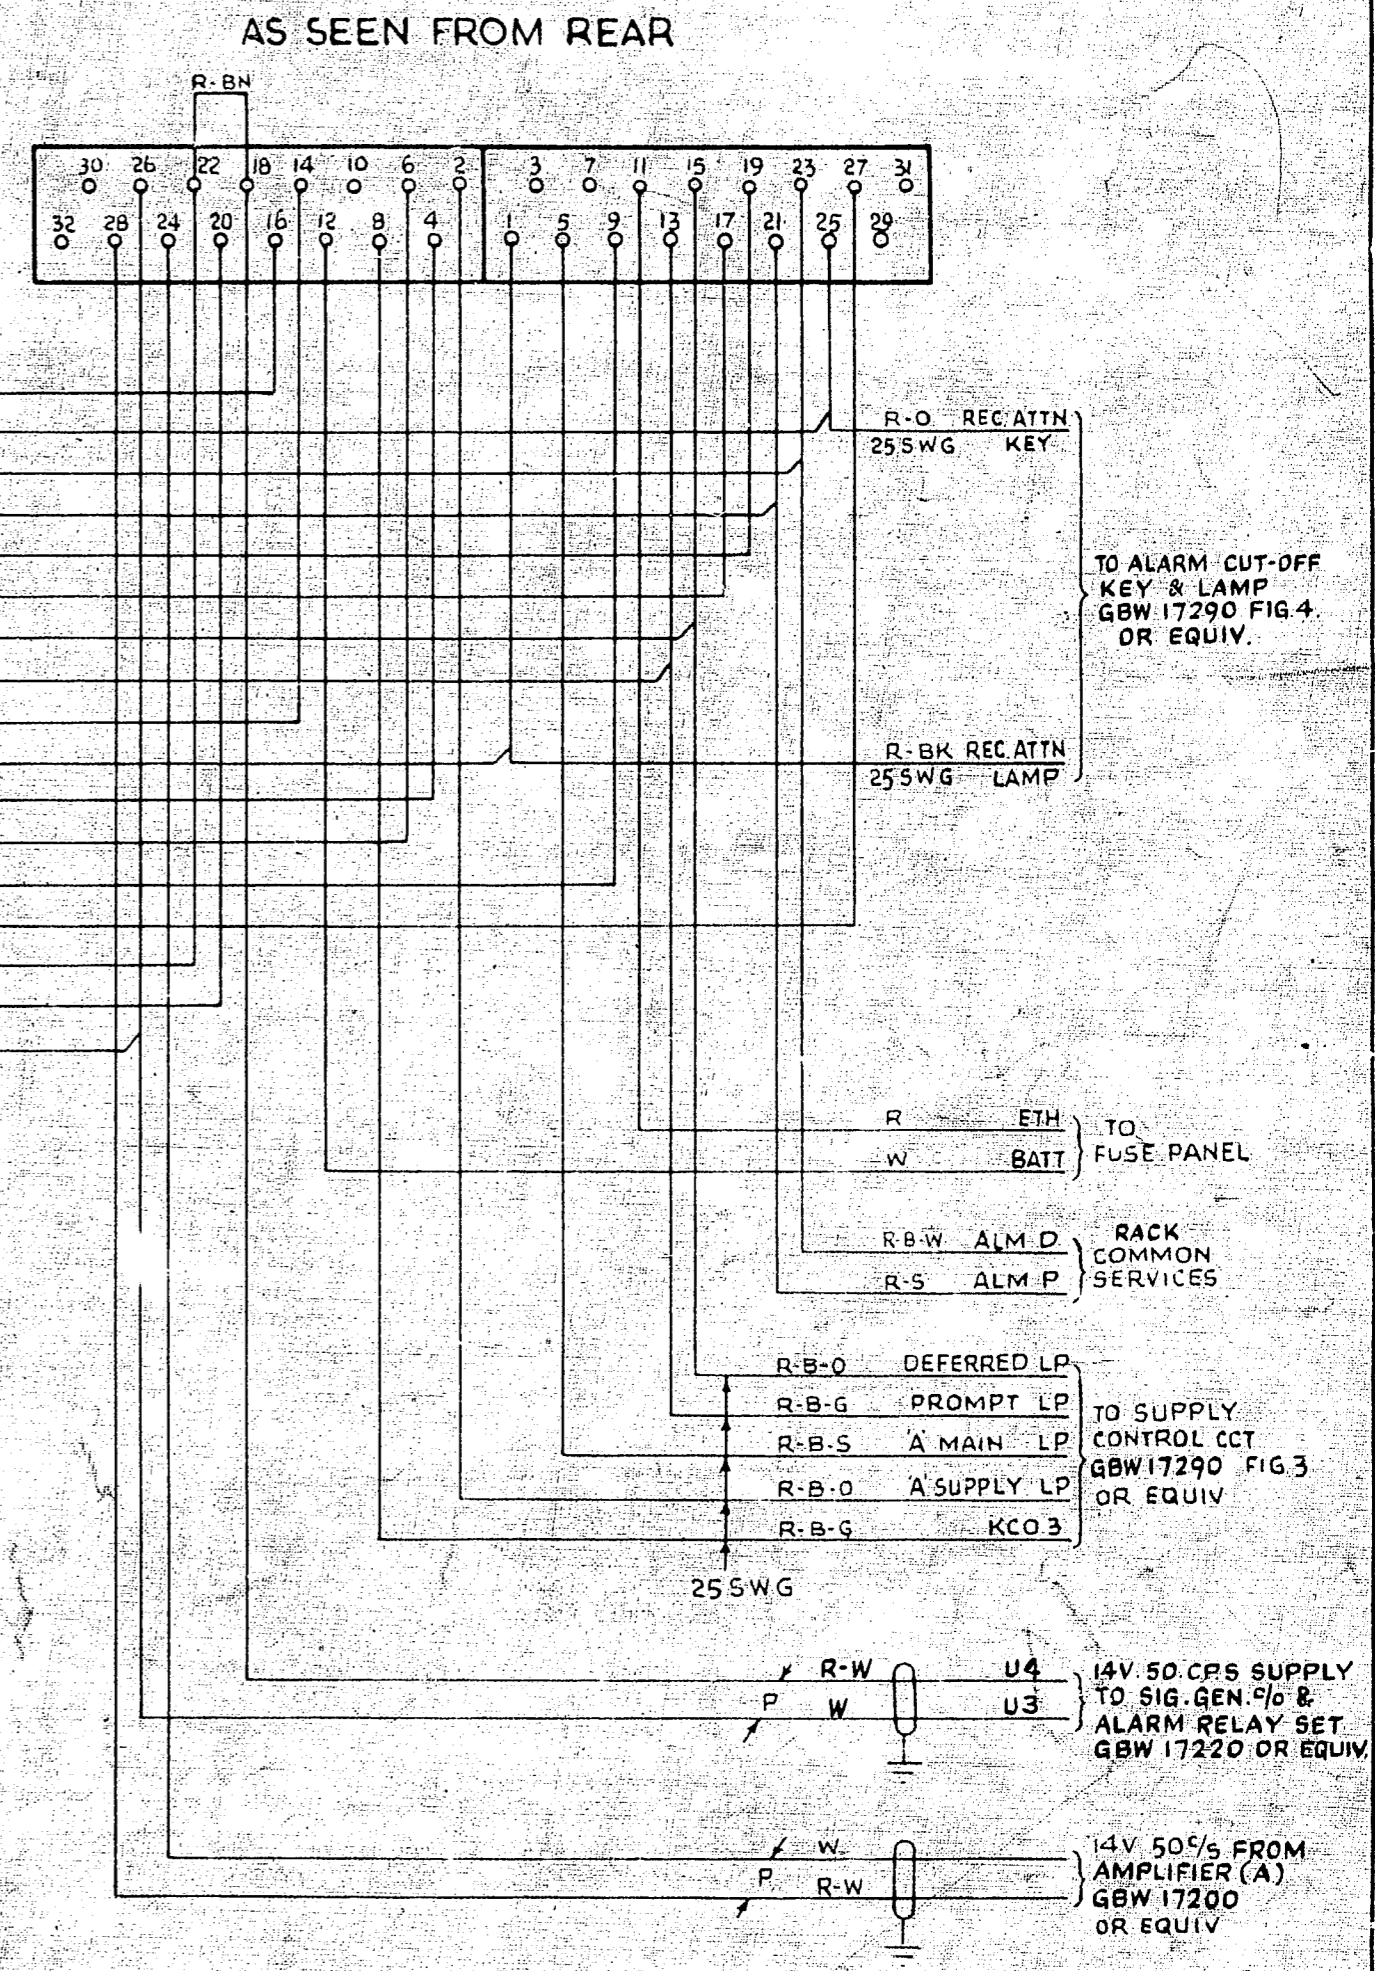


FIG 2 50~ FORK SUPPLY CHANGEOVER & ALARM RELAY SET (B)

FIG 1 50~ FORK SUPPLY CHANGEOVER & ALARM RELAY SET (A)

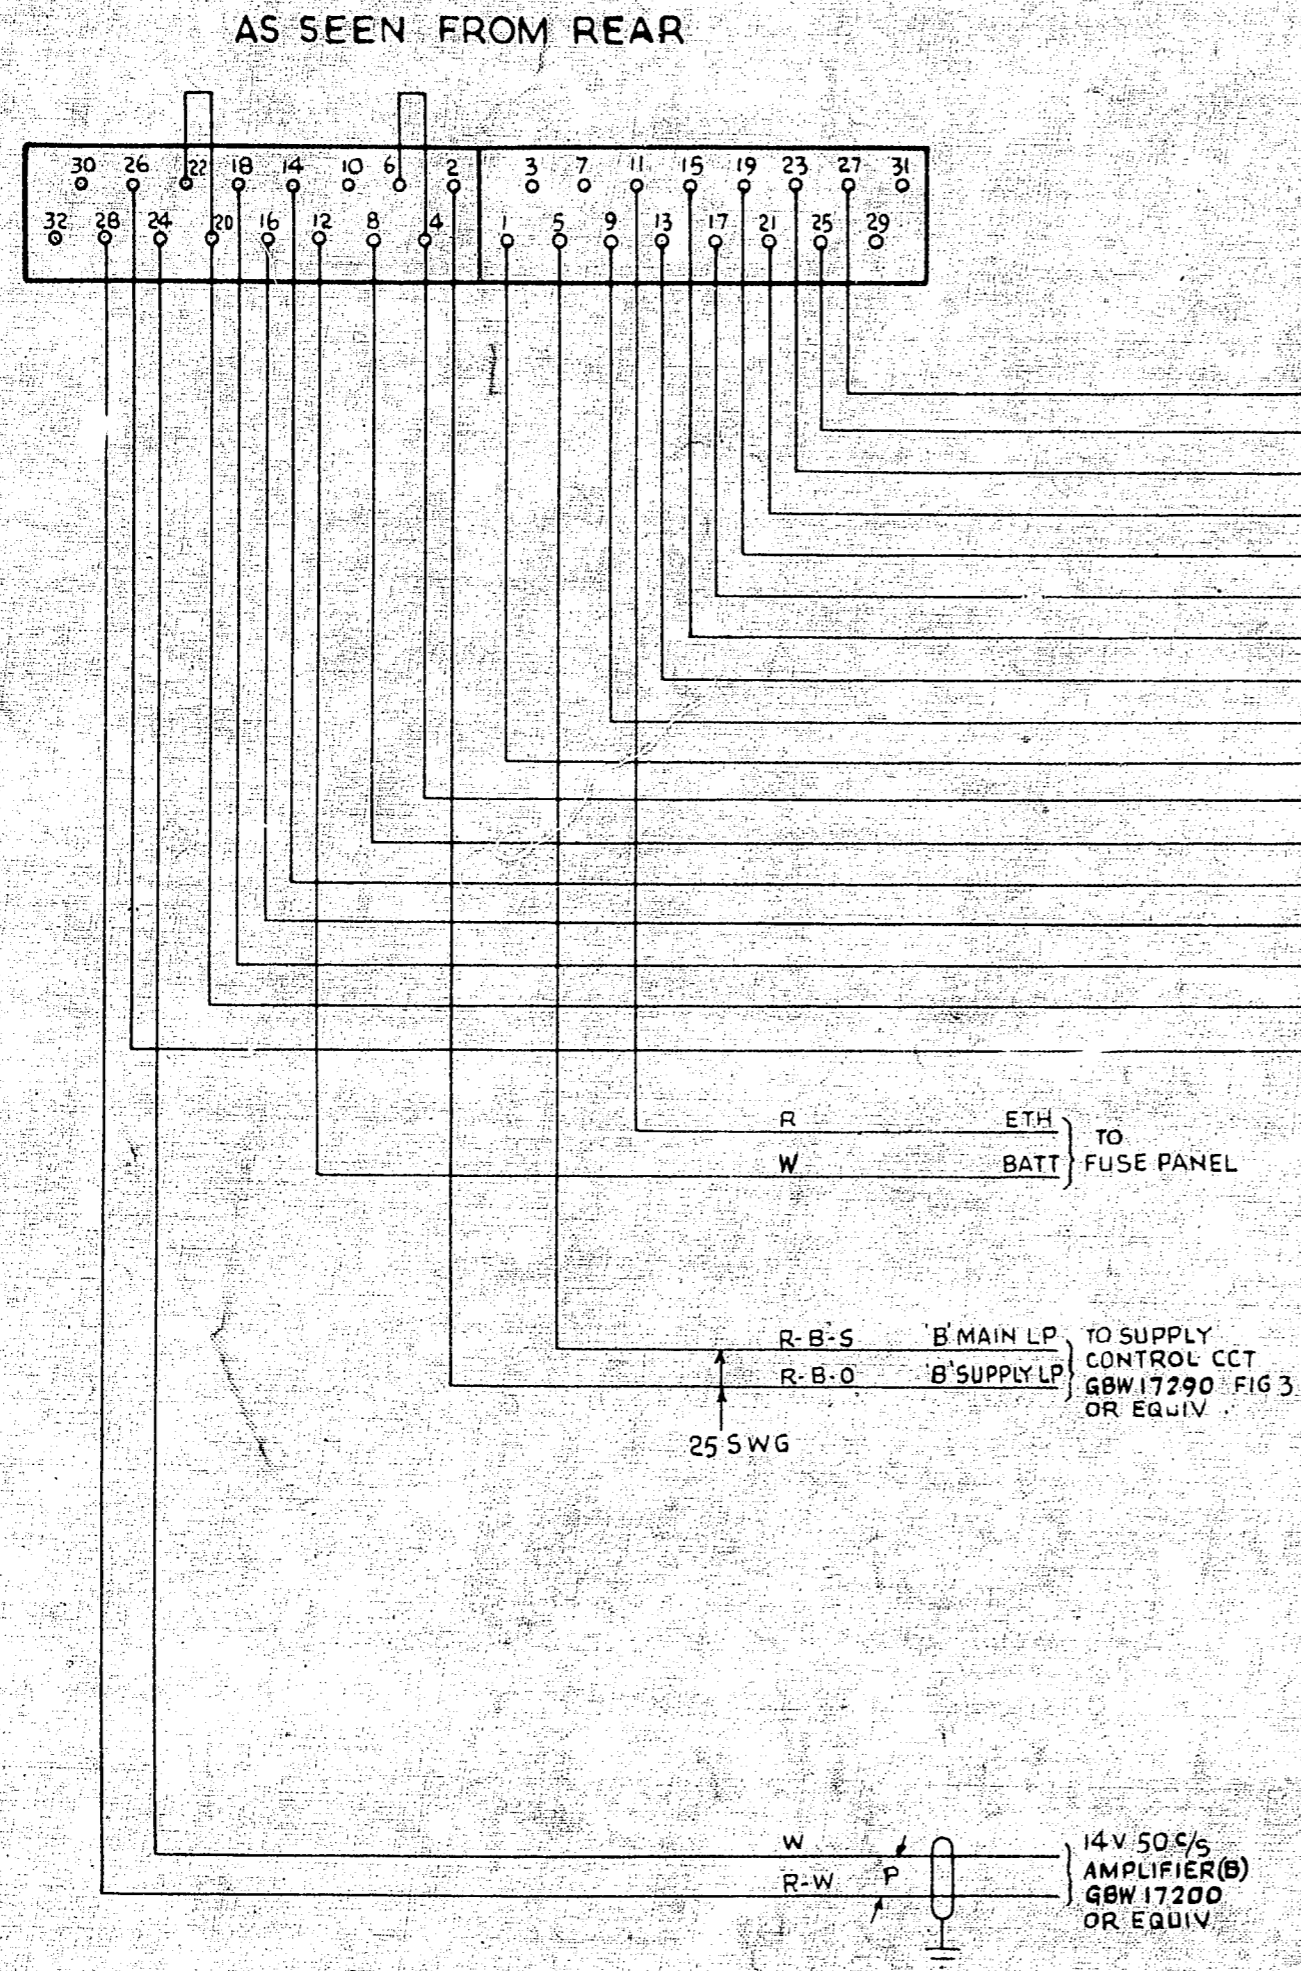

NOTES

1. SHELF JACK U POINTS 9 & 11 MAKE CONTACT WHEN RELAY SET IS REMOVED
2. WIRING NOT OTHERWISE SPECIFIED TO BE 22 SWG

				AUTOMATIC TELEX SYSTEM	
				50% SUPPLY	
				CHANGEOVER AND	
				ALARM RELAY SET	
(70675)		1	19.4.63	Flu	
AMENDMENT PARTICULARS		ISSUE	DATE	APPP	50V E
NZPO		DRAWN	CHECKED	WIRING CIRCUIT	GBU 17290

Centimetres 5 10 15 20 25 30