


AS SEEN FROM REAR

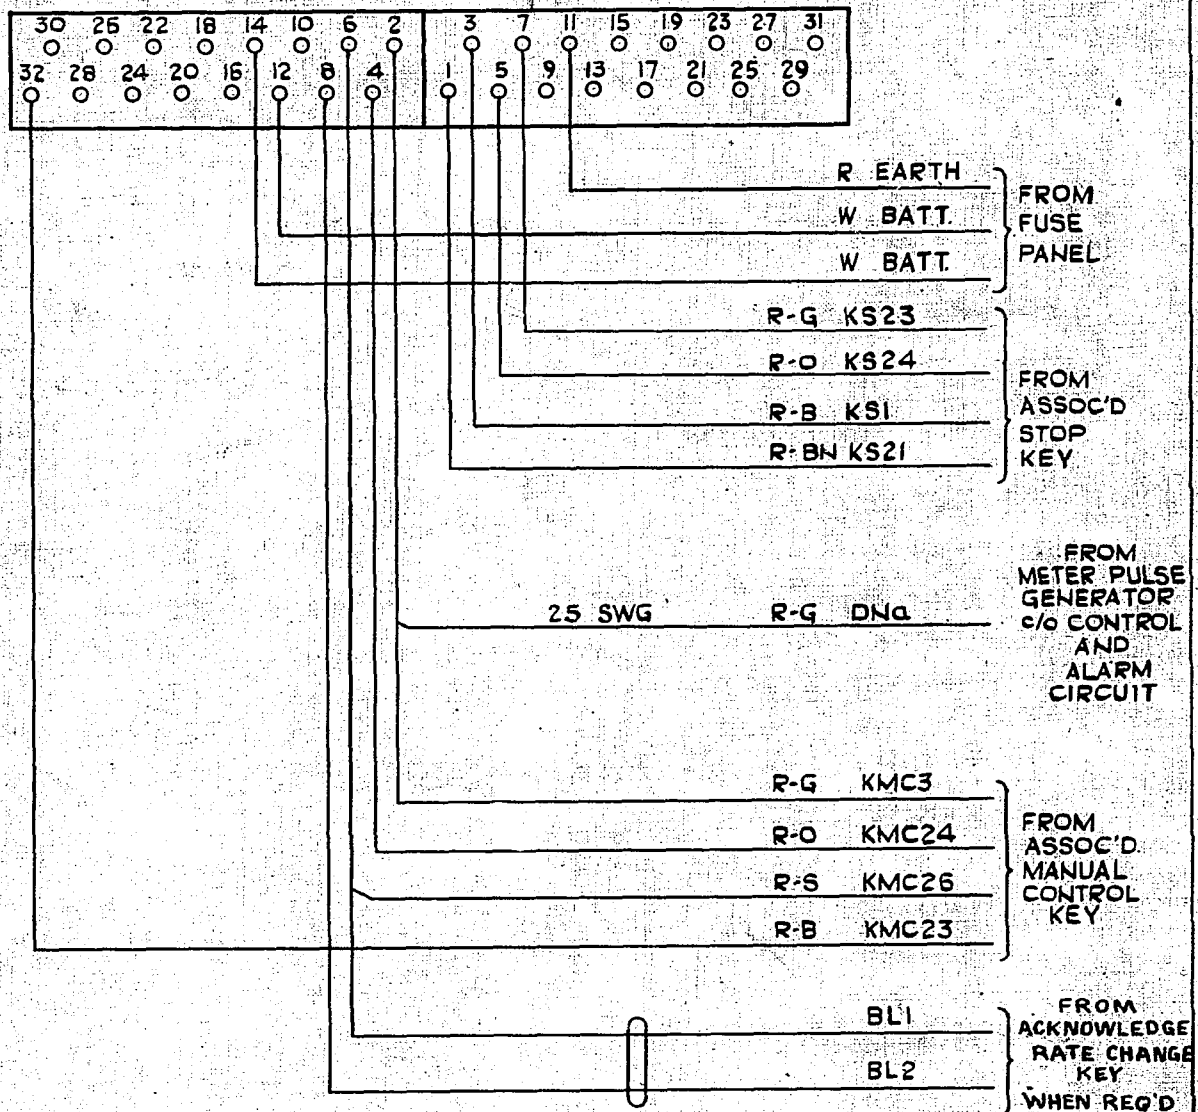

NOTES

1. ALL WIRING TO BE 22 SWG. UNLESS OTHERWISE SPECIFIED.
2. SHELF JACK U-POINTS 9&11 TO MAKE CONTACT WHEN RELAY SET IS REMOVED.

AUTOMATIC TELEX SYSTEM
 AUTOMATIC CONTROL CIRCUIT
 OF PERIODIC PULSE METERING
 DAY & NIGHT PULSE RATES

				(77163)		2-5-63		[Signature]	
AMENDMENT PARTICULARS				ISSUE	DATE	APP'D		SOV	E
NZ.P.O.				DRAWN	CHECKED	WIRING	CIRCUIT	GBU 17680	

0
5 Centimetres
10
15
20
25
30