

Centimetres

10

15

20

25

30

N.Z.P.O.	DRAWN	CHECKED	WIRING	CIRCUIT	GBU 17720	ELECTRONIC REGENERATIVE TELEGRAPH REPEATER PANEL TELEGRAPH No 92A			80V 150V	F
						AMENDMENT PARTICULARS (79952)	ISSUE 1	DATE 14.6.63		

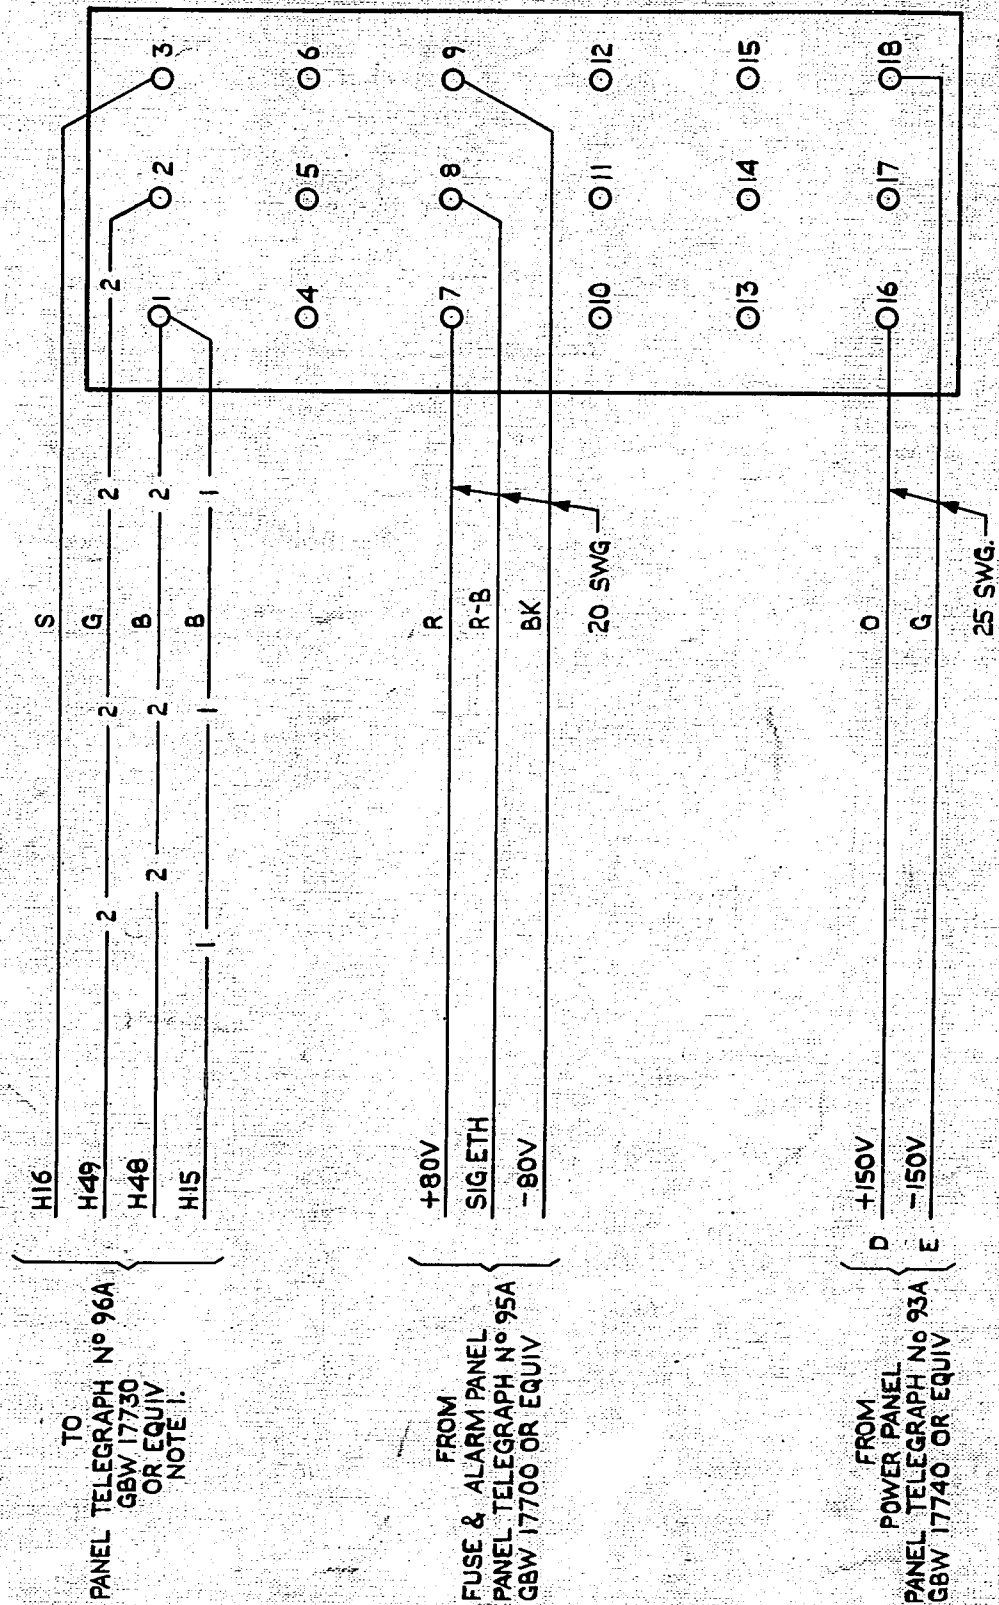


FIG. 1 STRIP CONNECTION 'A'

NOTES

- 1. IF REPEATER TEST JACKS ARE REQUIRED USE CONNECTIONS SHOWN — 2 — 2 — IN LIEU OF THAT SHOWN — 1 — 1 —

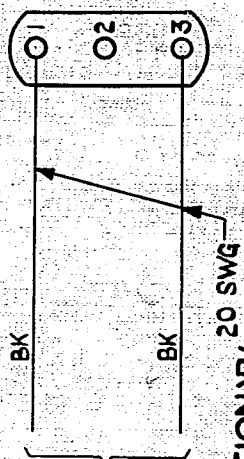


FIG. 2 STRIP CONNECTION 'B'