

0
5 Centimetres
10
15
20
25
30

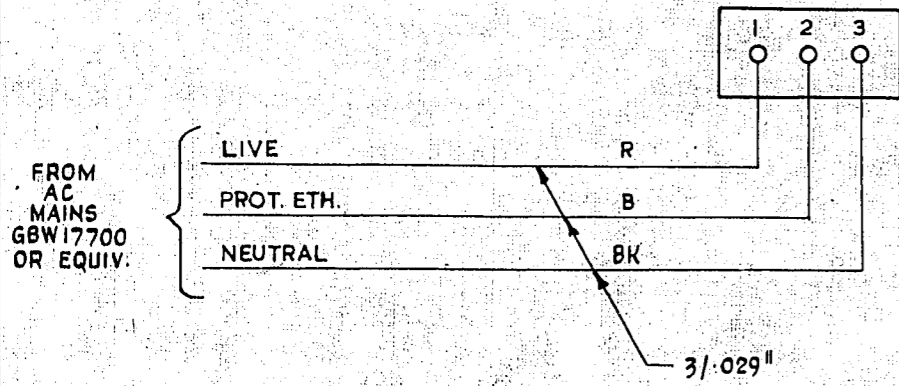


FIG. 1. STRIP CONNEXION C

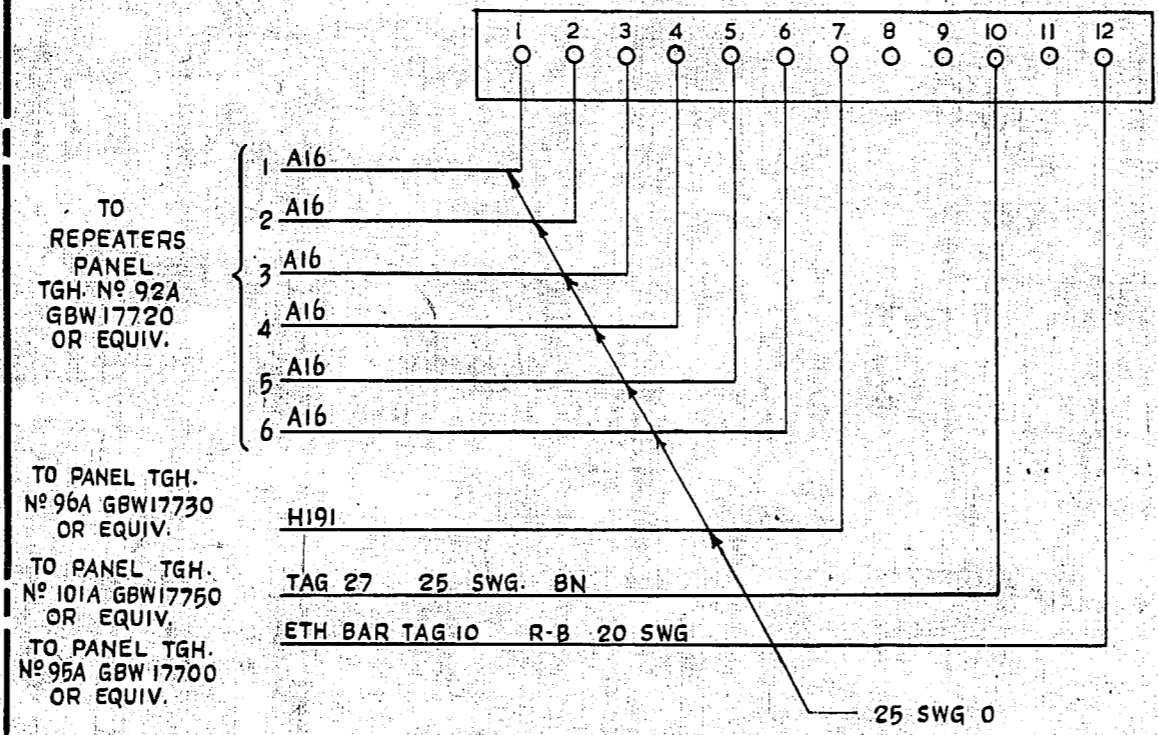


FIG. 2. STRIP CONNEXION D

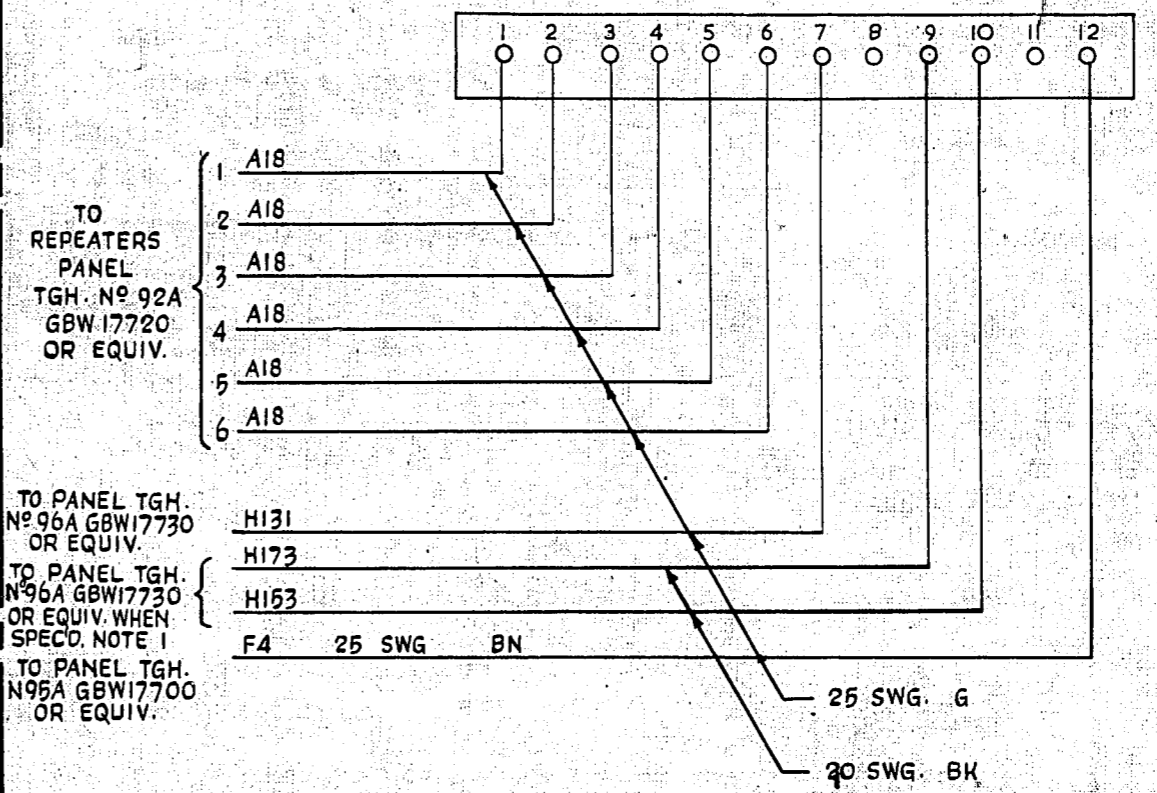


FIG. 3. STRIP CONNEXION E

NOTES
1. THE 6.3 VOLT FEED FROM TAGS E9 AND 10 TO THE PANEL TG N° 96A IS ONLY REQUIRED WHEN THE REPEATER RACK IS INSTALLED AT A SMALL STATION WHERE A TESTER IS USED.

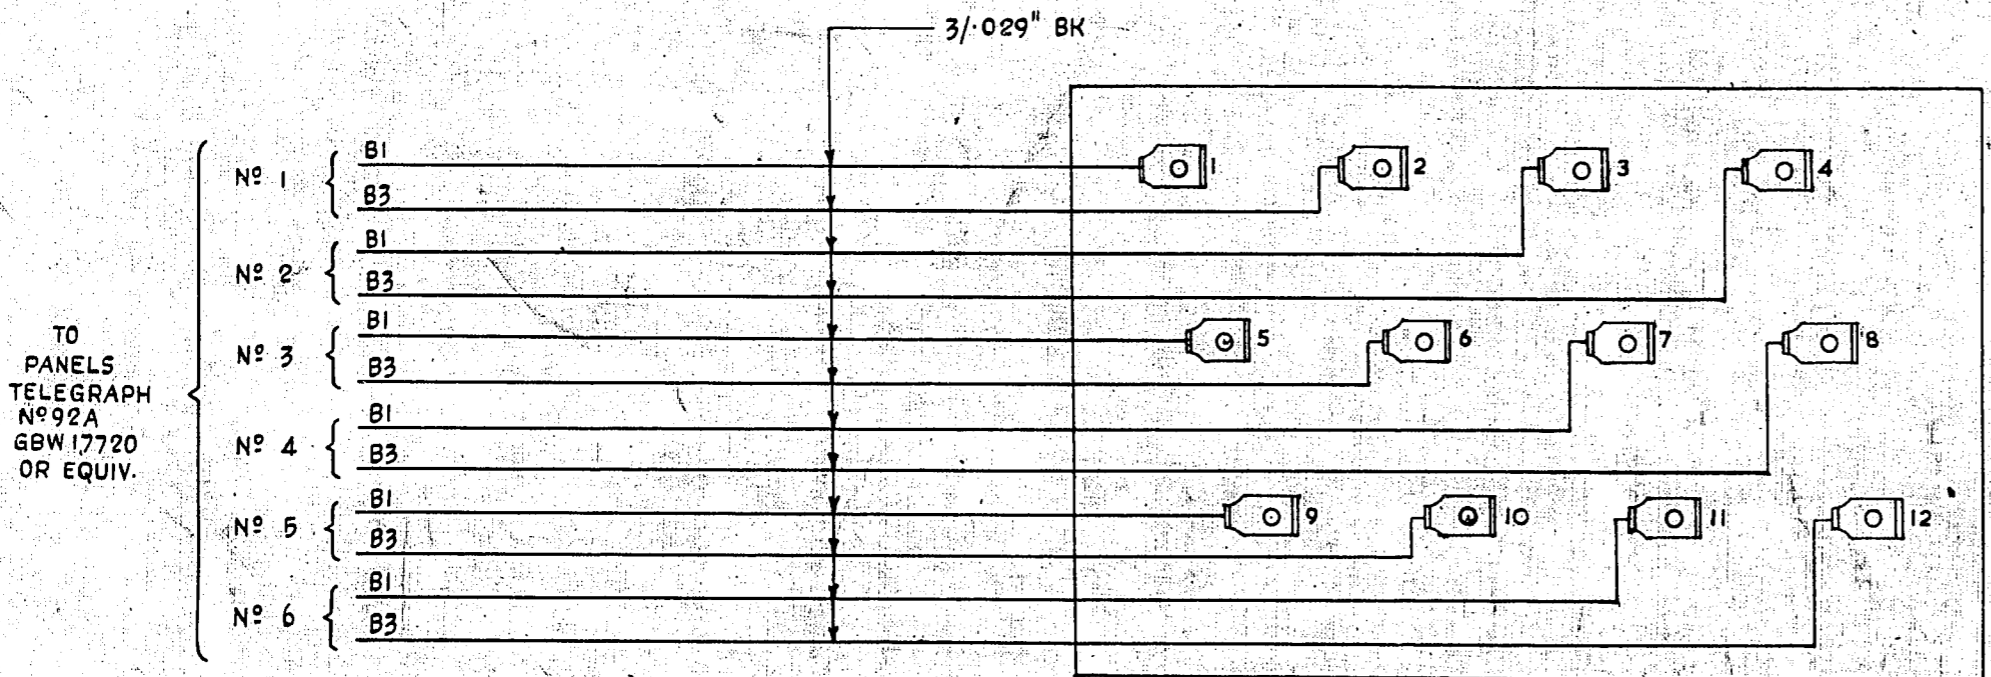


FIG. 4. TRANSFORMER TR2

ELECTRONIC REGENERATIVE TELEGRAPH REPEATER POWER PANEL FOR SIX REPEATERS (PANEL TELEGRAPH N° 93A)			
(79954)		14.6.63	
AMENDMENT	PARTICULARS	ISSUE DATE	APPD
N/Z.P.O.	DRAWN	CHECKED	WIRING CIRCUIT
GBU 17740			E