

1

2

3

4


5

6

FIG.1 M.A.R

FIG.3 (NOTE 4)

FIG.2: TEST DESK OR TEST RACK

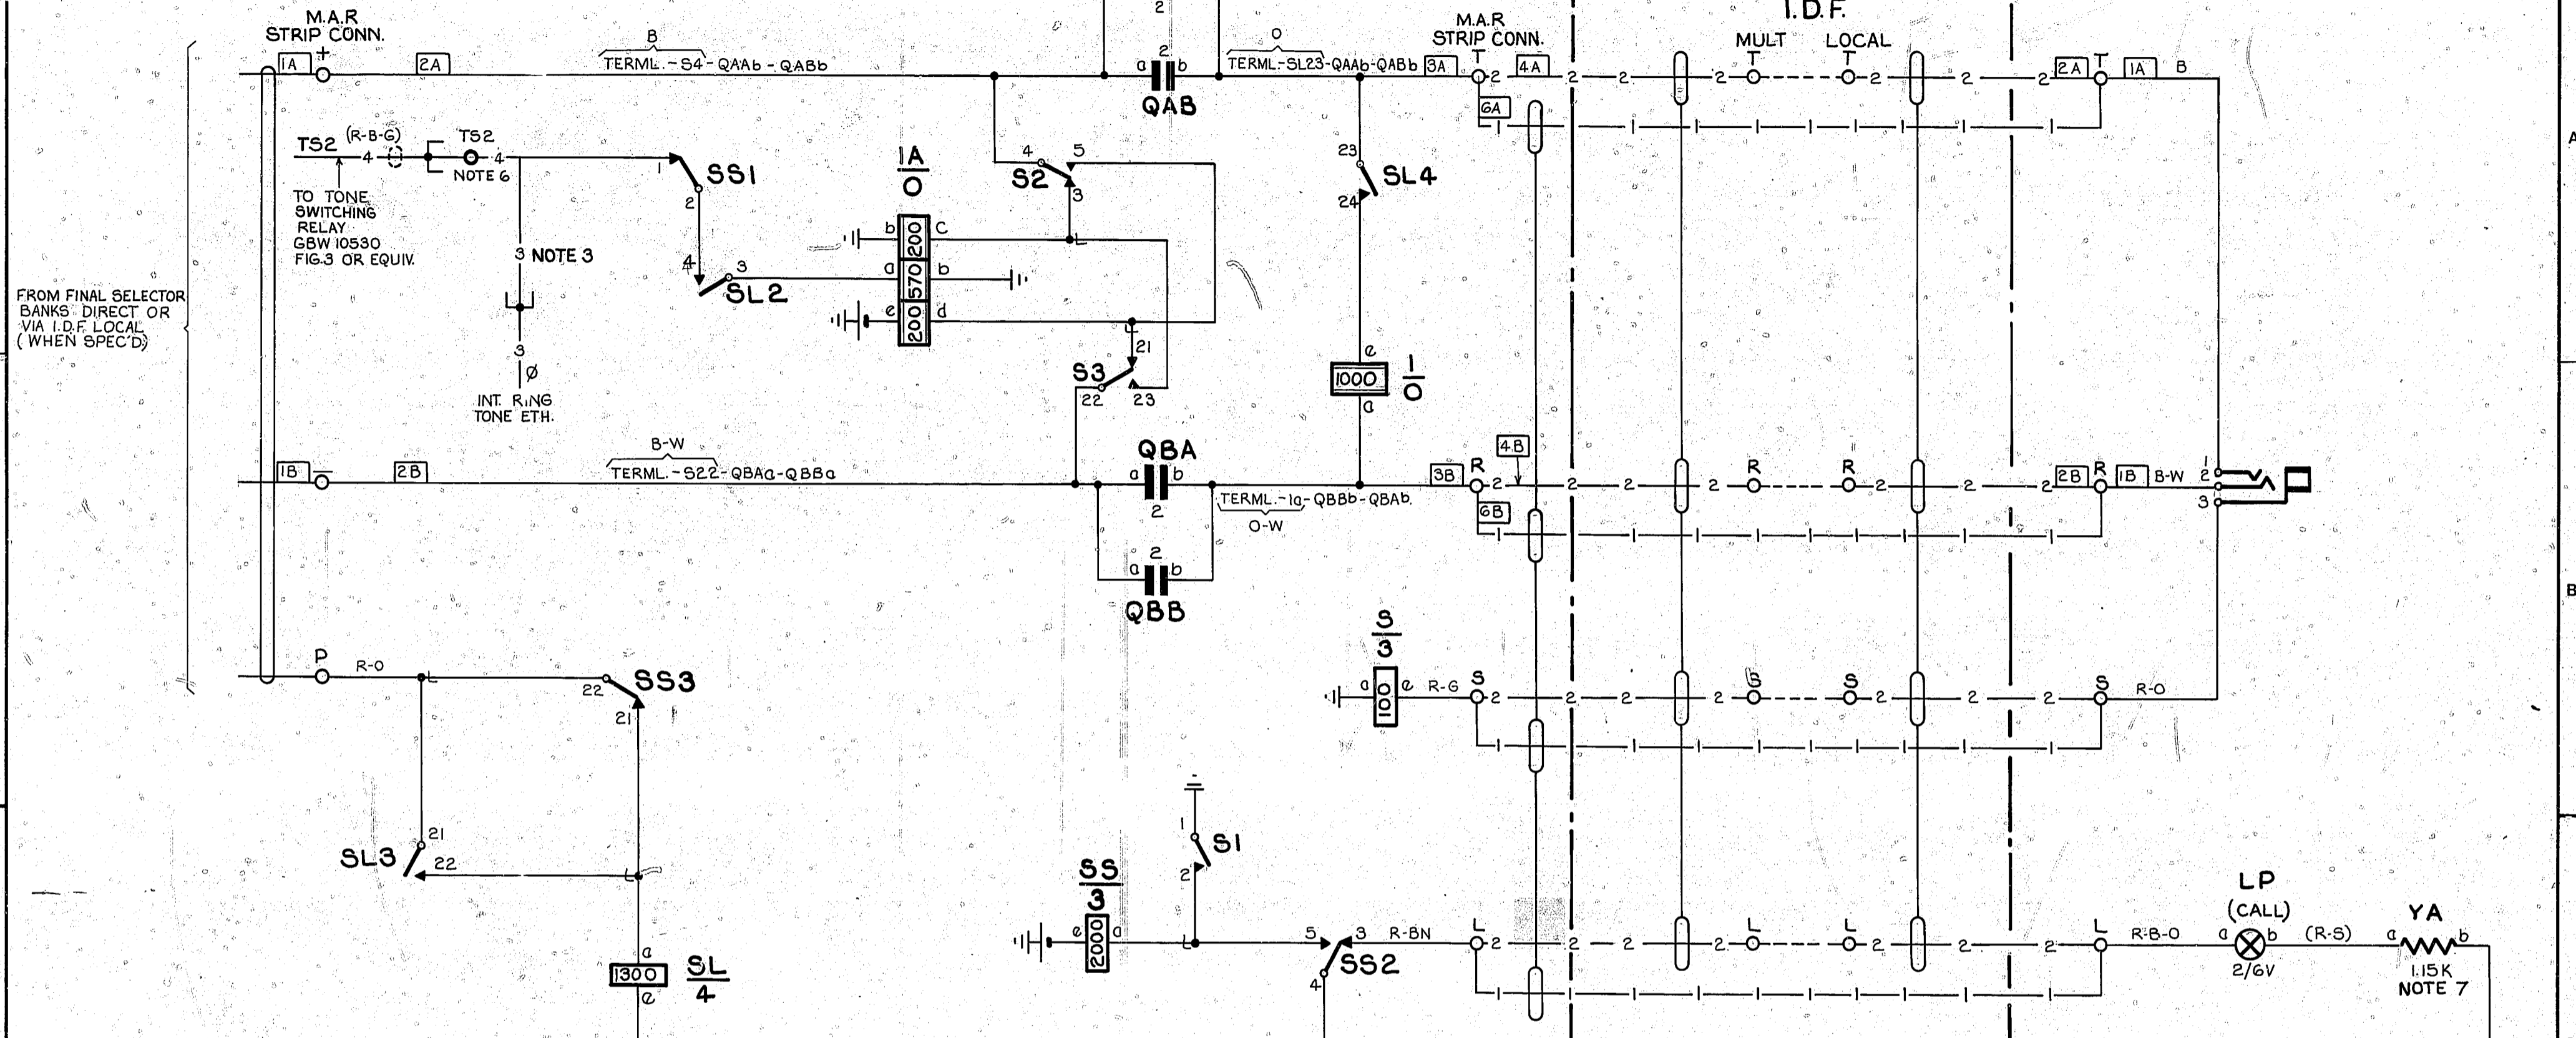

NOTES:

- 1. FUSING: 1.5A PER CIRCUIT.
- 2. UNLESS OTHERWISE SPECIFIED ALL WIRING TO BE 0.7mm.
- 3. AT SOME EARLY EXCHANGES CONNECTIONS SHOWN THUS — 3 — 3 — WERE PROVIDED IN LIEU OF CONNECTIONS SHOWN THUS — 4 — 4 —
- 4. WHEN I.D.F. TERMINATIONS ARE NOT REQUIRED DELETE FIG.3 AND CONNECTIONS SHOWN THUS — 2 — 2 — AND ADD CONNECTIONS SHOWN THUS — 1 — 1 —
- 5. ∅ FOR WIRING SEE ASSOCIATED COMMON SERVICE DIAGRAM.
- 6. TERMINALS TS2 & TS21 ARE REQUIRED ONLY WHEN TONE SWITCHING RELAY IS ON SEPARATE RACK.
- 7. ON SOME EARLY EQUIPMENT BATTERY WIRING IS BK OR W AND YA IS 1.2K OHMS.

BATT. V. 0.7mm. FUSE 5B IA_c-SL_c-SS_c

EARTH R. 0.7mm. ETH.BAR 5A IA_b-(SLI)-SI-S_a

TO TONE SWITCHING RELAY GBW10530 FIG.3 OR EQUIV.

TO BATT. VIA PILOT RELAY GBW 114.4.0 OR EQUIV.

PROOF

50V	E	<input type="checkbox"/> SLOW RELEASE	<input checked="" type="checkbox"/> SLOW OPERATE
A	2.10.80	A.G	17146
4	27.4.70		21876
3	11.3.57		68703
2			
ISS DATE	DEL	DC	ORDER CKD APD CHANGE
DRN S.S. SECT	CKD	ORIGIN S.S. SECT	
TCD A.G.	APPD	STANDARD ATW 22001	
NZPO ENGINEER-IN-CHIEF, WELLINGTON			
	SHT 10/1	G	10700
	SIZE A2		

TEST DESK OR TEST RACK LINES INCOMING FROM FINAL SELECTOR BANKS

UD 236

