



M.A.R.

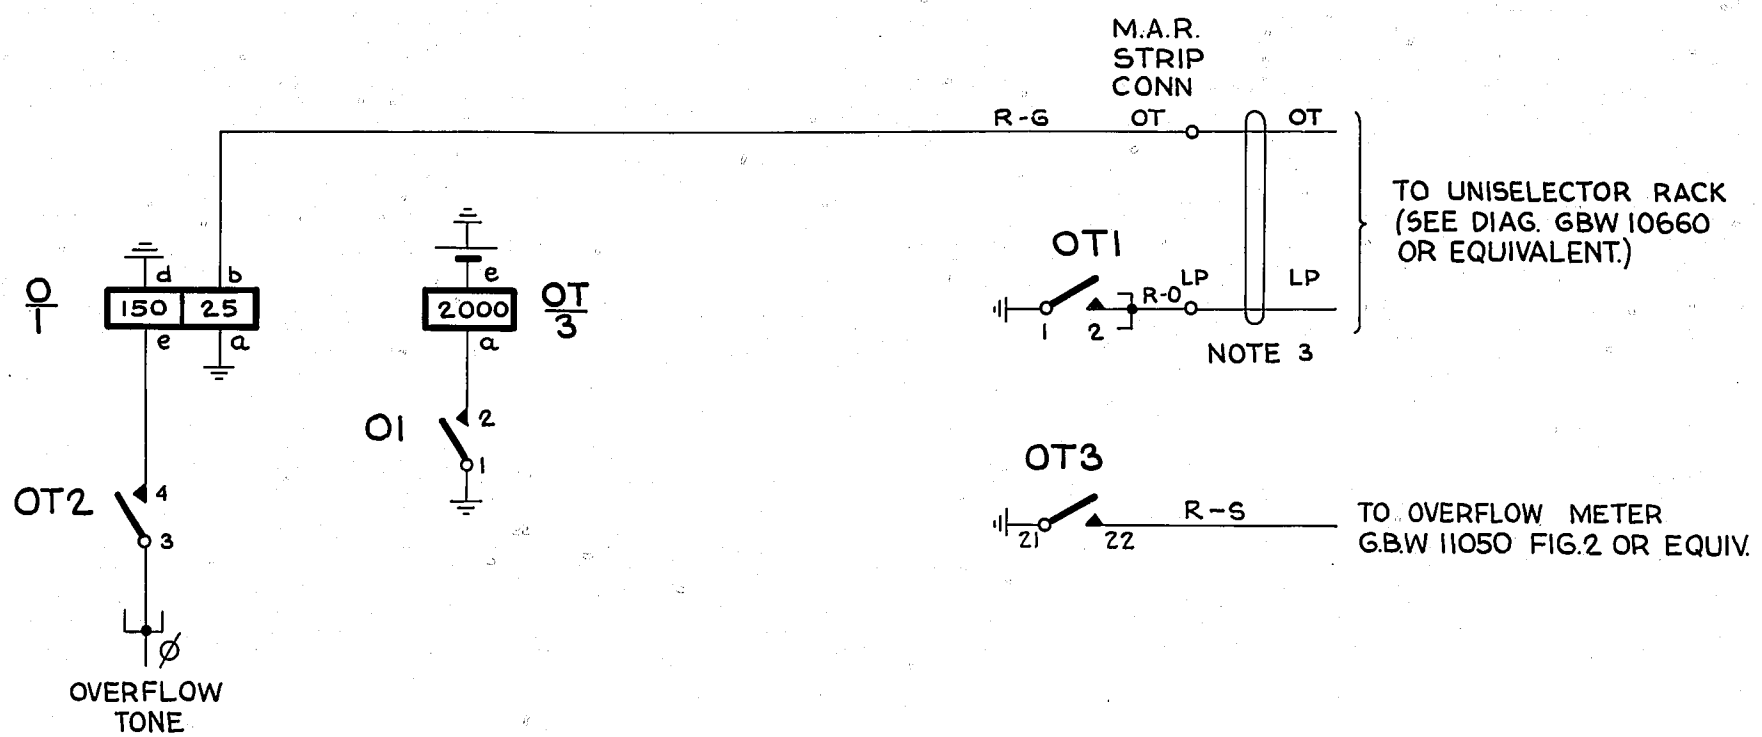

NOTES

1. FUSING: 1.5A PER 10 CIRCUITS AT SOME EARLY EXCHANGES FUSING WAS 1.5A PER CIRCUIT.
2. ONE CIRCUIT PER 100 UNISELECTORS.
3. ONE 'LP' LEAD PER 3 CIRCUITS.
4. ALL WIRING TO BE 0.6mm. UNLESS OTHERWISE SPECIFIED PLATE STRAPPING TO BE 0.6mm. OR 0.5mm.
5. Ø FOR WIRING SEE GBW 10690 OR EQUIV.

BATT 0.9mm. (BK) FUSE - OTe ETC
 EARTH 0.9mm. (R) EARTH BAR - Oa - Od - OI ETC.
 OT21 - OT1 ETC.



RETRACED AND METRICATED	(157683)	2A	28.7.78	RED
NOTE 1, REVISED		2	17.5.50	
		1		
AMENDMENT PARTICULARS		ISS	DATE	APP.
N.Z.P.O.		DRAWN	CHECKED	WIRING
				CIRCUIT

UNISELECTOR OVERFLOW
AND ALARM CIRCUIT
M.A.R.

REF: GEC DRG 98579 SIZE A3 50V E

GBW 10810