

Centimetres

DRAWN BY SHELDON MINNARD
CHECKED BY CAROL DILLI

50 V

DO

OBSOLETE

MADE OBSOLETE

(56578)

ISSUE DATE

1 17-4-62

Appo

SIZE F

50 V

E

METER READING
CIRCUIT

FIG. 1. METER RACK

EARTH R. 20 SWG ETH BAR (3A) I_a
BATT. BK 20 SWG FUSE (3B) I_e

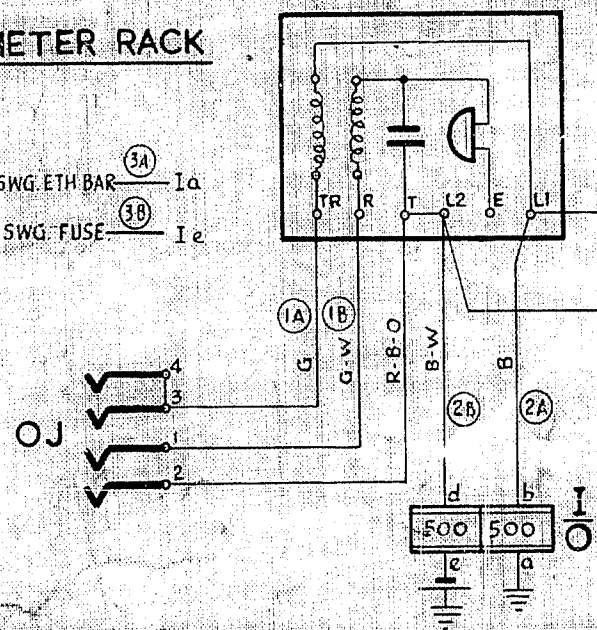


FIG. 2. CLERICAL ROOM. WIRED BY CUSTOMER

M.D.F.
EXCH. SIDE EXCH. SIDE


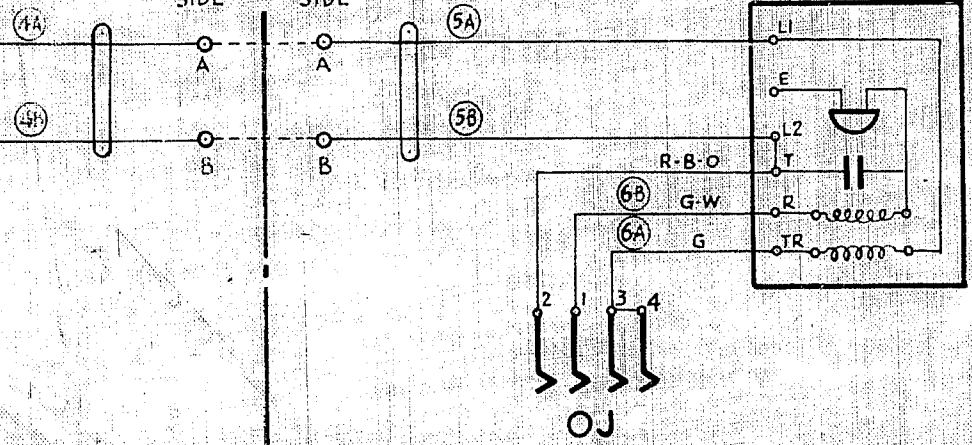


FIG. 3A. METER RACK

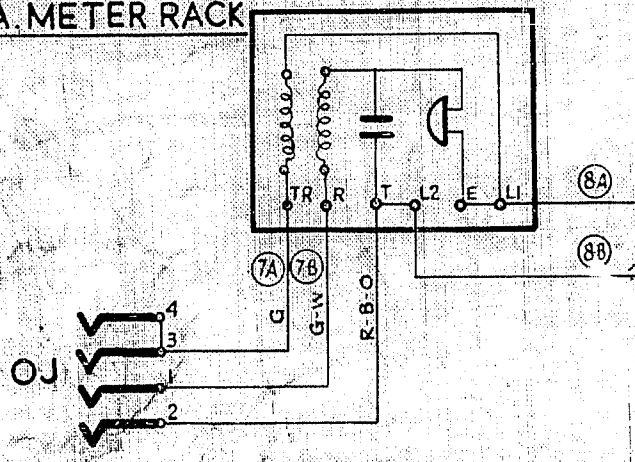

M.D.F. & FINAL SELR RACK (OR I.D.F.) CONNECTIONS
(EXPLANATORY ONLY)


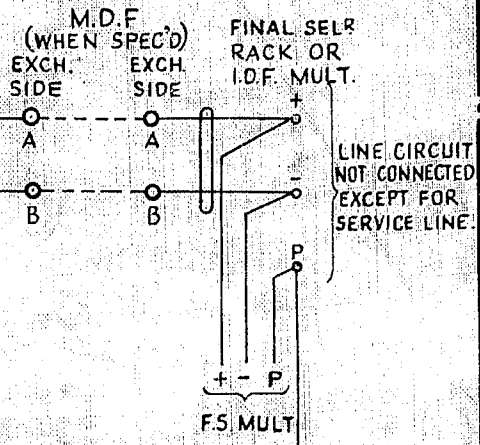


FIG. 4. CLERICAL ROOM WIRED BY CUSTOMER

NOTE 4.


M.D.F.
EXCH. SIDE.

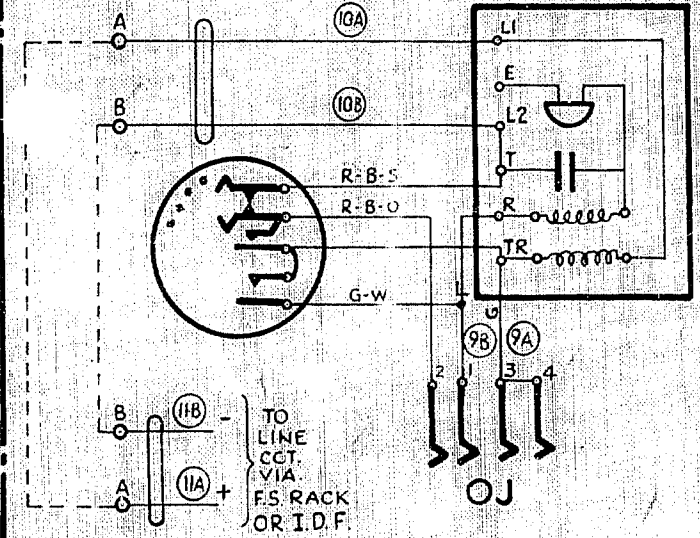

NOTES

1. FUSING: FIG. 1 1.5A PER CCT. FIG. 3B. 1.5A PER 10 CCTS.
2. ALL WIRE NOT OTHERWISE SPECIFIED TO BE 23. SWG. PLATE STRAPPING TO BE 23 OR 25 SWG.
3. FIGS. 1 & 2 APPLY WHEN CLERICAL ROOM IS IN SAME BUILDING AS AUTO. APPARATUS. & AT ALL MAIN EXCHANGES IN NON-DIRECTOR AREAS. FIGS. 3 & 4 APPLY IN OTHER CASES.
4. LOCAL ARRANGEMENTS MAY BE MADE FOR SERVICE LINES TO BE USED INSTEAD OF CIRCUITS TO FIG. 4. SERVICE LINES SO USED SHOULD HAVE A JACK CONNECTED TO THE BELL SET AS IN FIG. 4.

FIG. 3B. M.A.R.

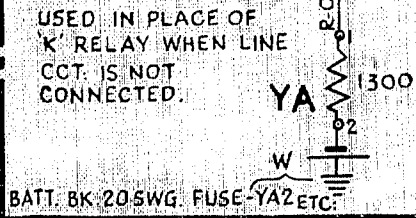

BATT. BK 20 SWG FUSE-YA2 ETC.