N.Z.P.O.

DRAWN AEC | CHECKED | WIRING | CIRCUIT

AMENDMENT PARTICULARS

ISSUE	DATE	APP^{D}	
OBSOLETE CANCELLED ADDED (57066)	2	19.4.62	
(35224)	1	5.10.60	

GBW 10851

METER READING CIRCUIT

SIZE F | 50V | H

OBSOLETE CANCELLED

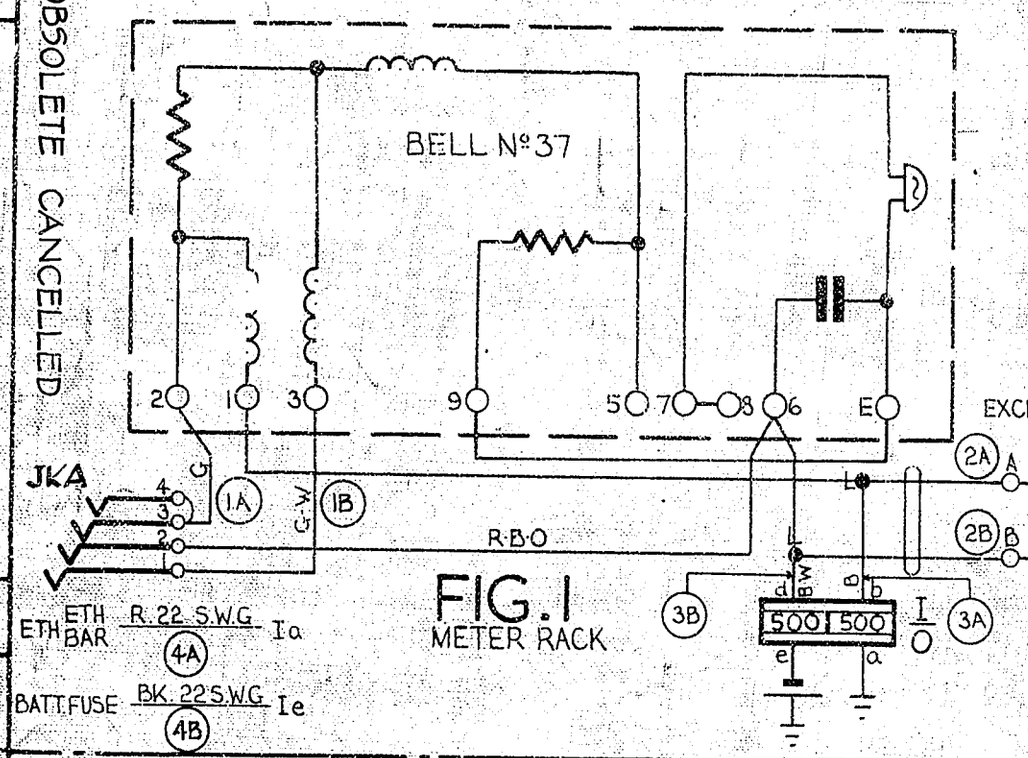

FIG.1
METER RACK

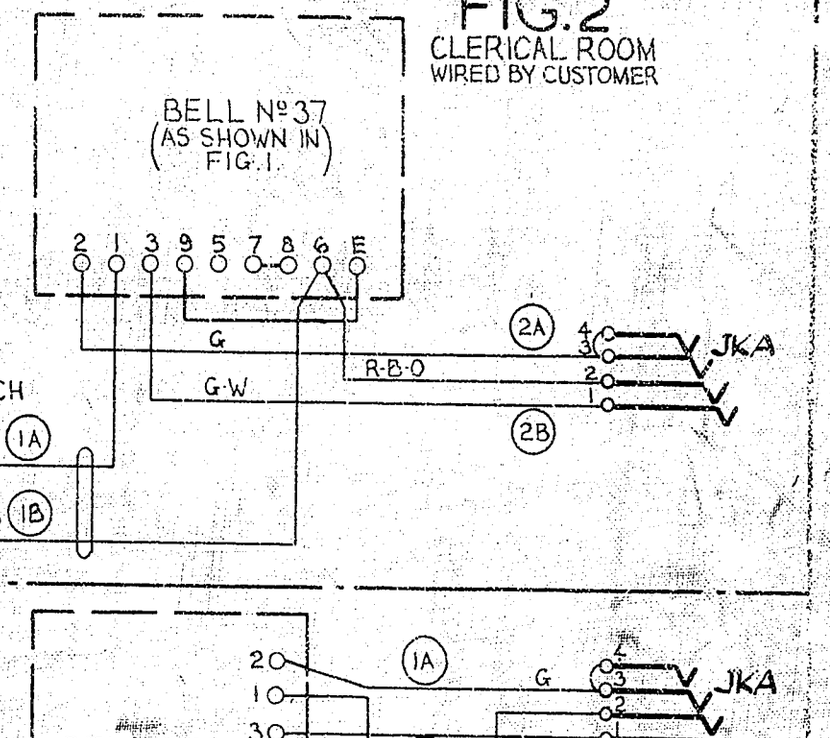

FIG.2
CLERICAL ROOM
WIRED BY CUSTOMER

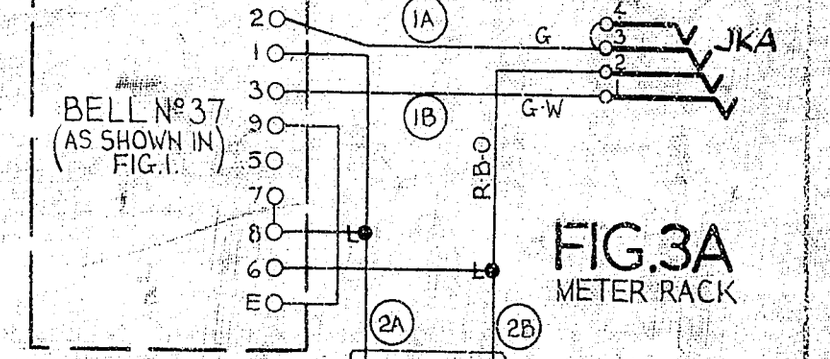

FIG.3A
METER RACK

NOTES:-

1. FUSING:- FIG.1 1·5A PER CCT.
   FIG.3B 1·5A PER 10 CCTS.
2. ALL WIRING NOT OTHERWISE SPECIFIED TO BE 25 S.W.G.
3. FIGS. 1 & 2 APPLY WHEN CLERICAL ROOM IS IN SAME BUILDING AS AUTO APPARATUS & AT ALL MAIN EXCHANGES. FIGURES 3 & 4 APPLY IN OTHER CASES.
4. LOCAL ARRANGEMENTS MAY BE MADE FOR SERVICE LINES TO BE USED INSTEAD OF CIRCUITS TO FIG.4. SERVICE LINES SO USED SHOULD HAVE A JACK CONNECTED TO THE BELL SET AS IN FIG.4.

FIG.4
CLERICAL ROOM (WIRED BY CUSTOMER) NOTE 4.

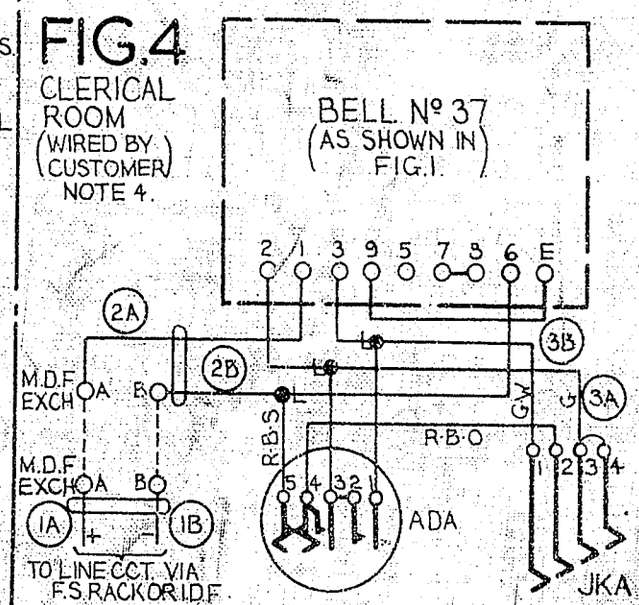
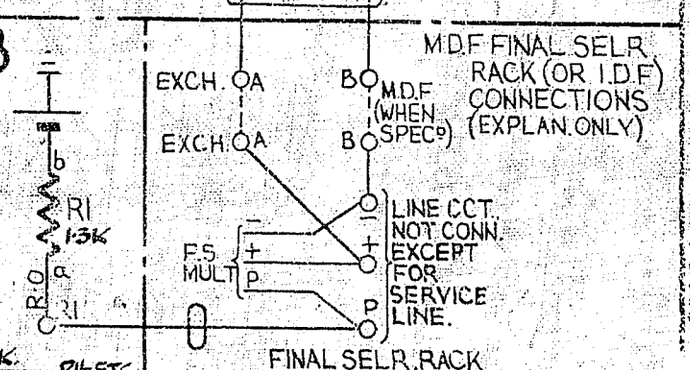
FIG.3B
M.A.R
USED IN PLACE OF 'K' RELAY WHEN LINE CCT IS NOT CONN.