
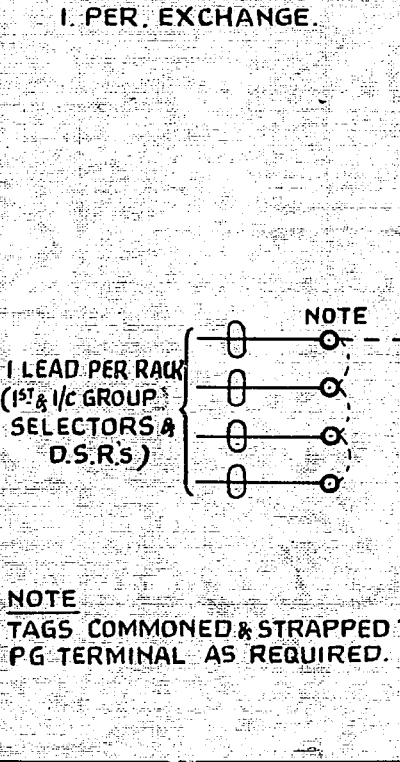


0  
5 Centimetres  
10  
15  
20  
25  
30  
35

**FIG. 1**  
**A.E.R. STRIP CONN.**



**FIG. 2 ALARM EQUIPMENT**  
**A.E.R.**

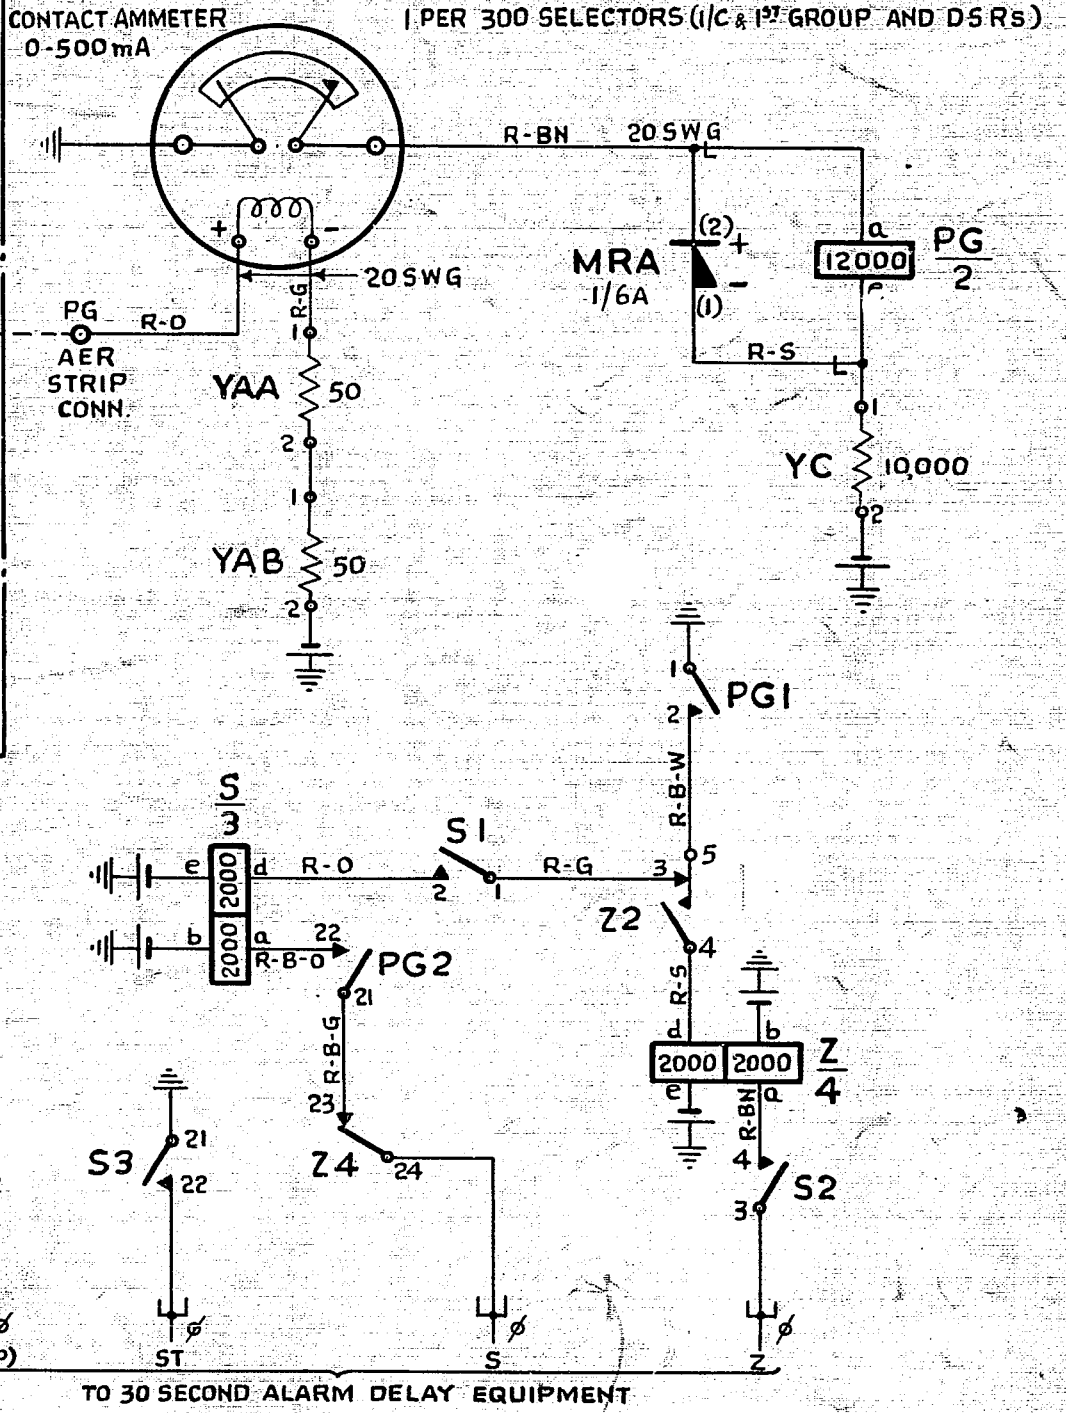

**NOTES**

1. FUSING - 1.5A PER CIRCUIT.
2. MILLIAMETER IS FITTED WITH AN ADJUSTABLE ALARM CONTACT.
3. ALL WIRING TO BE 23 SWG UNLESS OTHERWISE SPECIFIED.
4.  $\phi$  FOR WIRING SEE GBW 11060 OR EQUIV.

BATT. BK 20 SWG. FUSE — Zb-Ze-Sb-Se-YAB2-YB2-YC2  
 EARTH R 20 SWG. ETH. BAR — Z21-Z1-S21-PG1  
 AMMETER



**P.G. OVERLOAD ALARM  
CIRCUIT.**

AMENDMENT PARTICULARS				ISSUE	DATE	Appd
				(72622)	25-4-49	DBK
N.Z.P.O.		DRAWN	CHECKED	WIRING	CIRCUIT	

**GBW 10880**

SIZE F 50V E