


SWITCHBOARD

(SHOWN FOR EXPLANATORY PURPOSES ONLY)

M. A. R.

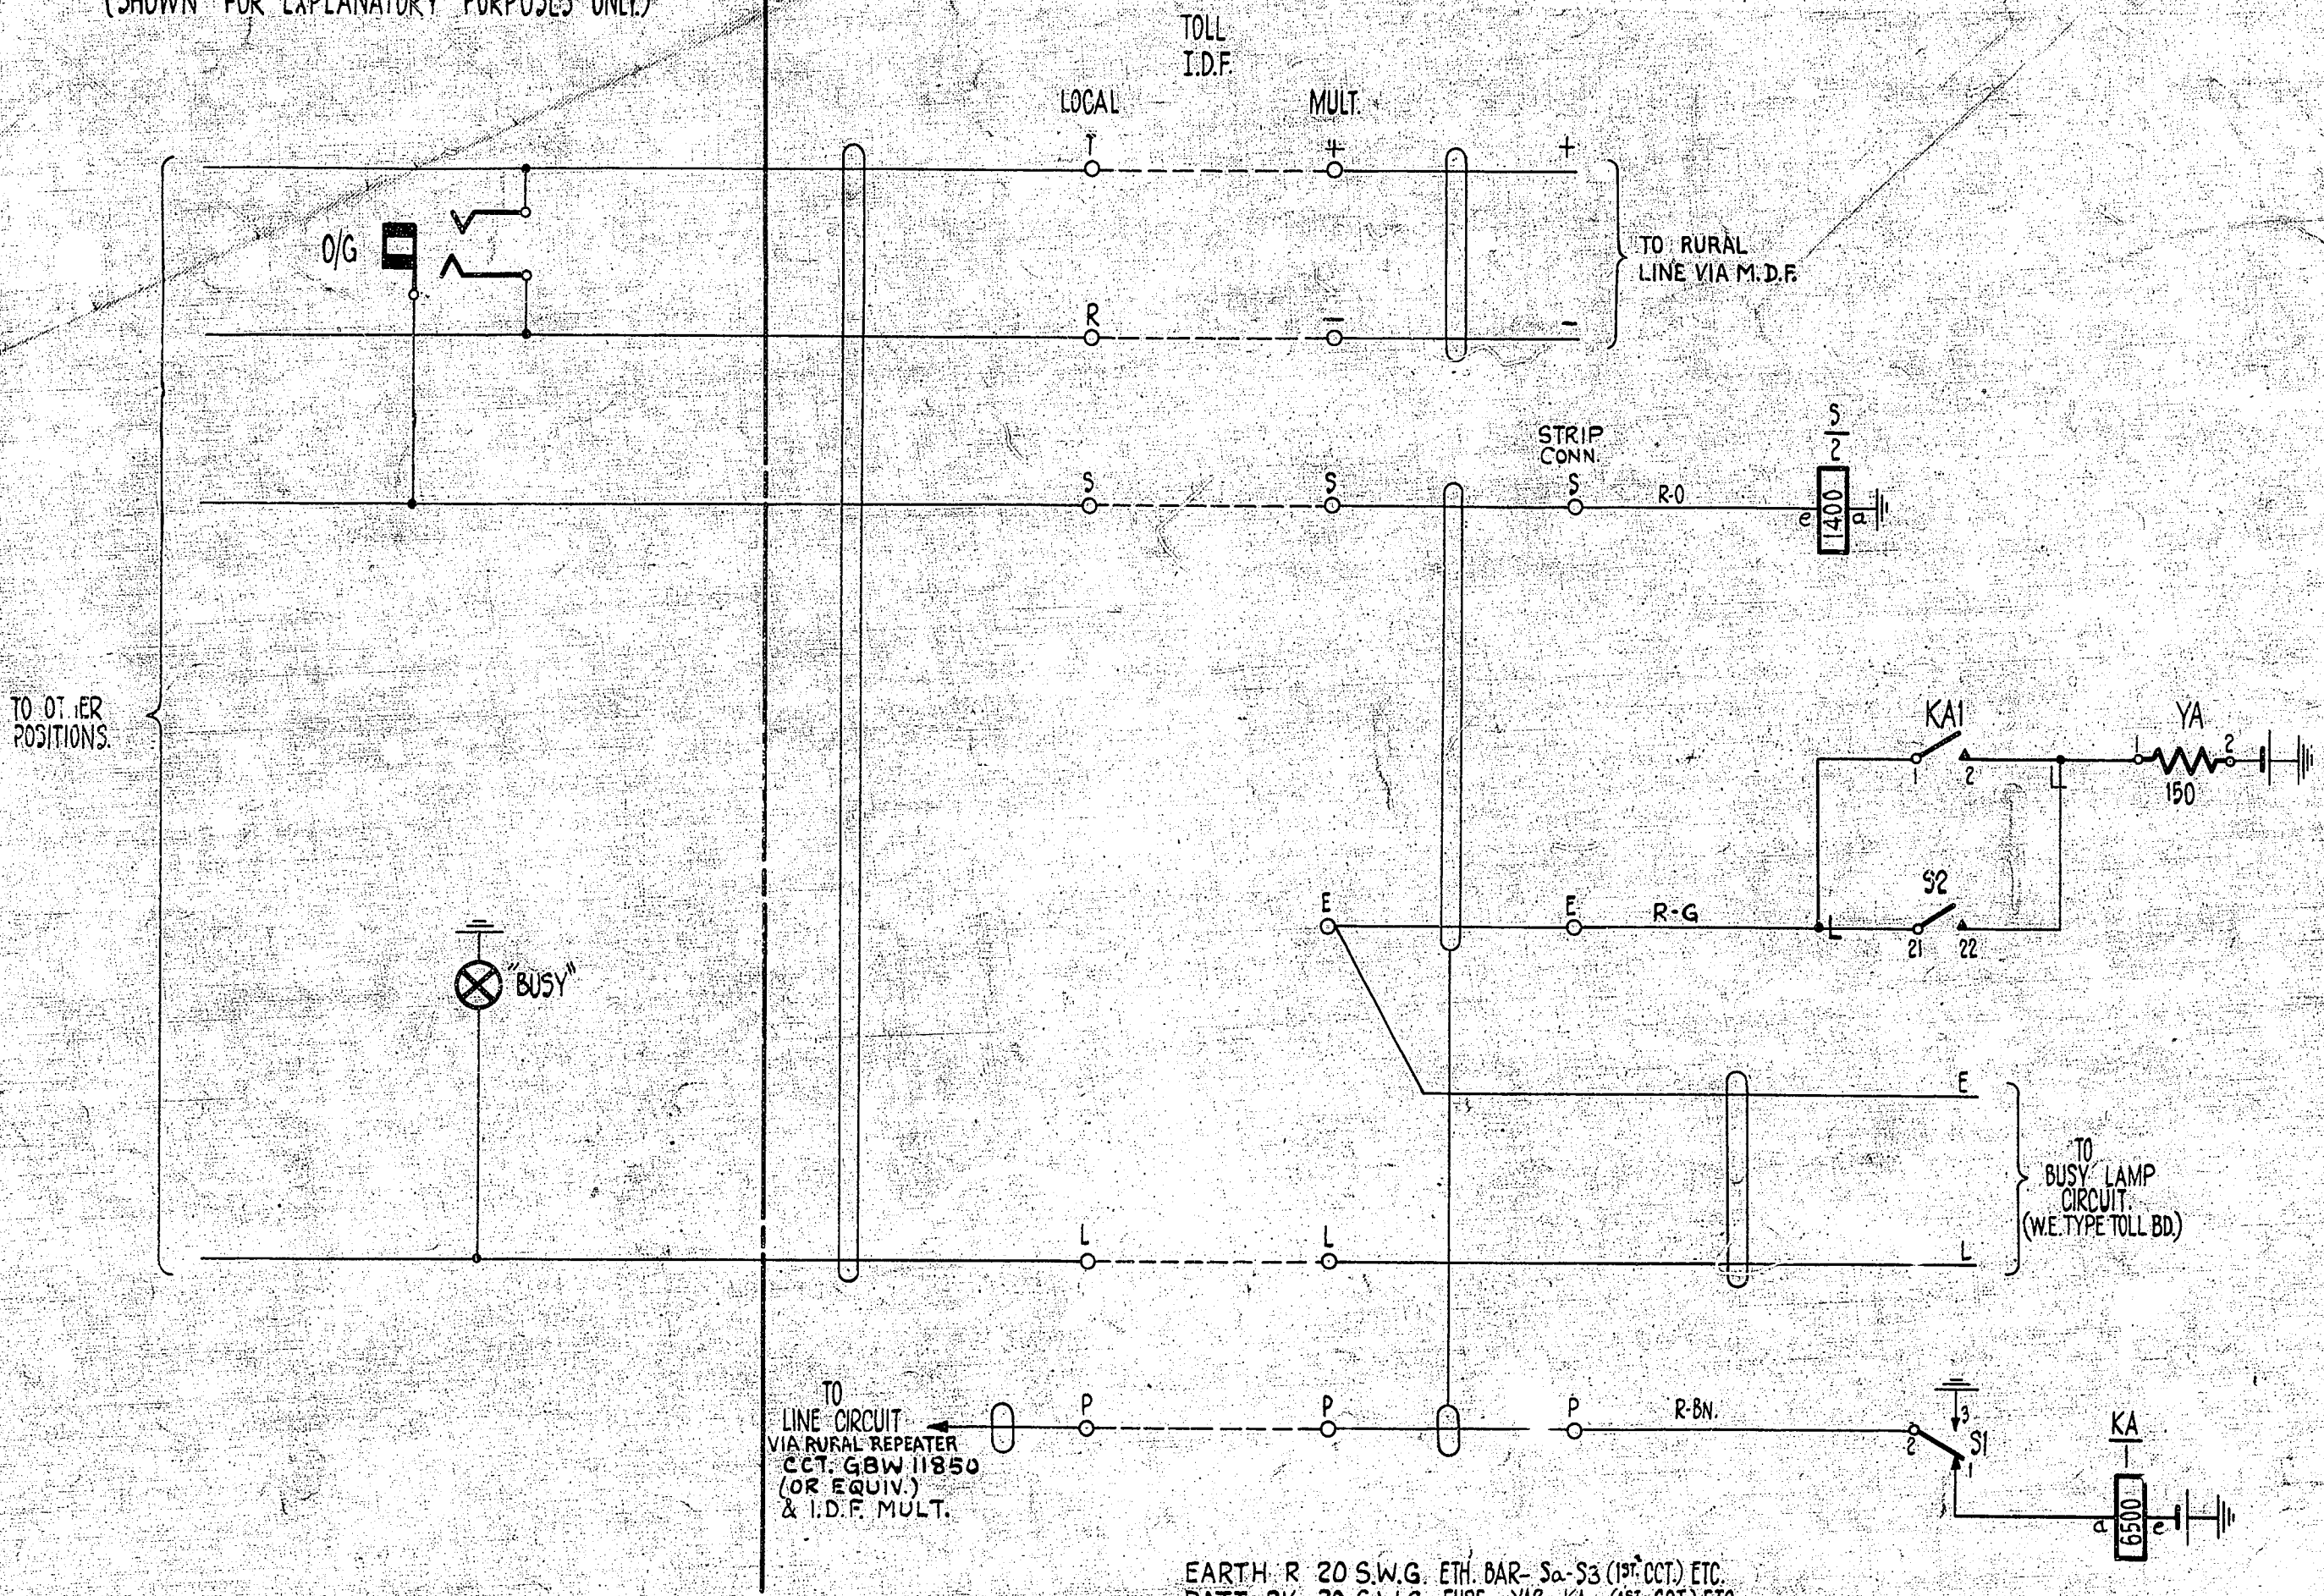

NOTES

1. FUSE 1.5A (1 PER 10 CCTS)
2. FOR USE WHERE RURAL LINE HAS OUTGOING AUTOMATIC SERVICE ONLY.
3. ALL WIRING TO BE 23 S.W.G. UNLESS OTHERWISE SPECIFIED. PLATE STRAPPING TO BE 23 OR 25 S.W.G.

TO LINE CIRCUIT VIA RURAL REPEATER CCT. GBW 11850 (OR EQUIV.) & I.D.F. MULT.

EARTH R 20 S.W.G. ETH. BAR- Sa-S3 (1ST. CCT.) ETC.
BATT BK 20 S.W.G. FUSE- YA2- KAe (1ST. CCT.) ETC.

OBSOLETE

		[] SLOW RELEASE		[X] SLOW OPERATE	
O/G CIRCUIT TO SEMI-AUTO RURAL LINE TOLL SWITCHBOARD					
DRG MADE OBSOLETE (50530)		2	5.12.62	DBA	
		1	16.6.52	CSA	
AMENDMENT PARTICULARS.		ISSUE	DATE	APPD	REF.
					SIZE S 50V C
					GBW 11840
NZPO		KAH			