


0
5 Centimetres
10
15
20
25
30

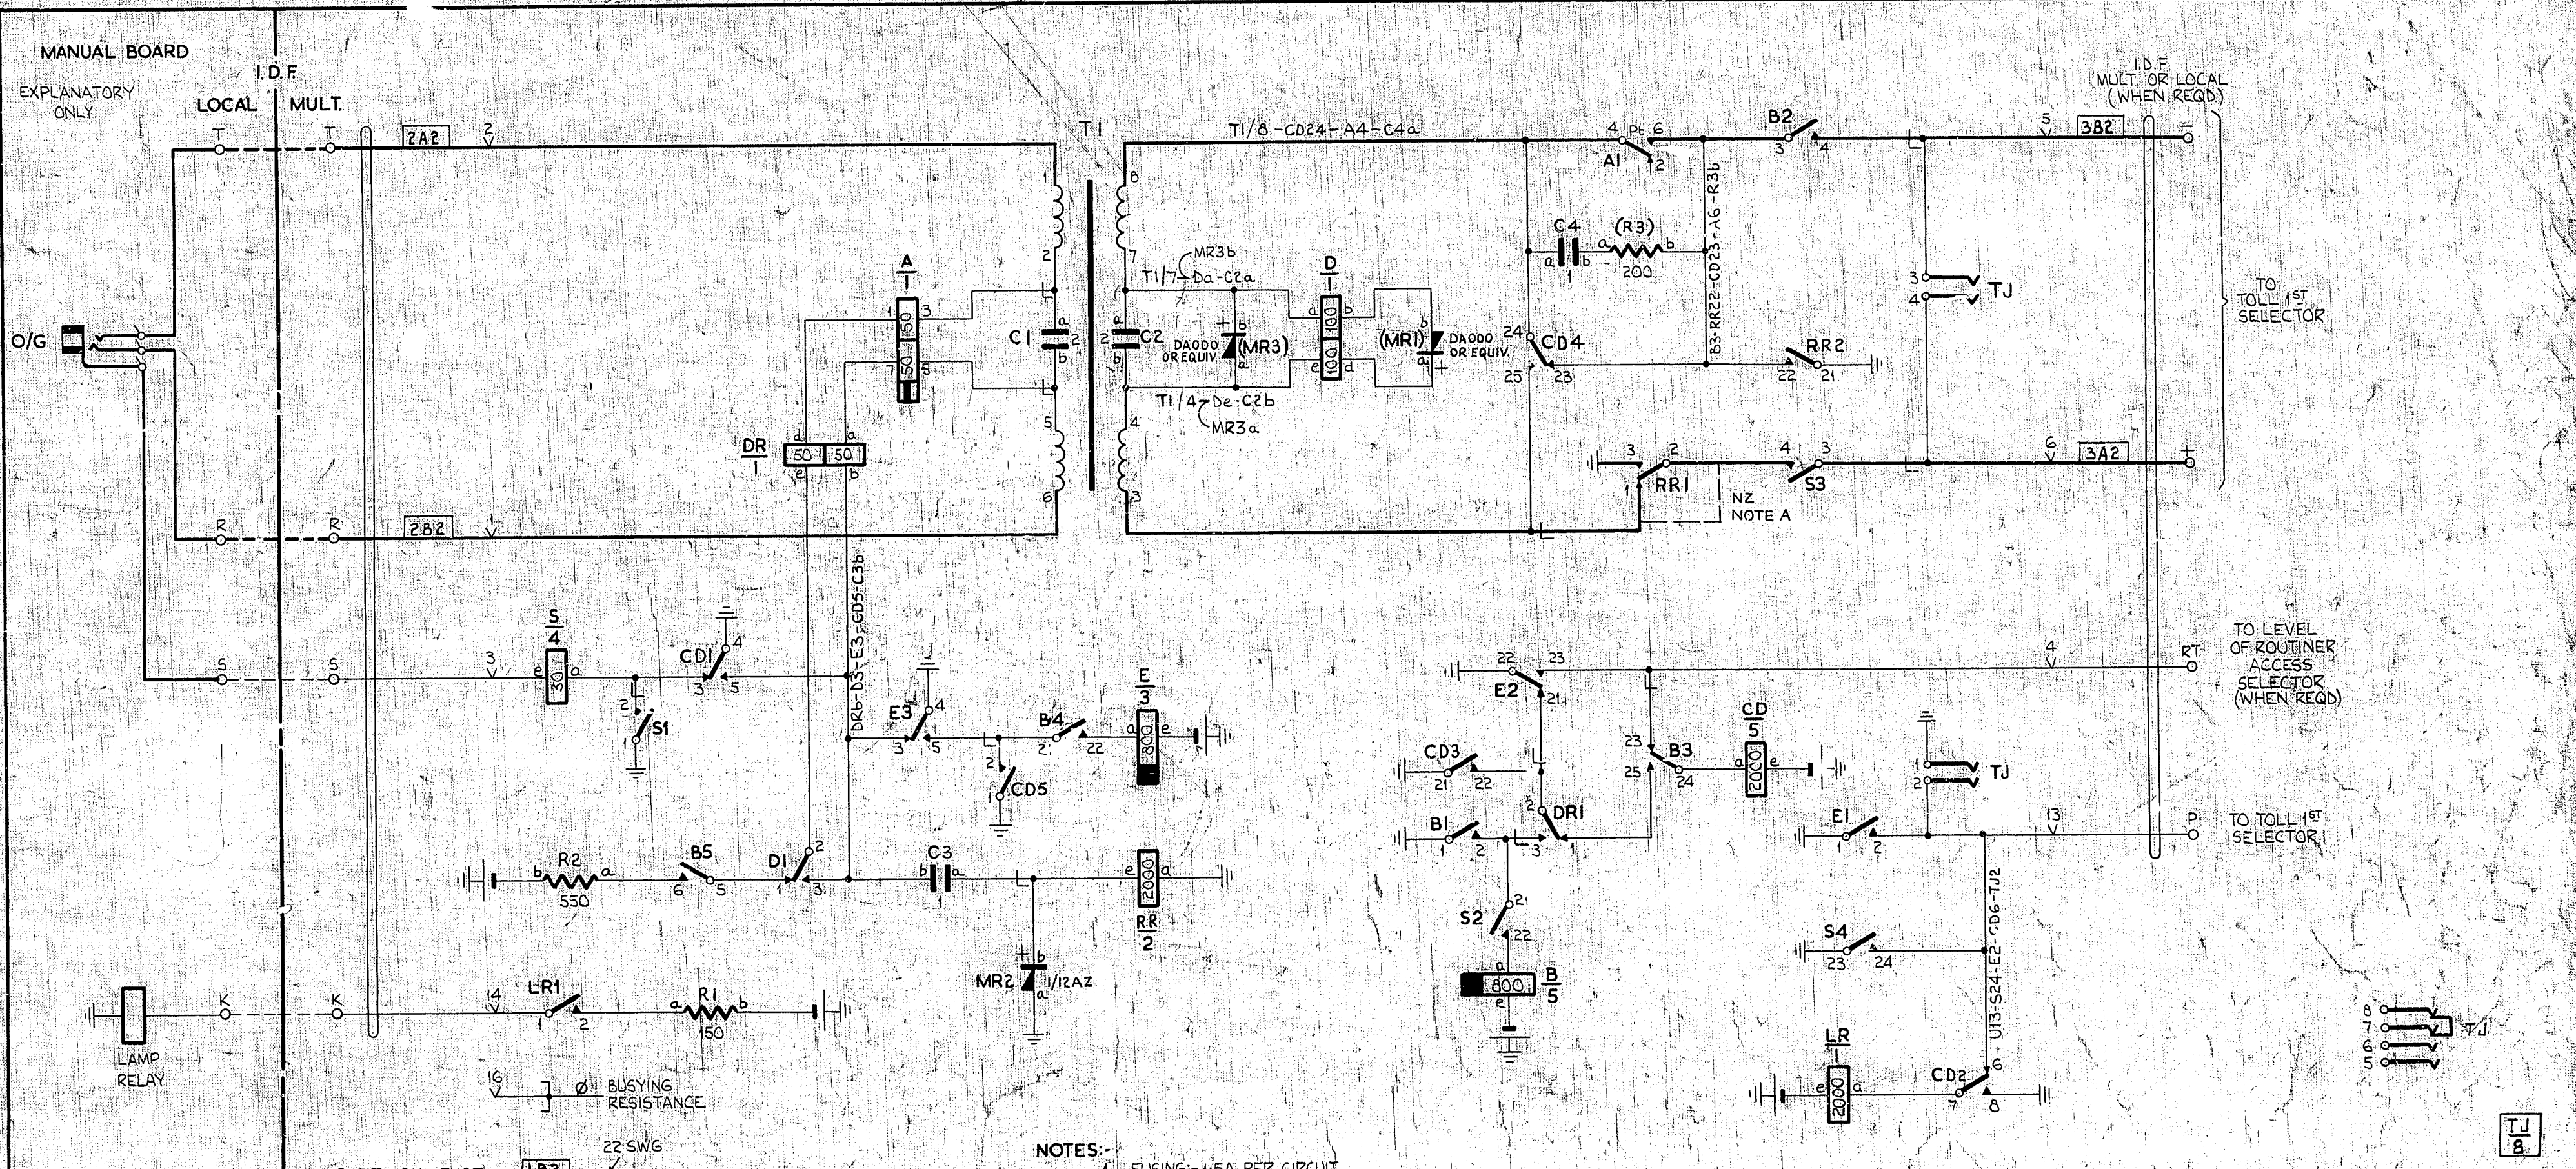

BATT. BK FUSE 1B2
ETH. R. ETH BAR 1A2
BATT. W. U12-BE-LRe-Ee-CDe-R1B-R2b
ETH. R. U11-B1-RR2i-RRa-RR3-S23-S1-E22-E1-E4-CD2i-CD1-CD4-CD8-MR2a-TJ1

- NOTES:-
1. FUSING--1.5A PER CIRCUIT
 2. SHELF JACK U-POINTS 9 & 11 AND 14 & 16 TO MAKE CONTACT WHEN RELAY SET IS REMOVED
 3. ALL WIRE TO BE 22 SWG UNLESS OTHERWISE SPECIFIED.
 4. Ø FOR WIRING SEE GBW 10640 OR EQUIVALENT

NZ NOTES
A) ADD STRAP _____ TO SECURE TRUNK OFFERING VIA SS AC3 SYSTEMS

TOLL-AUTO RELAY SET (W.E. TYPE TOLL BOARD)			
2000 TYPE			
NZ NOTE A ADDED	(43200)	1A	28.3.77 RED
	(94823)	1	15.4.65 JVC
AMENDMENT PARTICULARS	ISSUE	DATE	APP
NZ.P.O.			
	KRIS	RJ	GRW
			16.8.64
			GRW 11951

