

0
5 Centimetres
10
15
20
25
30

FIG. 1.
FUSE ALARM
AUTO MANUAL DISTRIBUTION

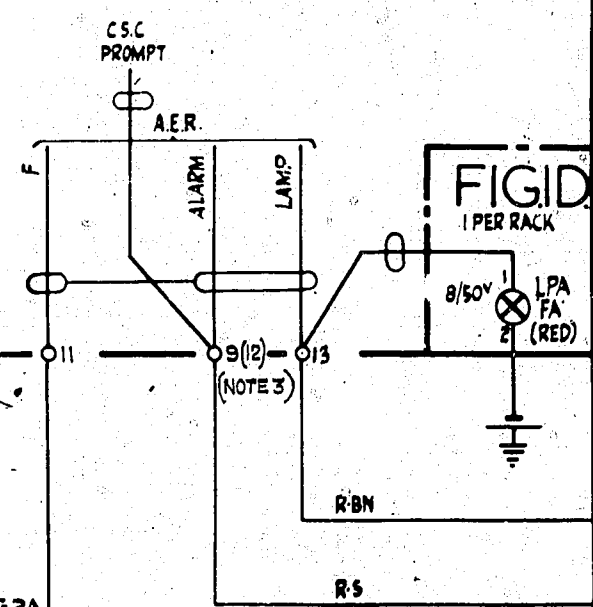


FIG. 1D
1 PER RACK

FIG. 2.
POS BATT
FUSE ALARM

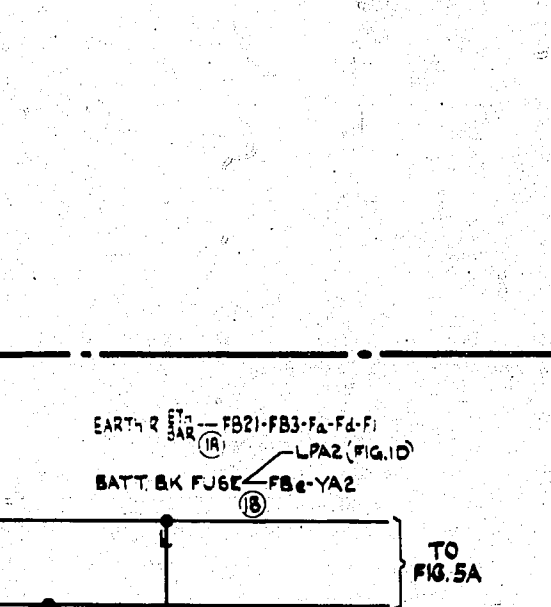


FIG. 2A.
1 PER EXCH.

FIG. 3.
POS BATT
FAIL ALARM.

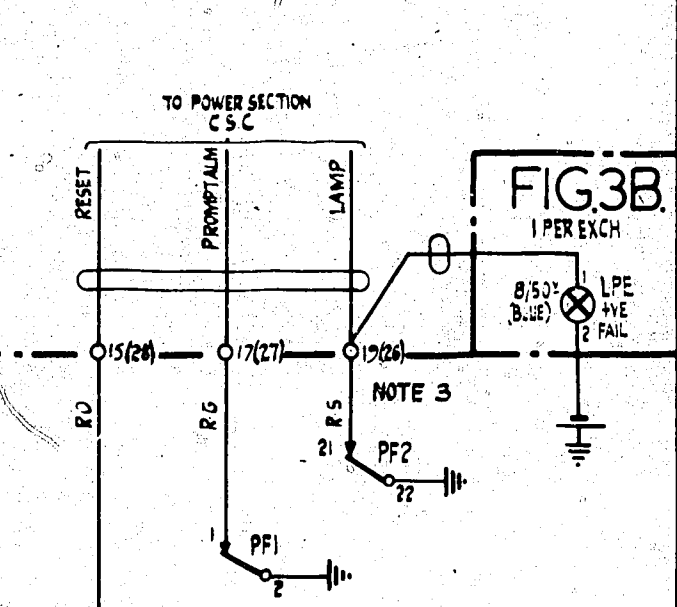


FIG. 3B.
1 PER EXCH.

FIG. 4.
BATT JACKS

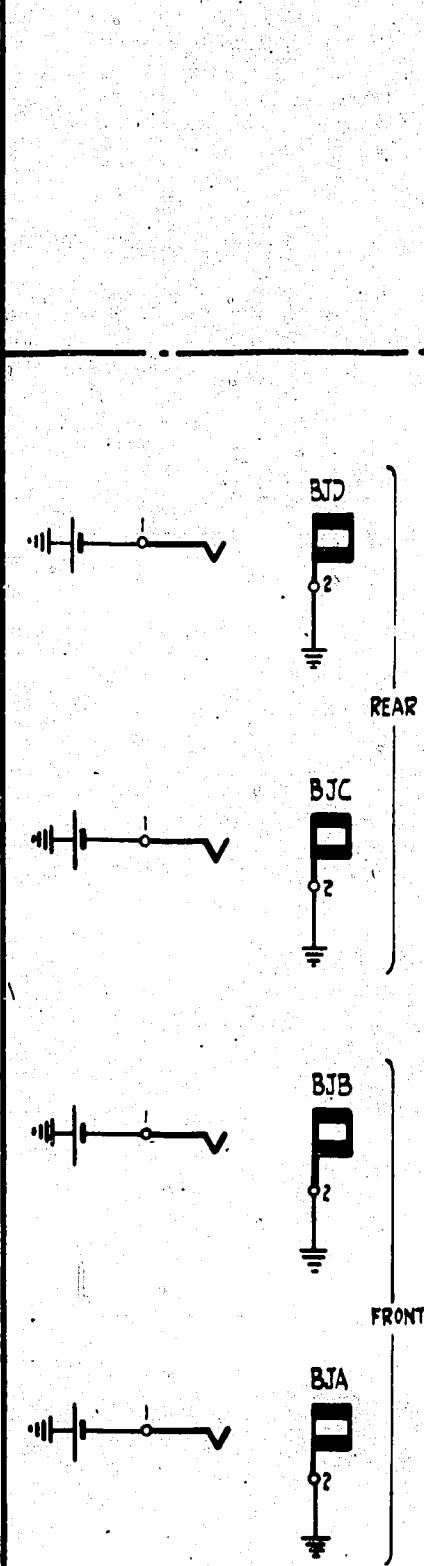


FIG. 4A
1 PER RACK

FIG. 5.
CONTINUOUS RINGING (P.B.X.)
DISTRIBUTION & FUSE ALARM

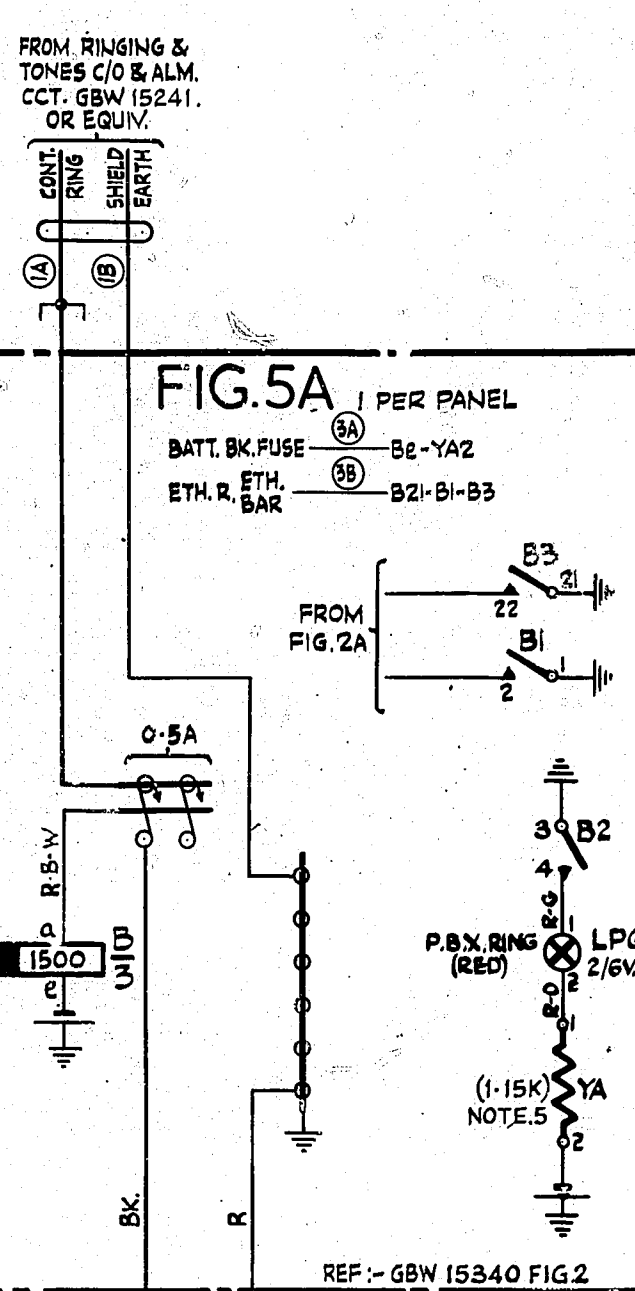


FIG. 5A
1 PER PANEL

FIG. 5C
1 PER P.B.X.
RINGING LEAD

FIG. 5B
FUSE: 0.5A PER LAMP.
ALL OTHER PARTICULARS
AS FIG. 5C.

NOTES:

- UNLESS OTHERWISE SPEC'D TAGS ARE ON RACK MISC STRIP CONN.
- EXCEPT WHERE OTHERWISE STATED ALL WIRING BEARING A COLOUR CODE TO BE 22S.W.G. PLATE WIRING TO BE 25 SWG
- TERMINAL NUMBERS IN BRACKETS APPLY WHEN FUSE PANELS ARE MOUNTED ON THE M.A.R.
- ON COMBINED RACKS (MAR/FPR) THE FUSES SHOWN IN FIG. 1C ARE FITTED ON FUSE PANEL SHOWN IN FIG. 1E.
- ON EARLIER EQUIPMENTS THESE RESISTORS WHERE 1-2K - N° 12.
- FOR TEST PURPOSES REMOVE STRAP 5(30)-7(31) & CONNECT SUITABLE BATT. IN SERIES OPPOSITION TO LOWER THE BATT. VOLTAGE TO THE POSITIVE BATT. LOW VOLTAGE LIMIT.

FIG. 1A.
1 PER RACK

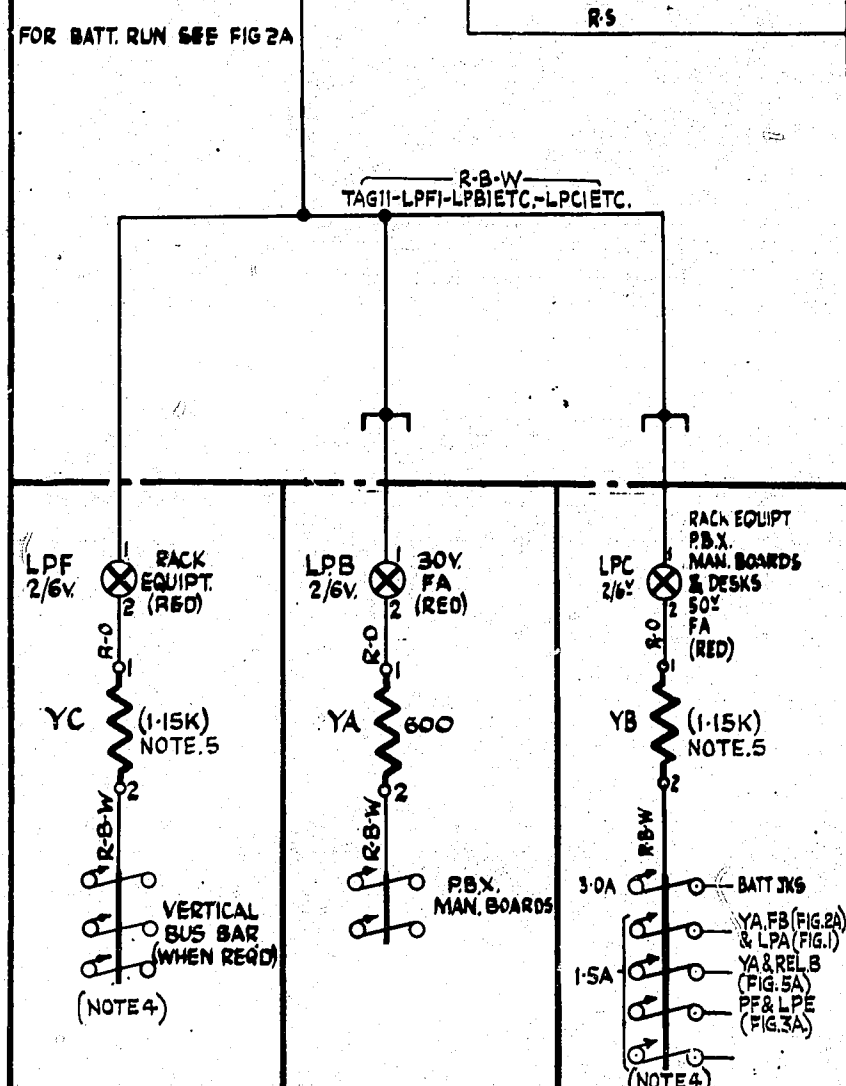


FIG. 1E
1 PER RACK WHEN
FUSE PANELS ARE
MOUNTED ON THE
M.A.R.

ALL FUSES NOT OTHERWISE
SPEC'D TO BE 1.5A

FIG. 1B
1 PER PANEL

ALL FUSES NOT OTHERWISE
SPEC'D TO BE 1.5A

FIG. 1C.
1 PER PANEL

FIG. 2B
1 PER PANEL

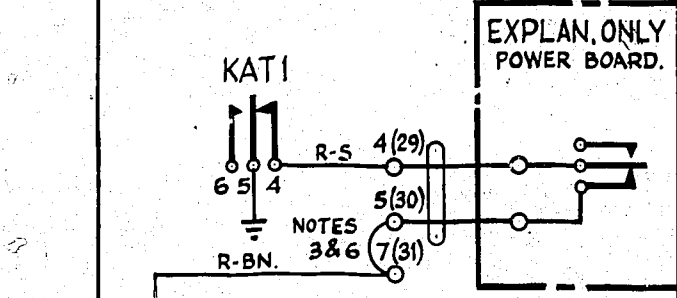
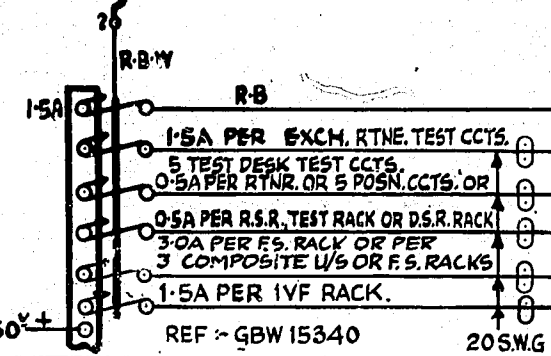


FIG. 3A
1 PER EXCH.

REF: GBW 15340

FIG. 2B & 3A REVISED. NOTES 5 & 6 ADDED (7/4/53)	8	16-3-54	D.B.H.
FIG. 3A: ALM TEST KEY ADDED. ASSOC'D WIRING MOD.	7		
FIG. 2B: POS BATT. SUPPLY TO TEST DESK ADDED	6		
FIG. 5C WAS 5B. FIG. 5B WAS NOT SHOWN.	5		
FIGS 2B & 3A MOD. FIG. 5B WAS NOT SHOWN.	4		
FIG. 1A: ROUTING ADDED. NOTE 4 ADDED.	3		
TITLE & FIGS. 1, 2, 3 MOD. & FIGS. 4 & NOTE 3 ADDED	2		
	1		

AMENDMENT PARTICULARS	ISSUE	DATE	APP'D	REF.	SIZE	M	50	H

NOT TO BE USED
FOR NEW WORK.

FUSE PANEL RACK
COMMON SERVICES DIAGRAM
& POSITIVE BATTERY DISTN.

12150

NZPO	DRAWN	CHECKED	WIRING	CIRCUIT	GBW
	3	10/1/54	10/1/54	10/1/54	