




PART OF ASSOCIATED METERING CONTROL CIRCUIT
EXPLANATORY ONLY

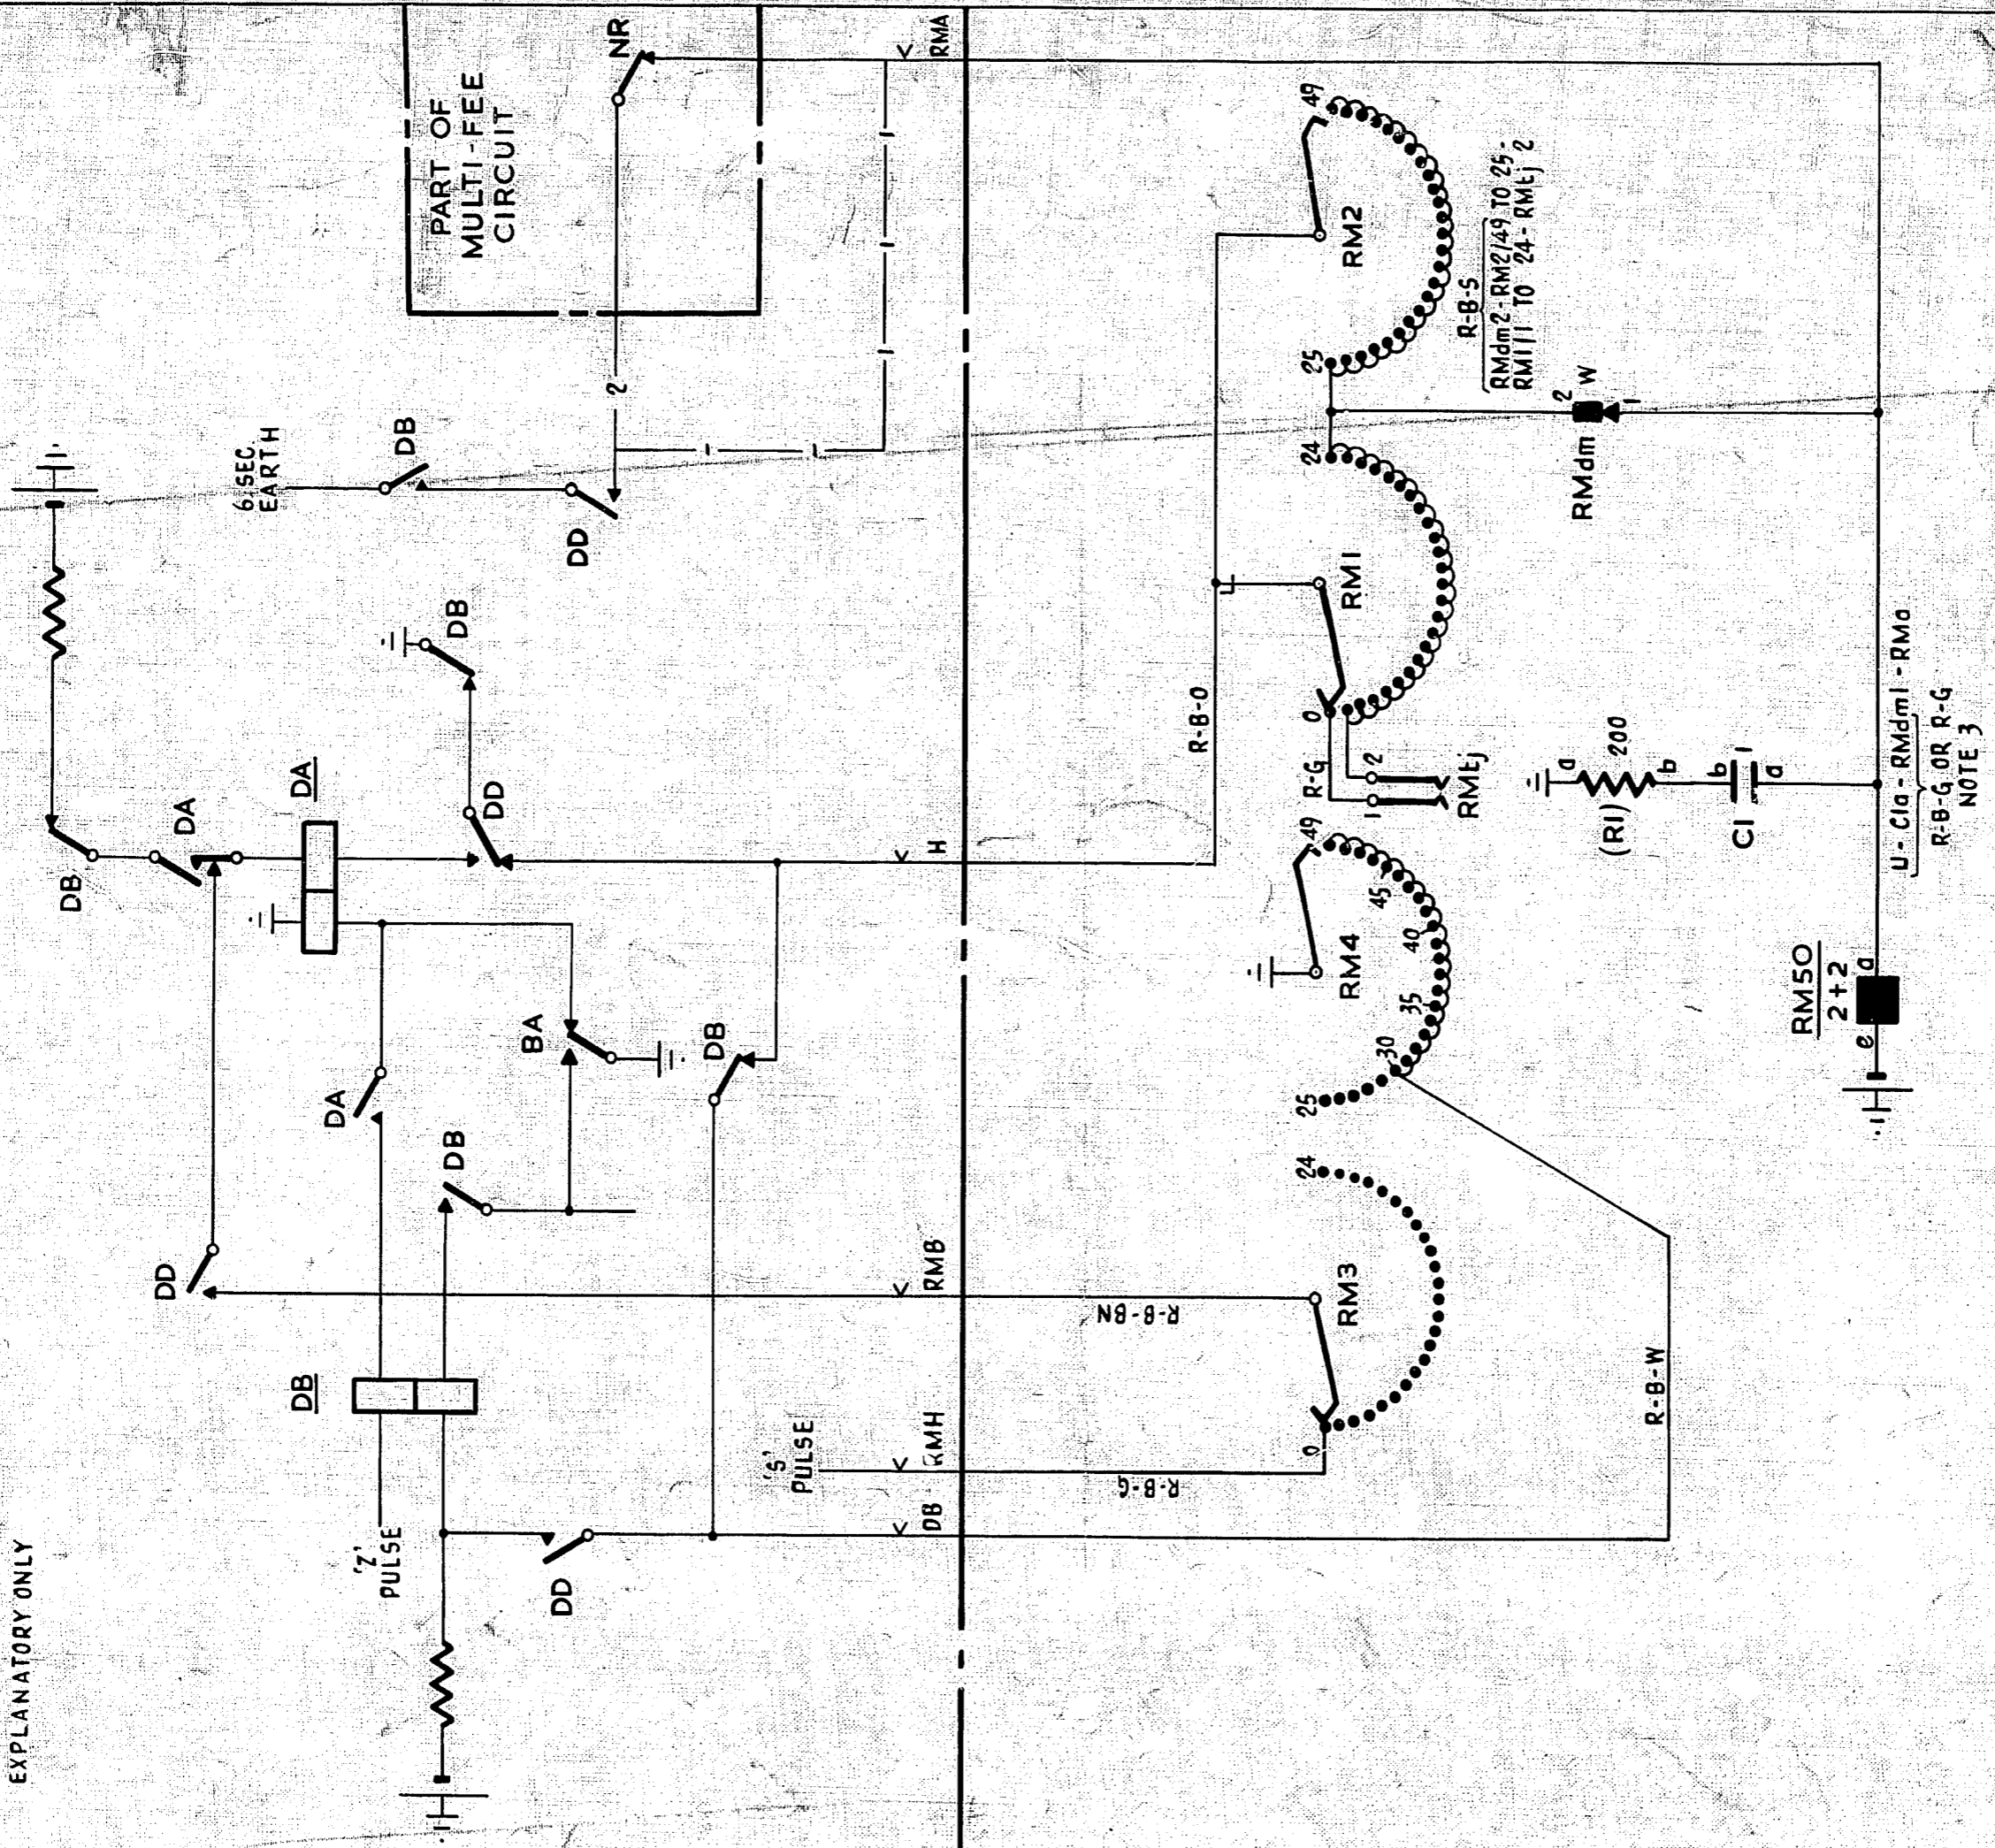

- NOTES
1. FUSING: FUSED WITH ASSOCIATED MULTI-FEE RELAY SET WHEN PROVIDED (FULL SATELLITE EXCHS ONLY) OR WITH ASSOCIATED OIG JUNCTION RELAY SET
 2. ALL WIRING TO BE 25 SWG UNLESS OTHERWISE SPECIFIED
 3. FOR COLOUR OF THIS CONNECTION SEE ASSOCIATED SHELF JACK WIRING DIAGRAM

				REPEAT METERING EQUIPMENT		
(56663)				1	26-1-62	
AMENDMENT PARTICULARS				ISSUE DATE	APPRO	REF. TR1039 17.41
N.Z.P.O.				DRAWN CHECKED WIRING CIRCUIT		SIZE S 50V E
						GBW 12451