


M.A.R.

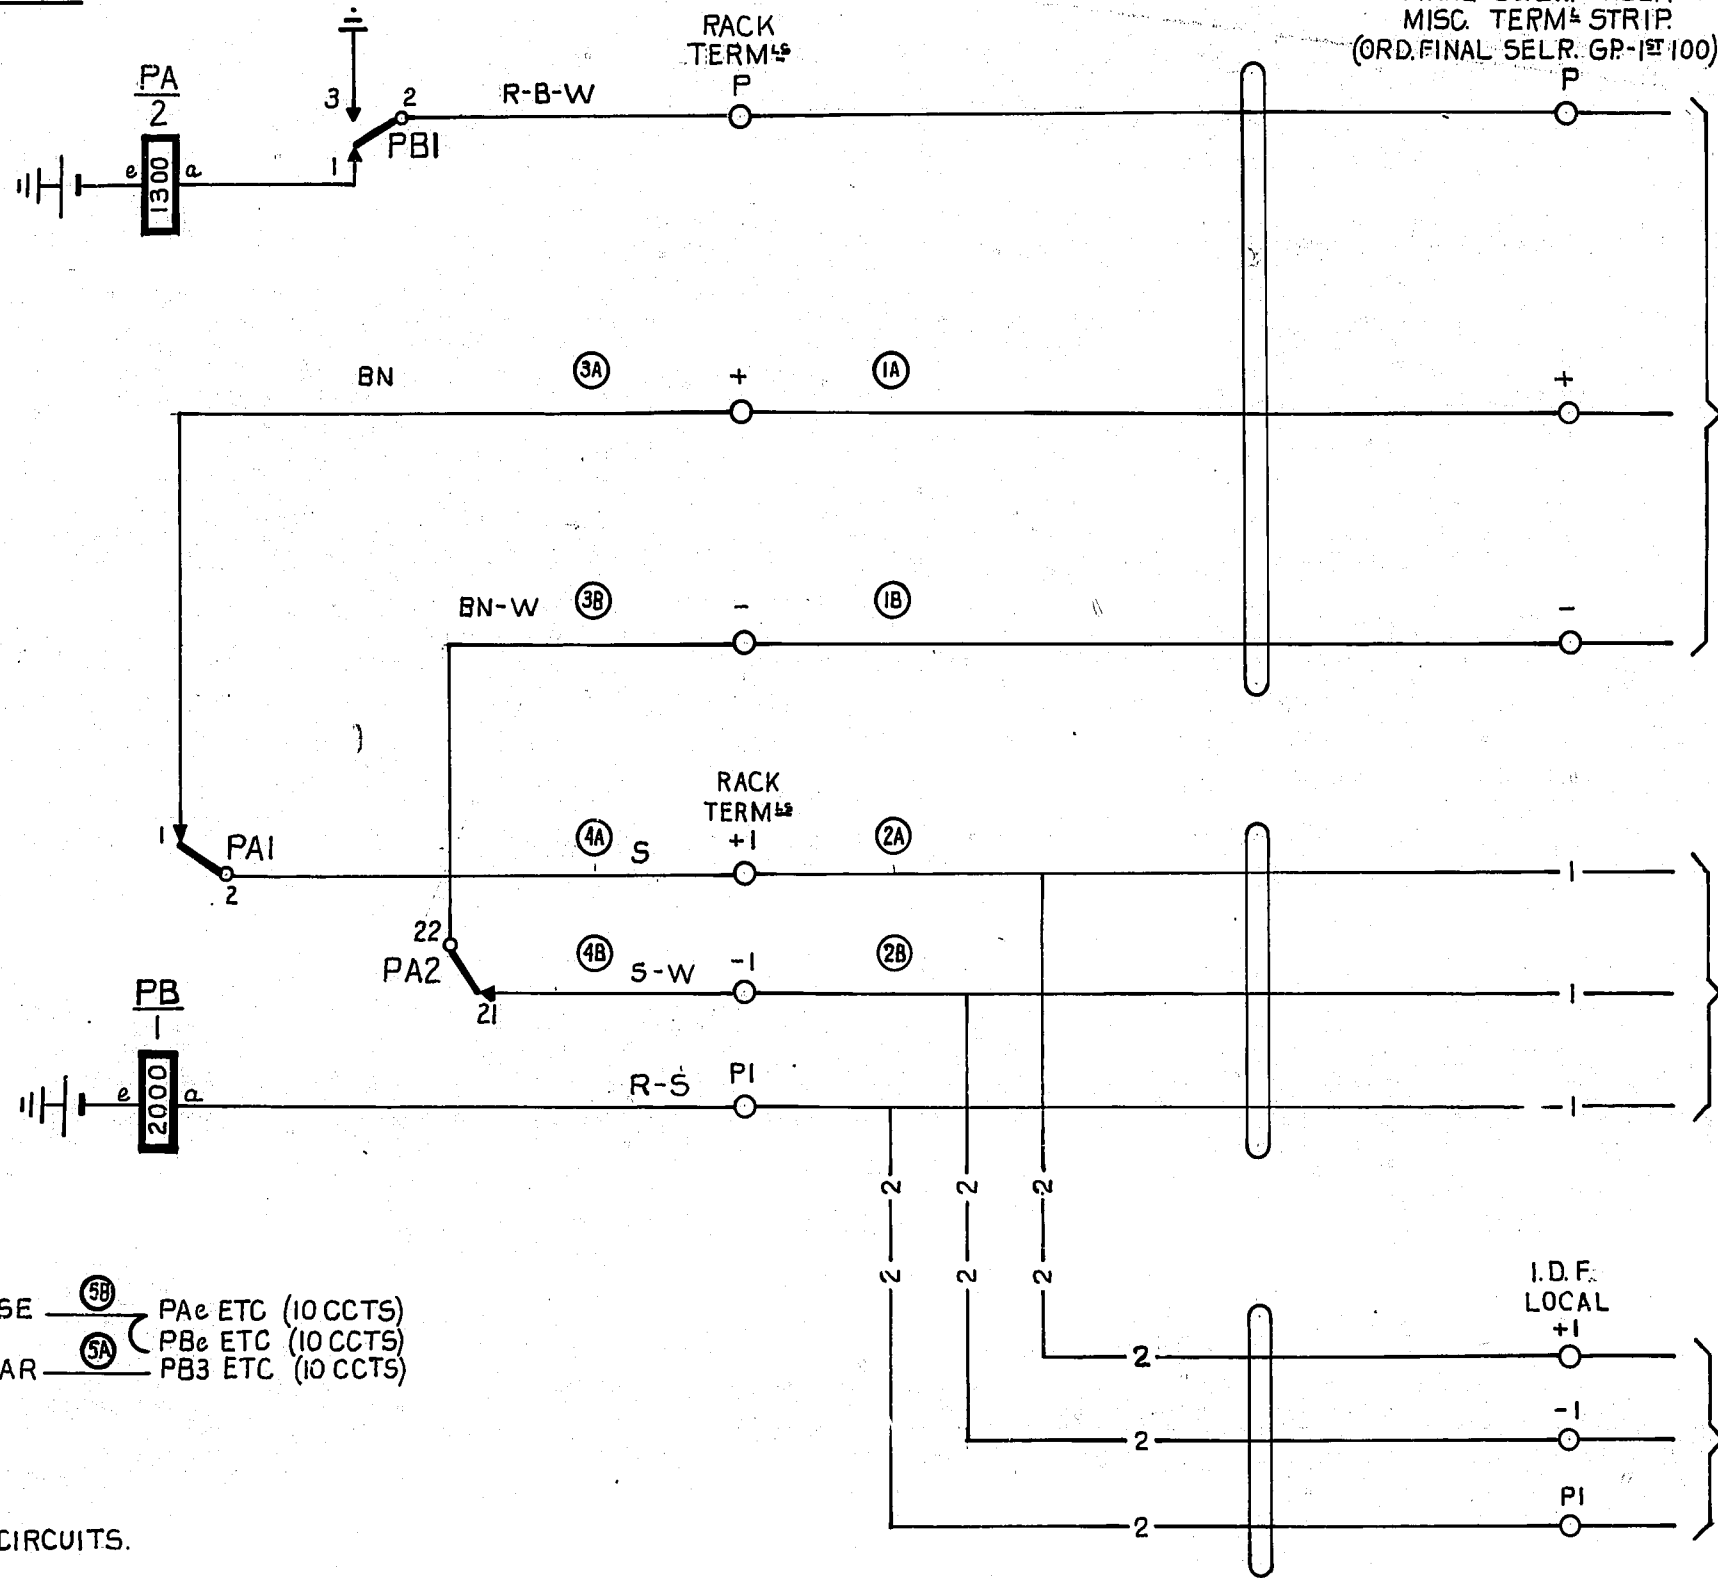

BATT. BK 0.7mm FUSE (5B) PAe ETC (10 CCTS)
 ETH. R 0.7mm ETH. BAR (5A) PBe ETC (10 CCTS)
 PB3 ETC (10 CCTS)

NOTE

- 1. FUSING: -1.5A PER 10 CIRCUITS.
- 2. ALL WIRING NOT OTHERWISE SPECIFIED TO BE 0.5mm.

PROOF 50V-S

ISS	DATE	DEL	DC	ORDER	CKD	APD	CHANGE
5A	31-3-80	SS		17061			RETRACED FROM COV ISS 5 20-4-67 DIRECT ONLY CABLING TO GROUP SELR WAS
2							

P-WIRE CONTROL CIRCUIT FOR C.C.B LINES

DRN T-EQPT	CKD	ORIGIN T-EQPT
TCD S.S.	APPD	STANDARD ATW 2200I
NZPO ENGINEER-IN-CHIEF WELLINGTON		
SHT OF 1	GBW 12480	

UD 235

1

2

3

4

5