


Centimeters 0 5 10 15 20 25 30

COPY TRACING NO. 64 (A.7 M. TYPE)

M.A.R. EXPLANATORY ONLY

FIG. A & B
 FIG. A SUPERVISORS TURRET
 FIG. B POSTMASTERS TURRET

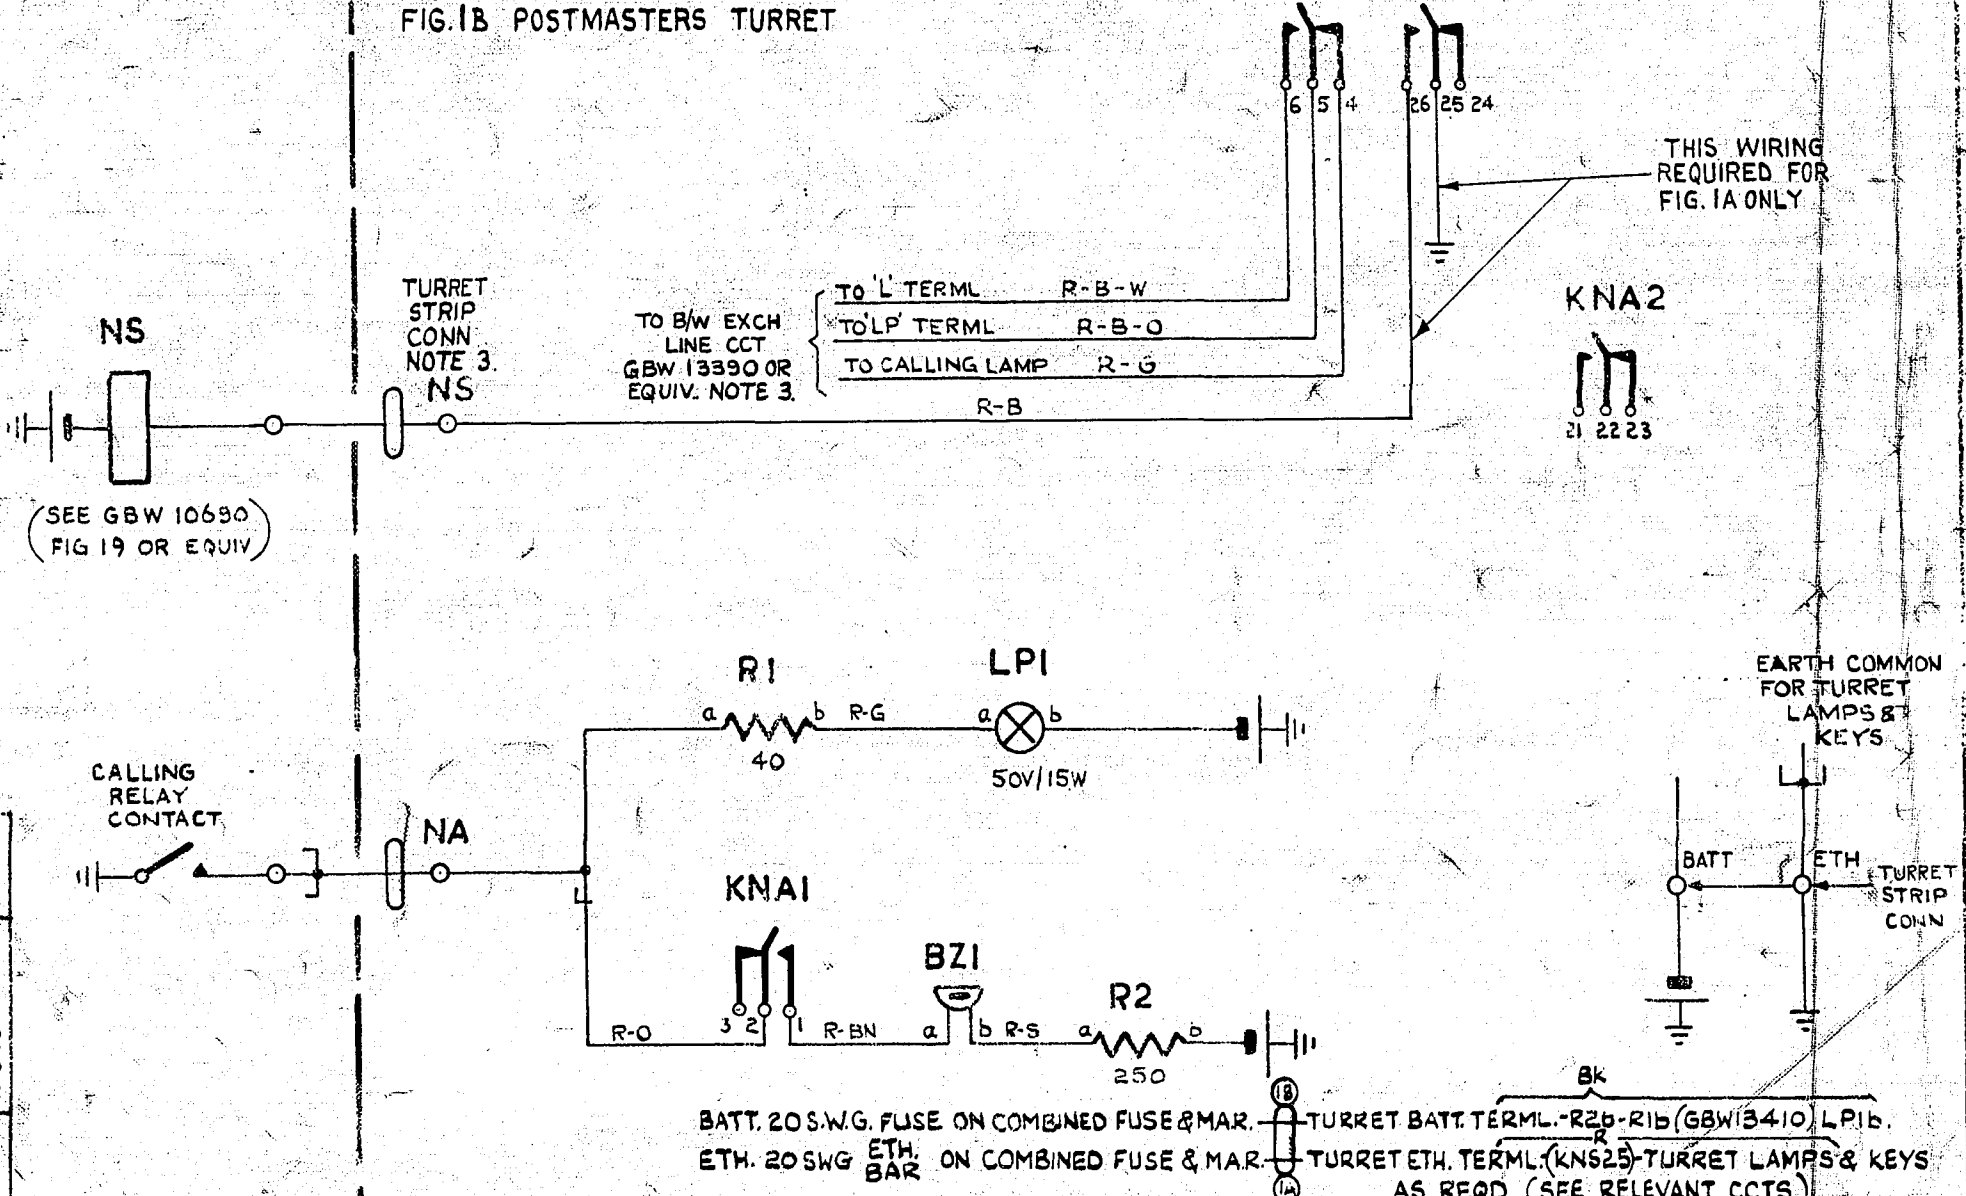

NIGHT ALM. (KNA)	NIGHT SWITCHING (KNS)
2	2

NOTES

- 1. FUSE 1.5A 1PER CCT
- 2. ALL WIRING NOT OTHERWISE SPEC'D TO BE 23 S.W.G.
- 3. IN SOME EXCHANGES THE MANUAL SWITCHBOARD IS SITUATED IN A BUILDING REMOTE FROM THE AUTO EQUIPMENT BUILDING AND IN SUCH CASES THE CONNECTION BETWEEN THE RACK STRIP CONN. AND THE TURRET STRIP CONN. ARE CABLED VIA THE I.D.F. MULT AND/OR LOCAL (AUTO BUILDING) AND A MANUAL ROOM FRAME (MANUAL BUILDING)

DRAWN G.M.M.	CHECKED G.M.M.	WIRING A.M.M.	CIRCUIT L.M.M.	ISSUE	DATE	APP'D	REF. -	SIZE	F	50V	S
				2	1-11-63	DBH	GBW 13420				
NOTE 3 ADDED. (69441)				NIGHT ALARM & NIGHT SWITCHING CIRCUIT SUPERVISORS OR POSTMASTERS TURRET							
2000 TYPE											