
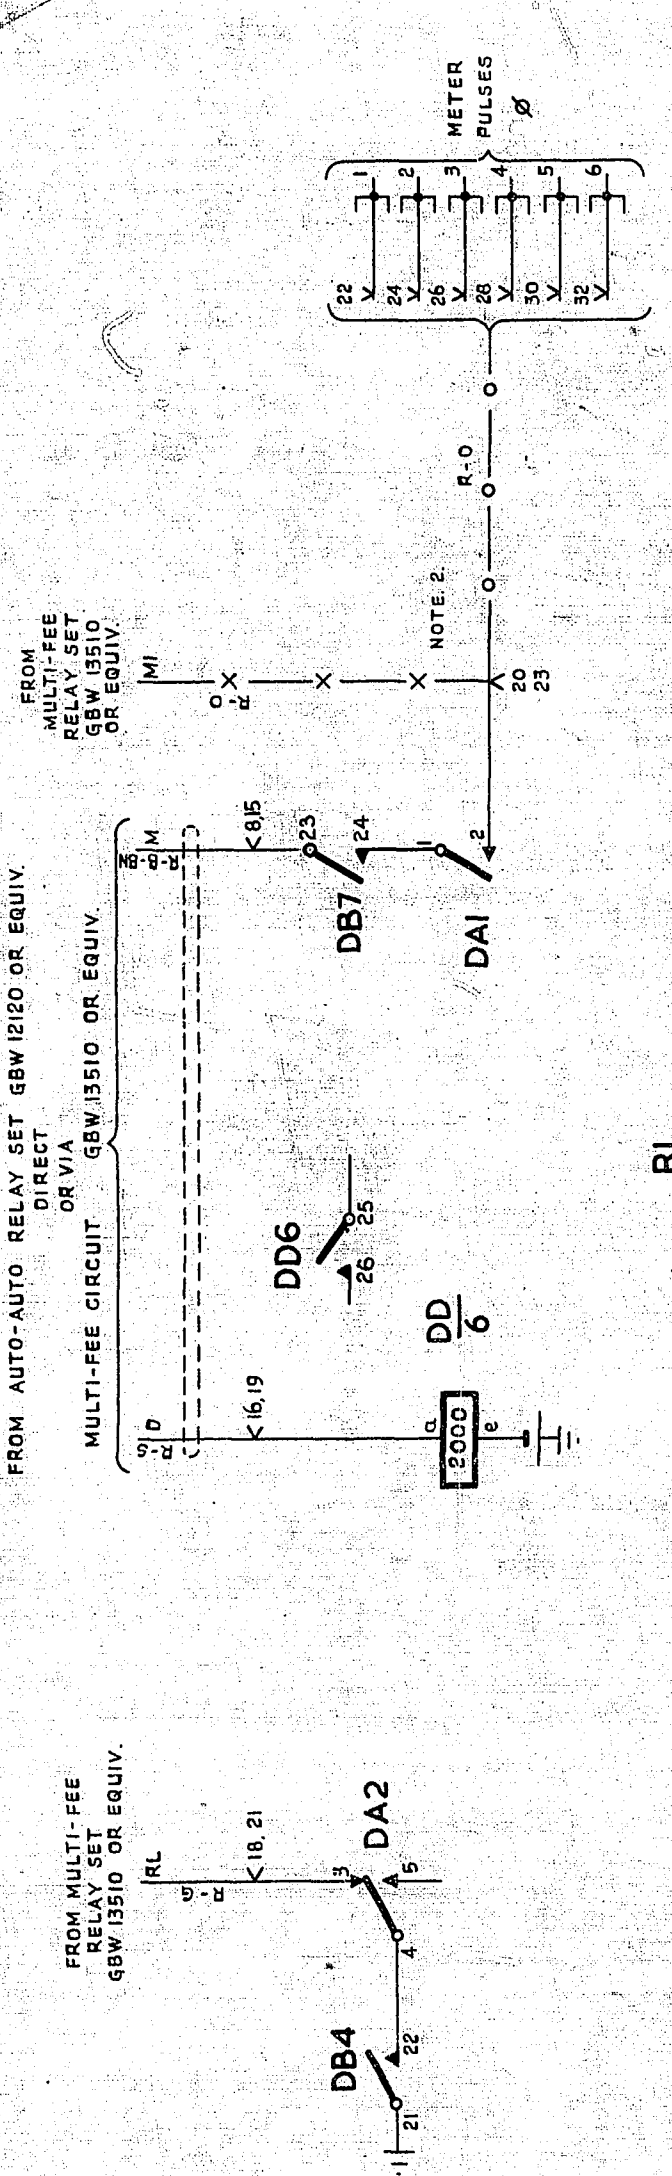


0 5 Centimetres 10 15 20 25 30

PART OF O/G JUNCTION RELAY SET  
GBW 14530 OR EQUIV.

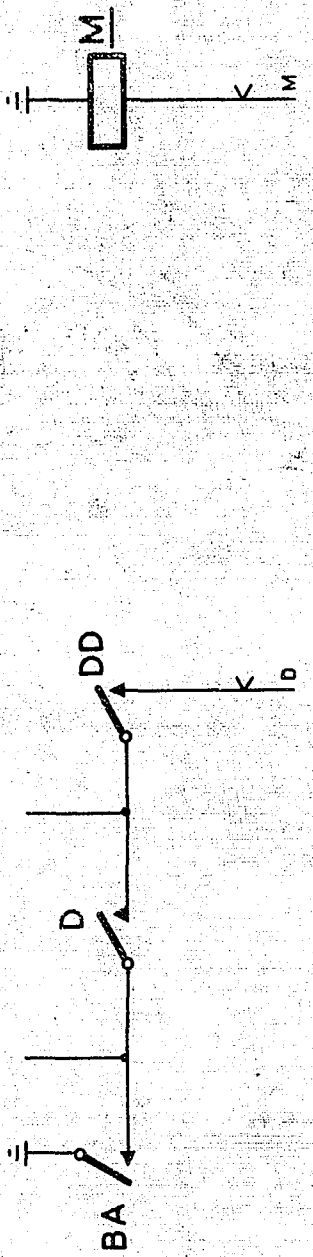

DB7 ADDED. DB6 WAS WIRED. (30682)	2	26.5.55	208
(31147)	1	12.54	208
AMENDMENT PARTICULARS	ISSUE	DATE	APPD
NZPO	4		
DRAWN	CHECKED	WIRING	CIRCUIT

METERING CONTROL CIRCUIT  
FULL SATELLITE EXCHANGES.

SIZE: S 50V E

GBW 13520

NOTES

- FUSING - EACH CIRCUIT FUSED WITH ITS ASSOCIATED MULTI-FEE RELAY SET WHEN PROVIDED, OR WITH ITS ASSOCIATED AUTO-AUTO RELAY SET.
- FOR FIXED FEE WORKING CONNECT U20 (1ST CCT) & U23 (2ND CCT) AS SHOWN. FOR VARIABLE FEE WORKING ADD CONNECTION SHOWN. X - WHEN REPEAT METERING EQUIPMENT IS NOT PROVIDED STRAP U27-U25-U7.
- ALL WIRING TO BE 23 SWG. UNLESS OTHERWISE SPECIFIED.
- JACK POINTS 9&11 TO MAKE CONTACT WHEN RELAY SET IS REMOVED.
- FOR WIRING SEE GBW 10640 OR EQUIV.

TJ

TJ 2