

NOTES

1. FUSING 1-5A PER CCT
2. FINDER BANK OUTLETS 1-6 ARE CONNECTED TO FINAL SELECTOR CIRCUITS 1-6 RESPECTIVELY
3. ALL WIRE UNLESS OTHERWISE SPECIFIED TO BE 0.5mm
4. SHELF JACK U POINTS 9 & 11 MAKE CONTACT WHEN RELAY SET IS REMOVED.
5. Ø FOR WIRING SEE GBW 13700 OR EQUIV.
6. WHEN THIS RELAY SET IS USED TO PROVIDE TEMPORARY MULTI-PARTY LINE SERVICE IN AN AMX OR CAX PARTY TO BE CONNECTED TO UB AND LINK REMOVED FROM TJ7-B

N.Z.P.O. NOTE

- A. WHEN THIS RELAY SET IS USED IN A REMOTE NZ 13 R OR NZ 13 RM UNIT TO TERMINATE AN INCOMING UNIDIRECTIONAL OR BOTHWAY JUNCTION, EARTH IS TO BE CONNECTED TO U POINT 8 AND THE LINK REMOVED FROM TJ7 AND 8.

TO UAX 13 GRP SELR. MULT. OR TO JUNCTION RELAY SET VIA 1 P.F. MULT.

BATT BK FUSE (1B) 0.7mm U12
 ETH R ETH BAR (1A) Fe (FIG 2) U11
 Ri-a-Ftj 1 (FIG 2)
 BATT. W. U12-BAa-DGe-Pe-Le-Rib
 ETH. R. U11-BA21-PG21-DG4-P2-K25-K26-Lb-TJ1.

FIG.1


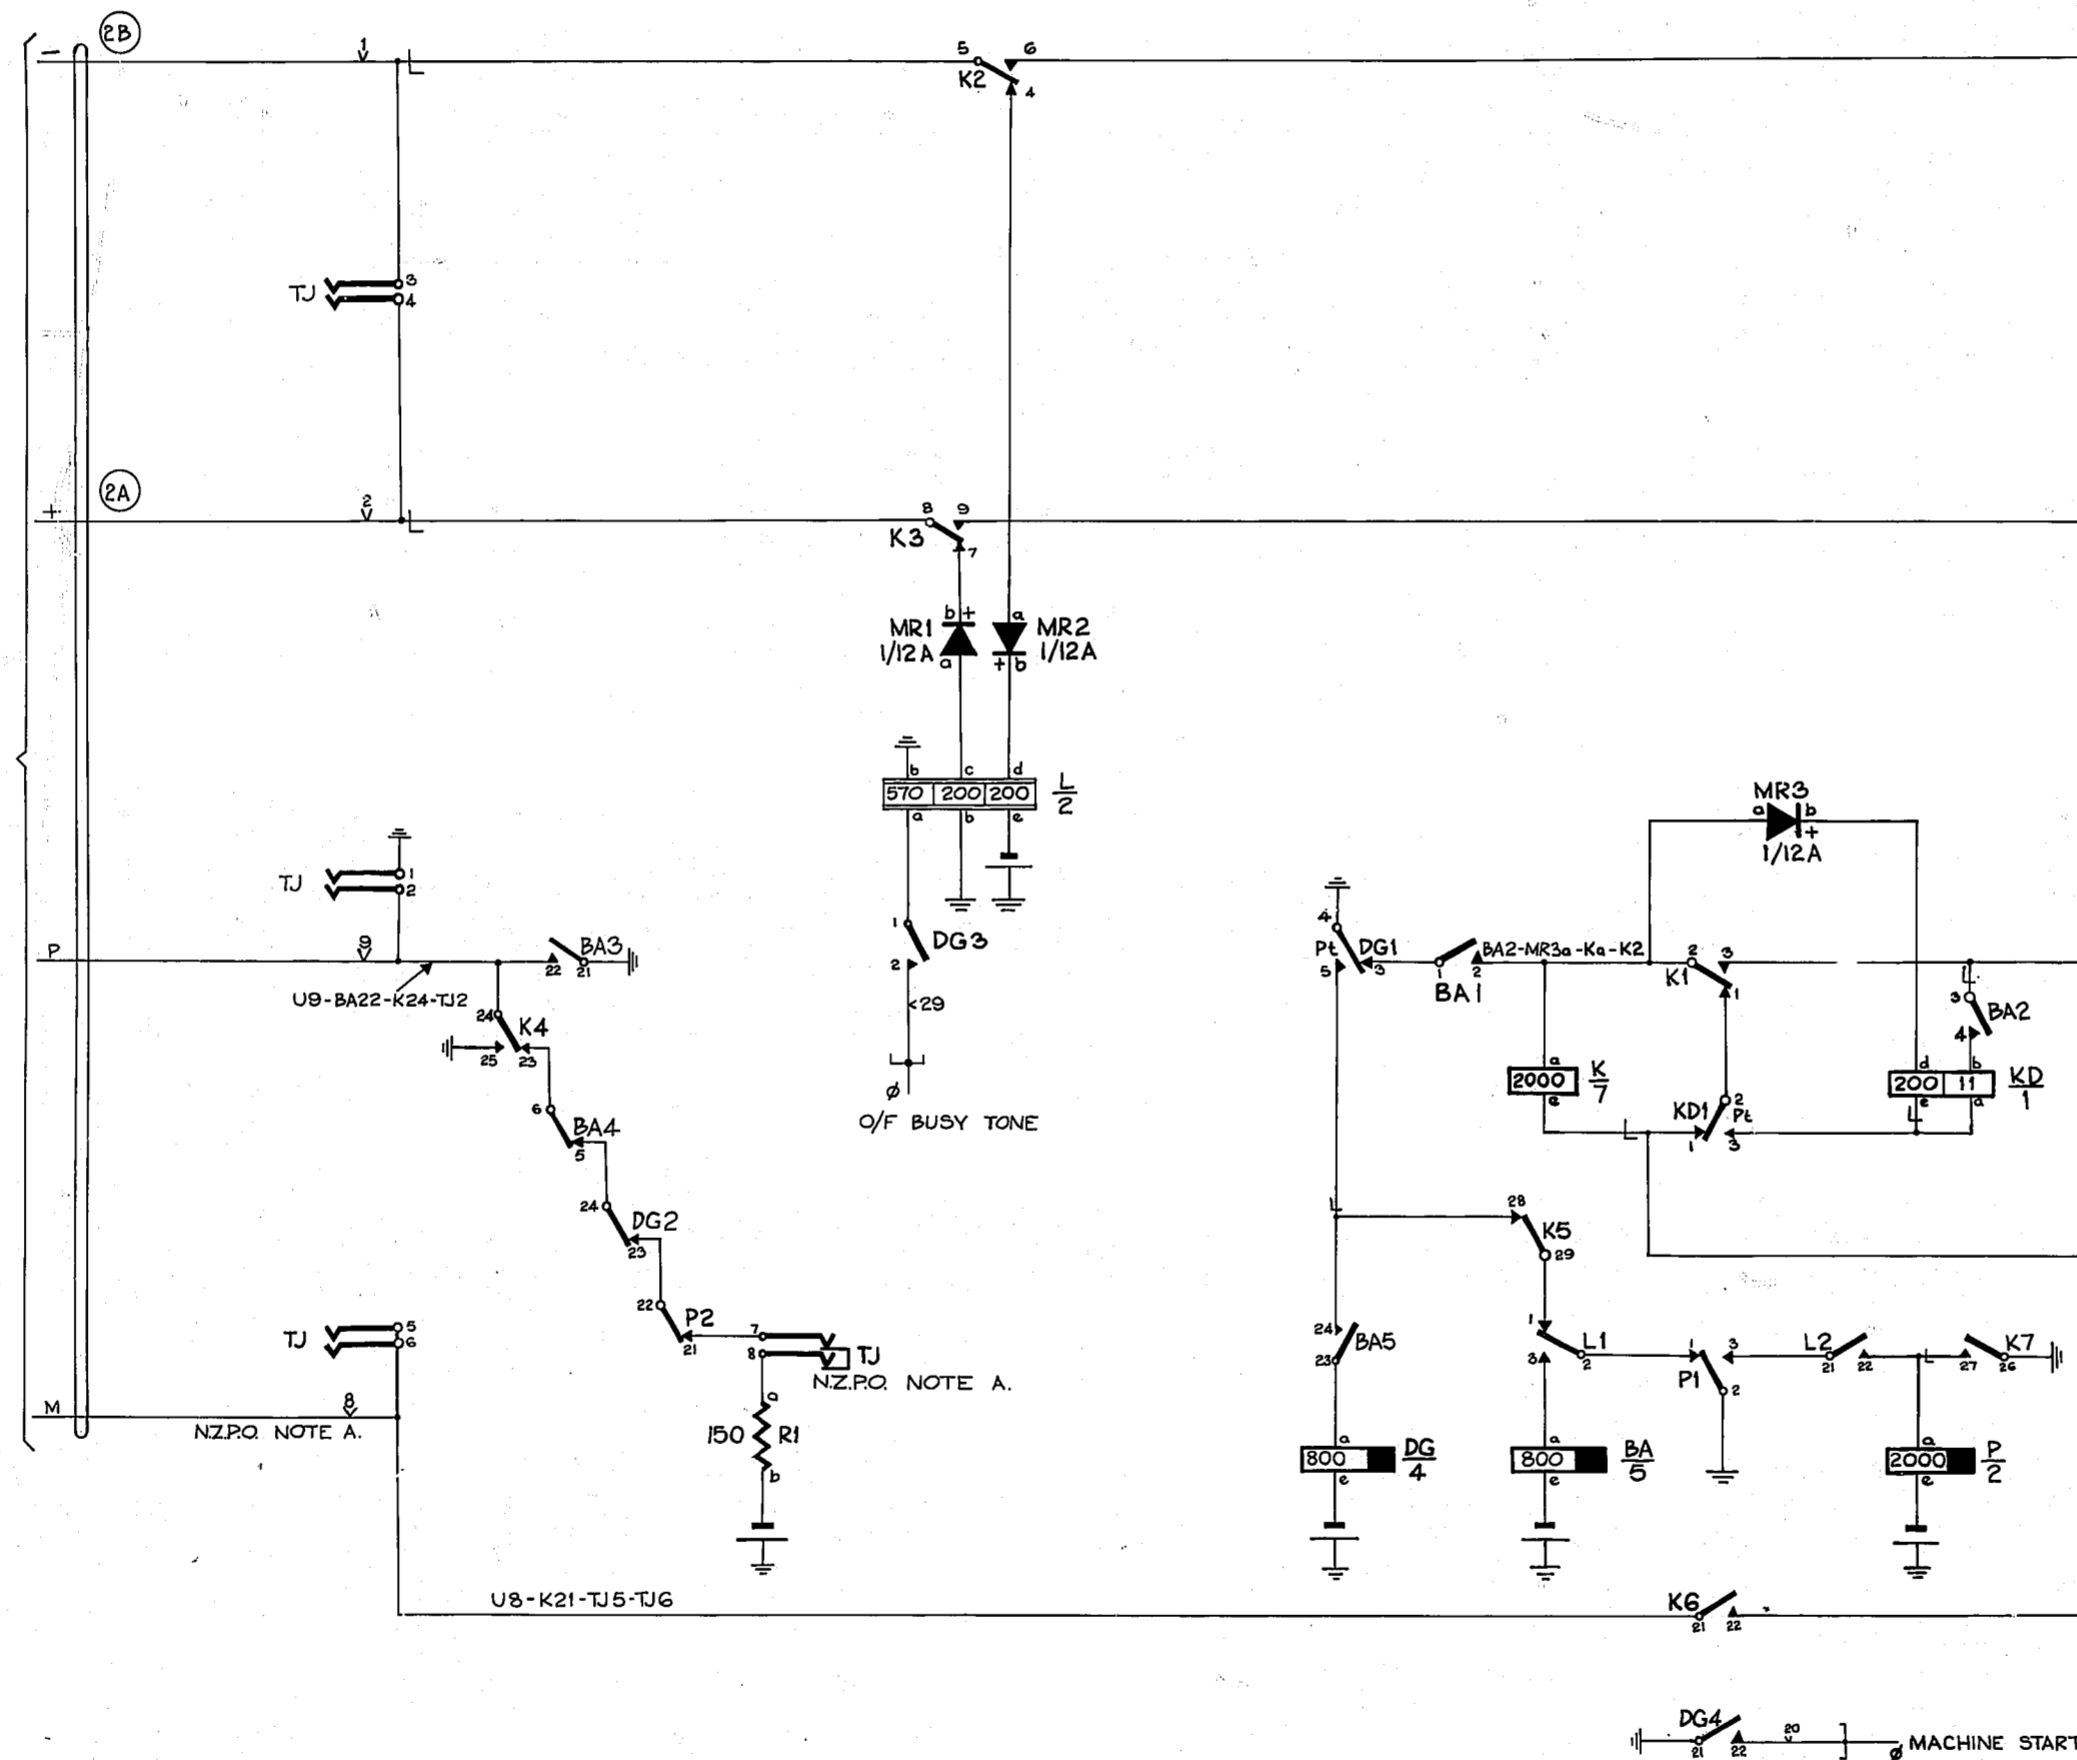


FIG.2

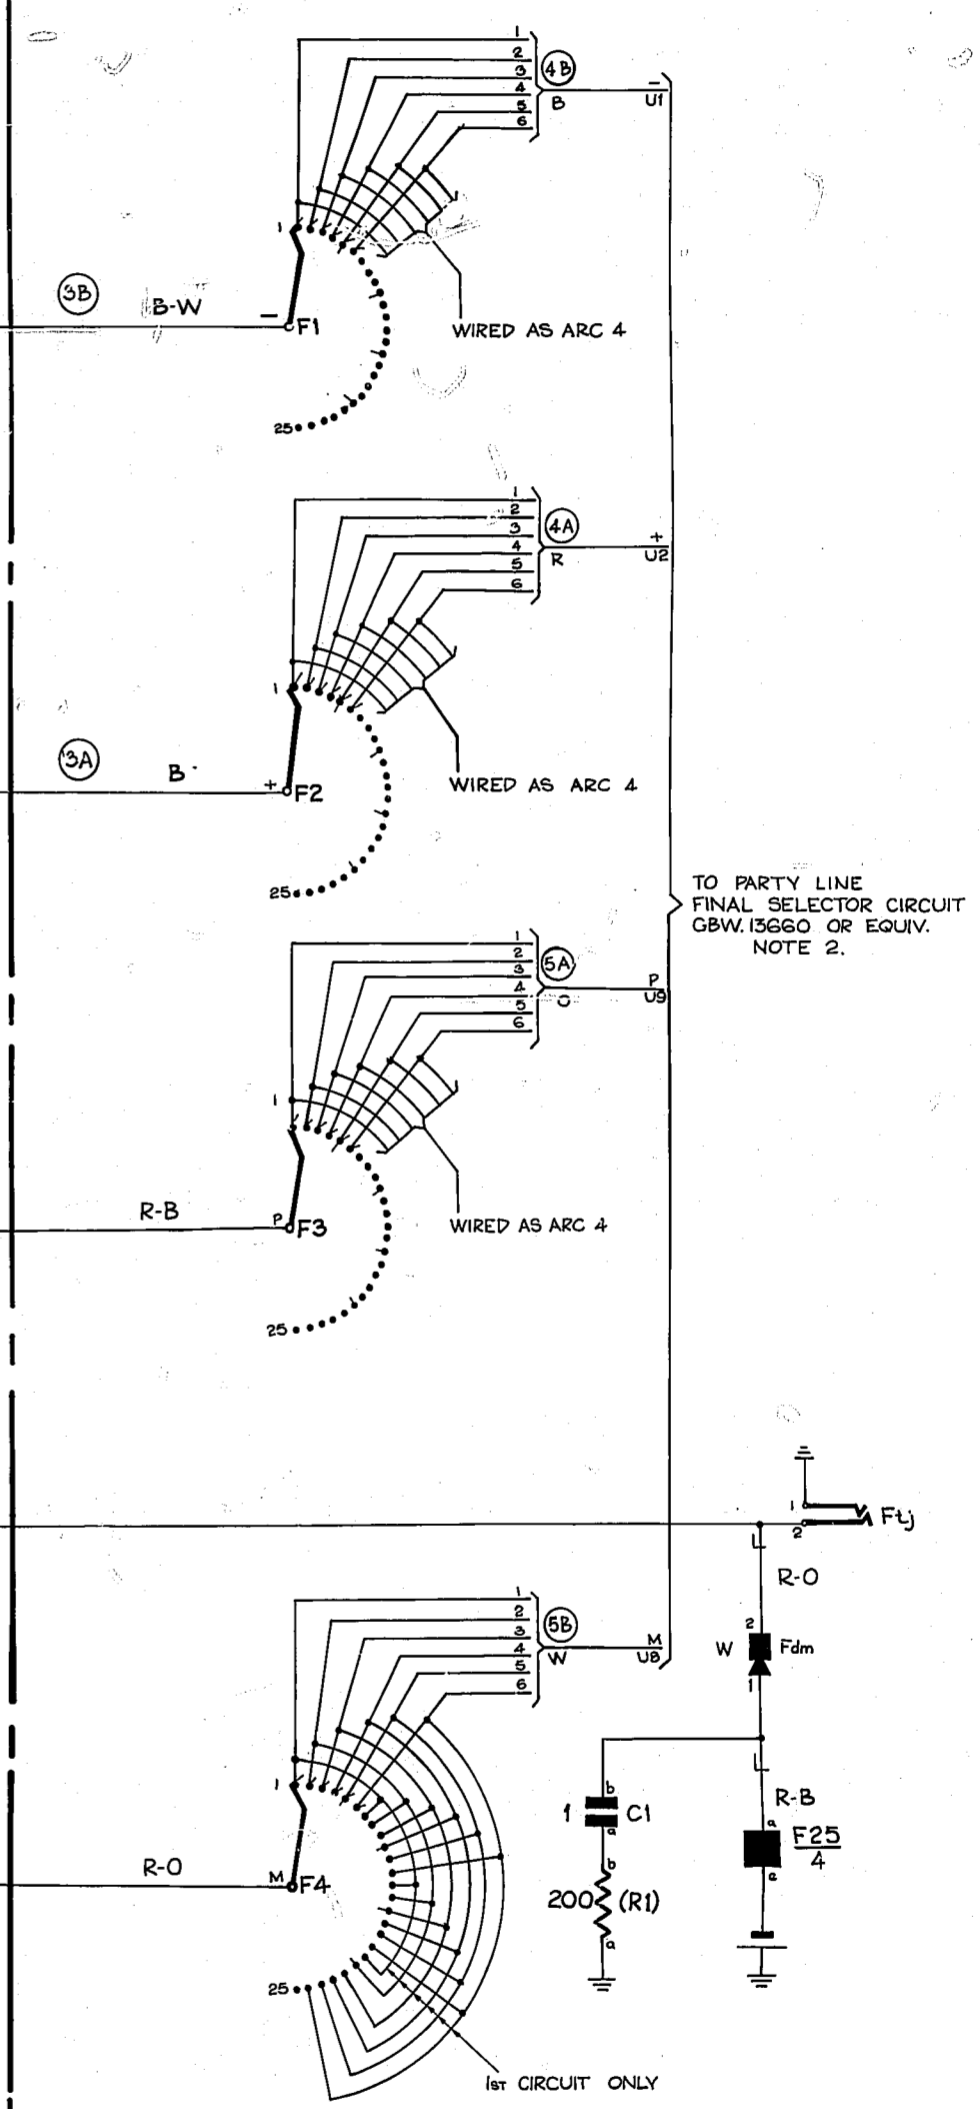

NOT TO BE USED FOR NEW WORK

REDRAWN AND METRICATED	(57612)	5B	25-3-78
NZPO NOTE A ADDED LIMITATION OF USE AMENDMENT	(2830)	5A	17-7-70
LIMITATION OF USE ADDED	(21173)	5	23-10-77
AMENDMENT PARTICULARS	ISSUE DATE	BY	

INCOMING JUNCTION RELAY SET MULT-PARTY LINE UNIT U.A.X.N.Z. 13 R

SIZE A1 50 V. C
GBW. 13680.

