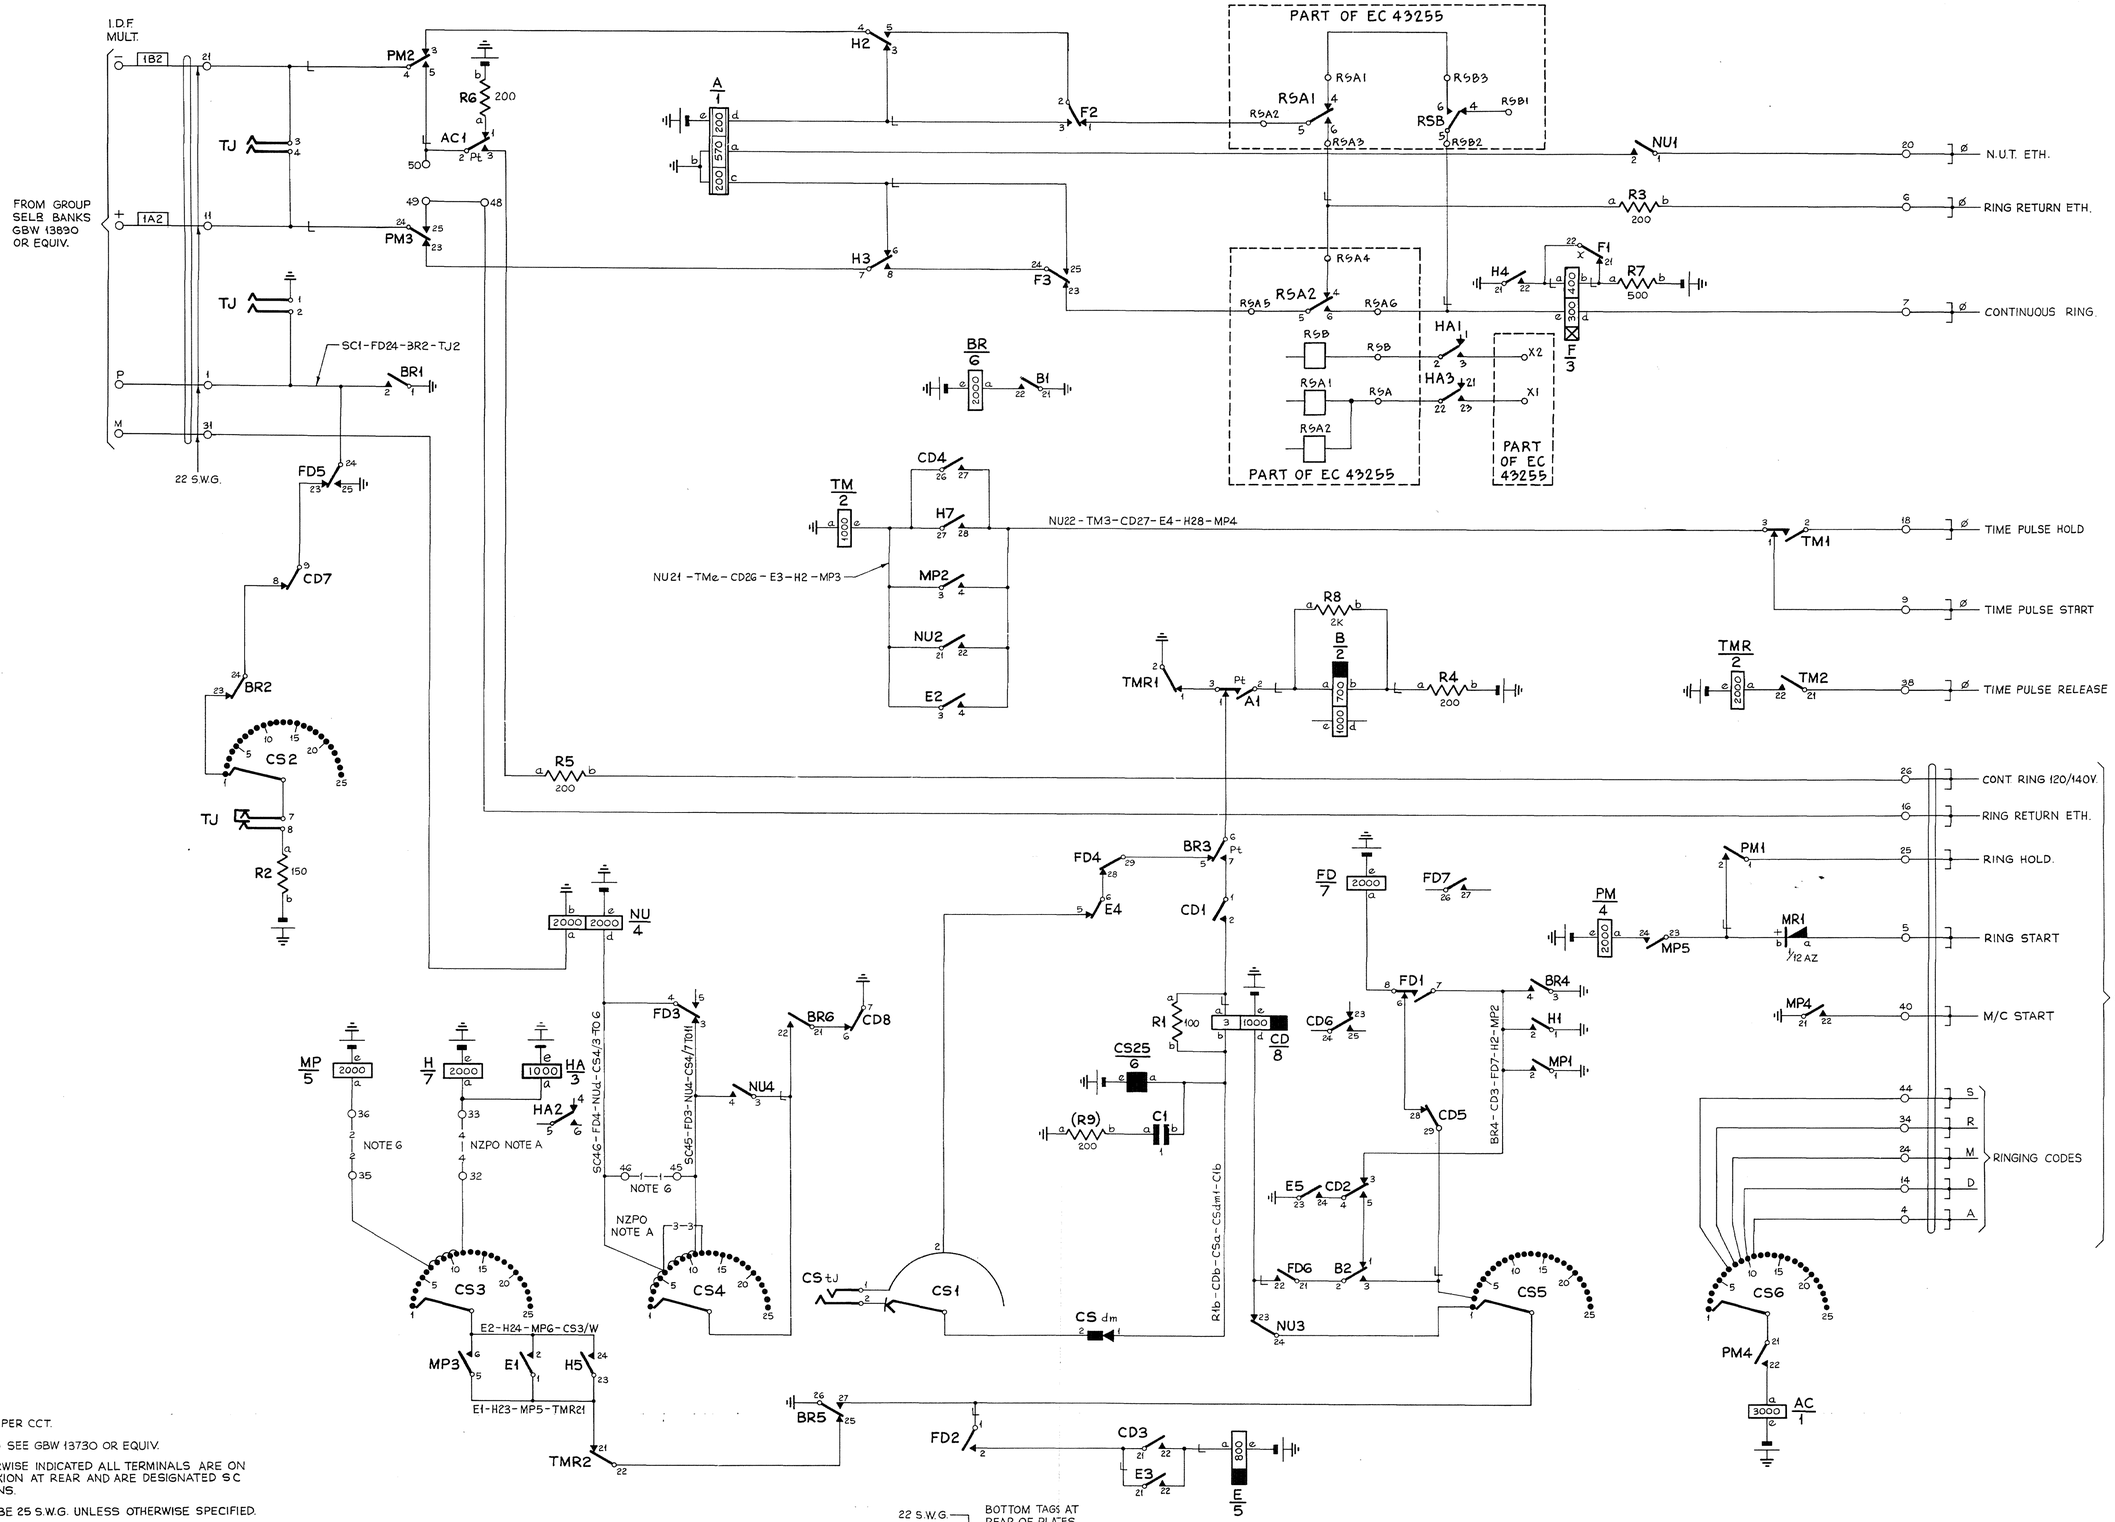

NOTES :-

1. FUSING - 1·0A PER CCT.
2. Ø FOR WIRING SEE GBW 13730 OR EQUIV.
3. UNLESS OTHERWISE INDICATED ALL TERMINALS ARE ON STRIP CONNEXION AT REAR AND ARE DESIGNATED SC IN WIRING RUNS.
4. ALL WIRE TO BE 25 S.W.G. UNLESS OTHERWISE SPECIFIED.
5. DELETED.
6. AT EXCHANGES WHICH PROVIDE FOR ONLY 2 PARTY LINES & DIAG. GBW 13760 IS NOT FITTED USE CONNECTION SHOWN —1—1— & OMIT —2—2— OTHERWISE USE —2—2— & OMIT —1—1—

N.Z. NOTE A :-

WHEN USED WITH REMOTE 'M' UNITS PROVIDE —3— & OMIT —4— AT OTHER INSTALLATIONS PROVIDE —4— & OMIT —3—

AMENDMENT PARTICULARS		ISSUE	DATE	APPD
NZM XT MOD B	(54562)	A	26·7·85	GCG
~~RETRACED~~	~~(68204)~~	~~9A~~	~~13·5·76~~	~~CJW~~
NZ. NOTE ADDED	(86825)	9A	5·6·69	GE
NU RELAY & ASSOCD WIRING REVISED	(47279)	9	11·2·65	DIB

SLOW RELEASE | SLOW OPERATION

U.A.X. N.Z.13
REVERTIVE CALL RELAY SET
FOR 2 PARTY & 5 PARTY LINES
(FOR USE WITH NEC LLE)

SIZE : A1 | 50V | C

GBW 13770 MOD B

NZPO

TJ/12