


POS. BATT. CHARGE FAIL ALARM.
(PROVIDED WHEN POS. BATT. SERVES 1VF EQUIPMENT)

FIG. IC

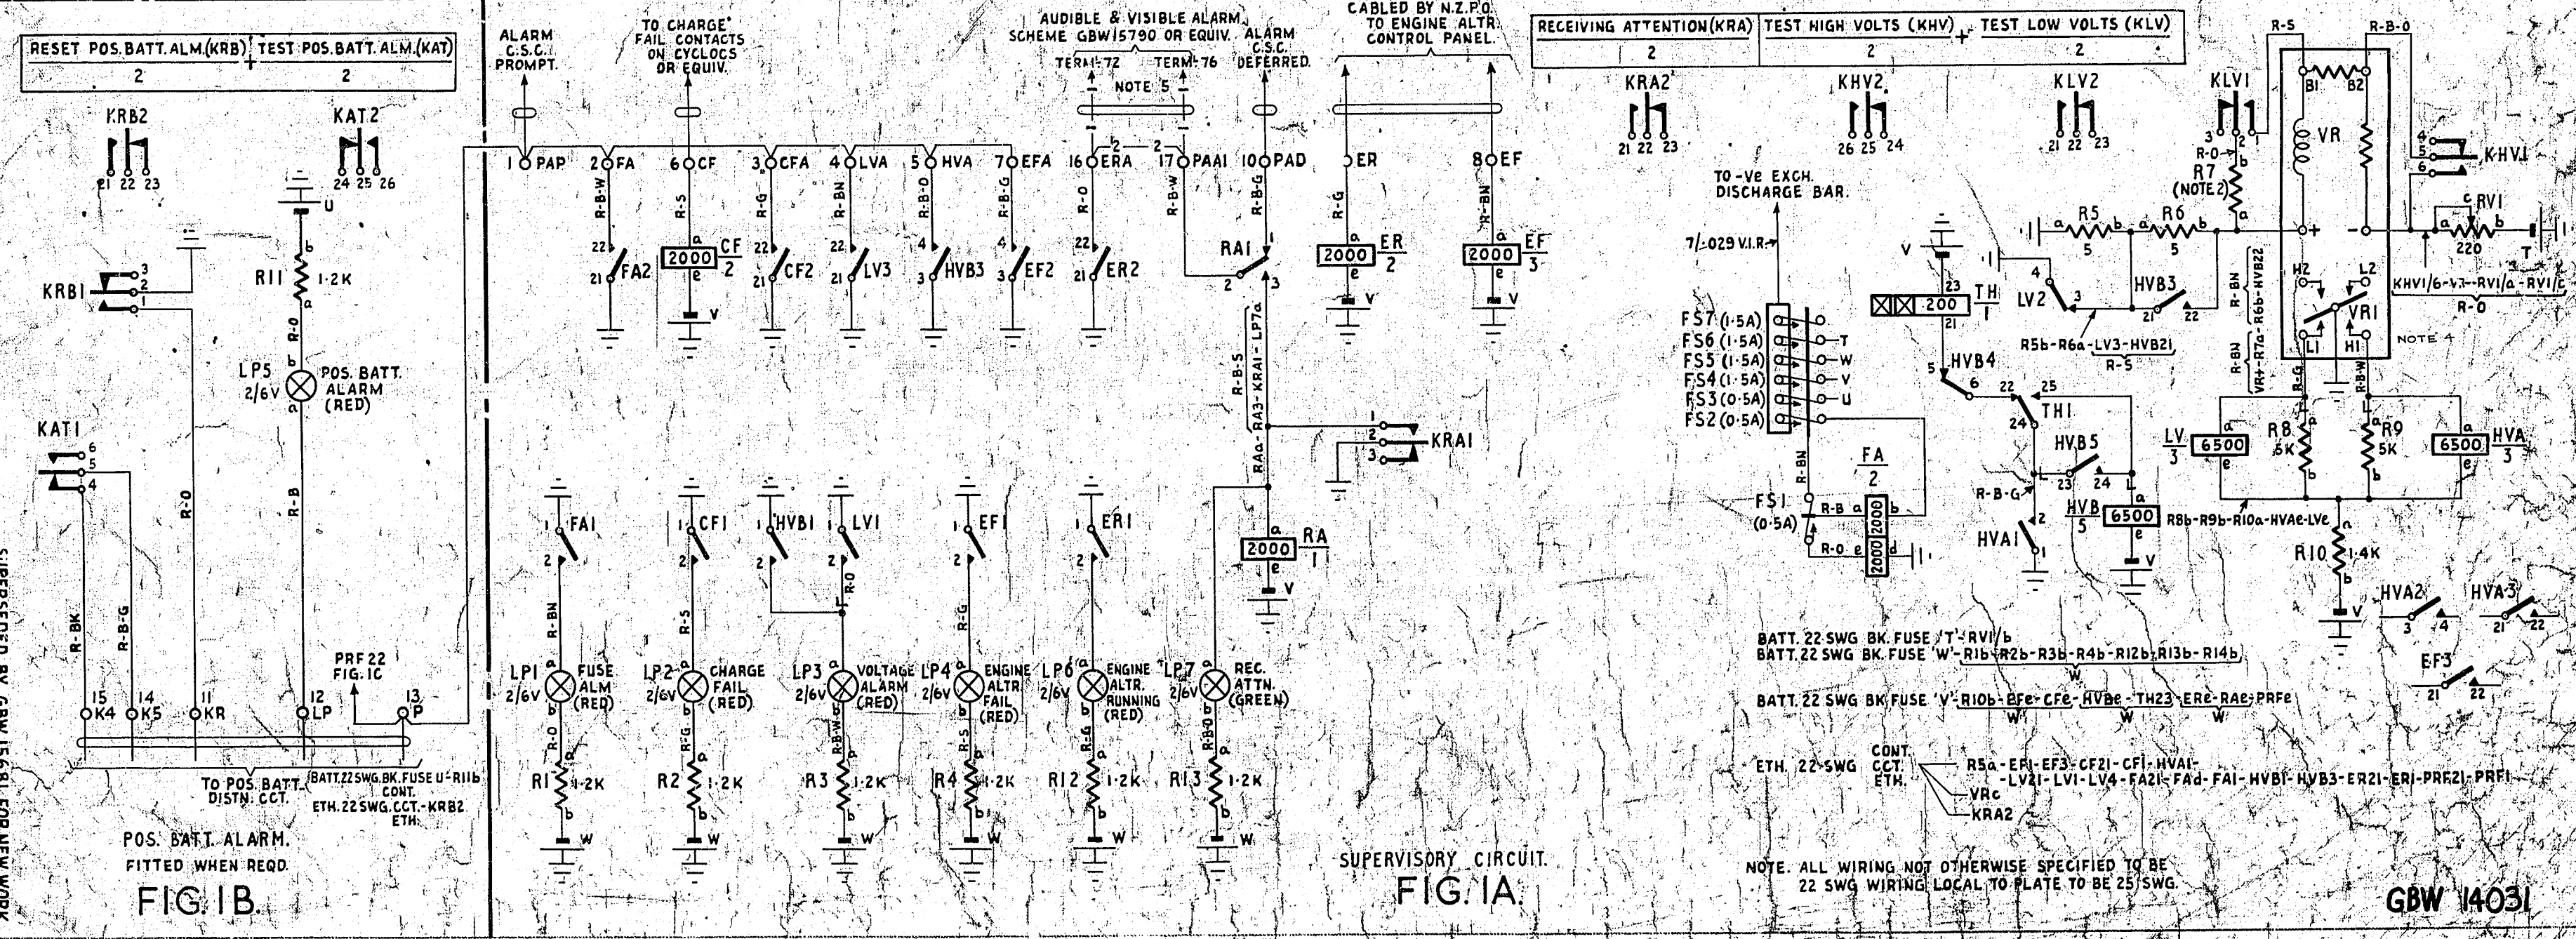

ORIGIN: NZPO	AMENDMENT PARTICULARS	ISSUE DATE	APPD.	REF.	SIZE	VOLTS
DC POWER PLANT CONTROL PANEL					M	50V
GBW 14031						

1 of 1