

FIG.1A
FUSE ALARM

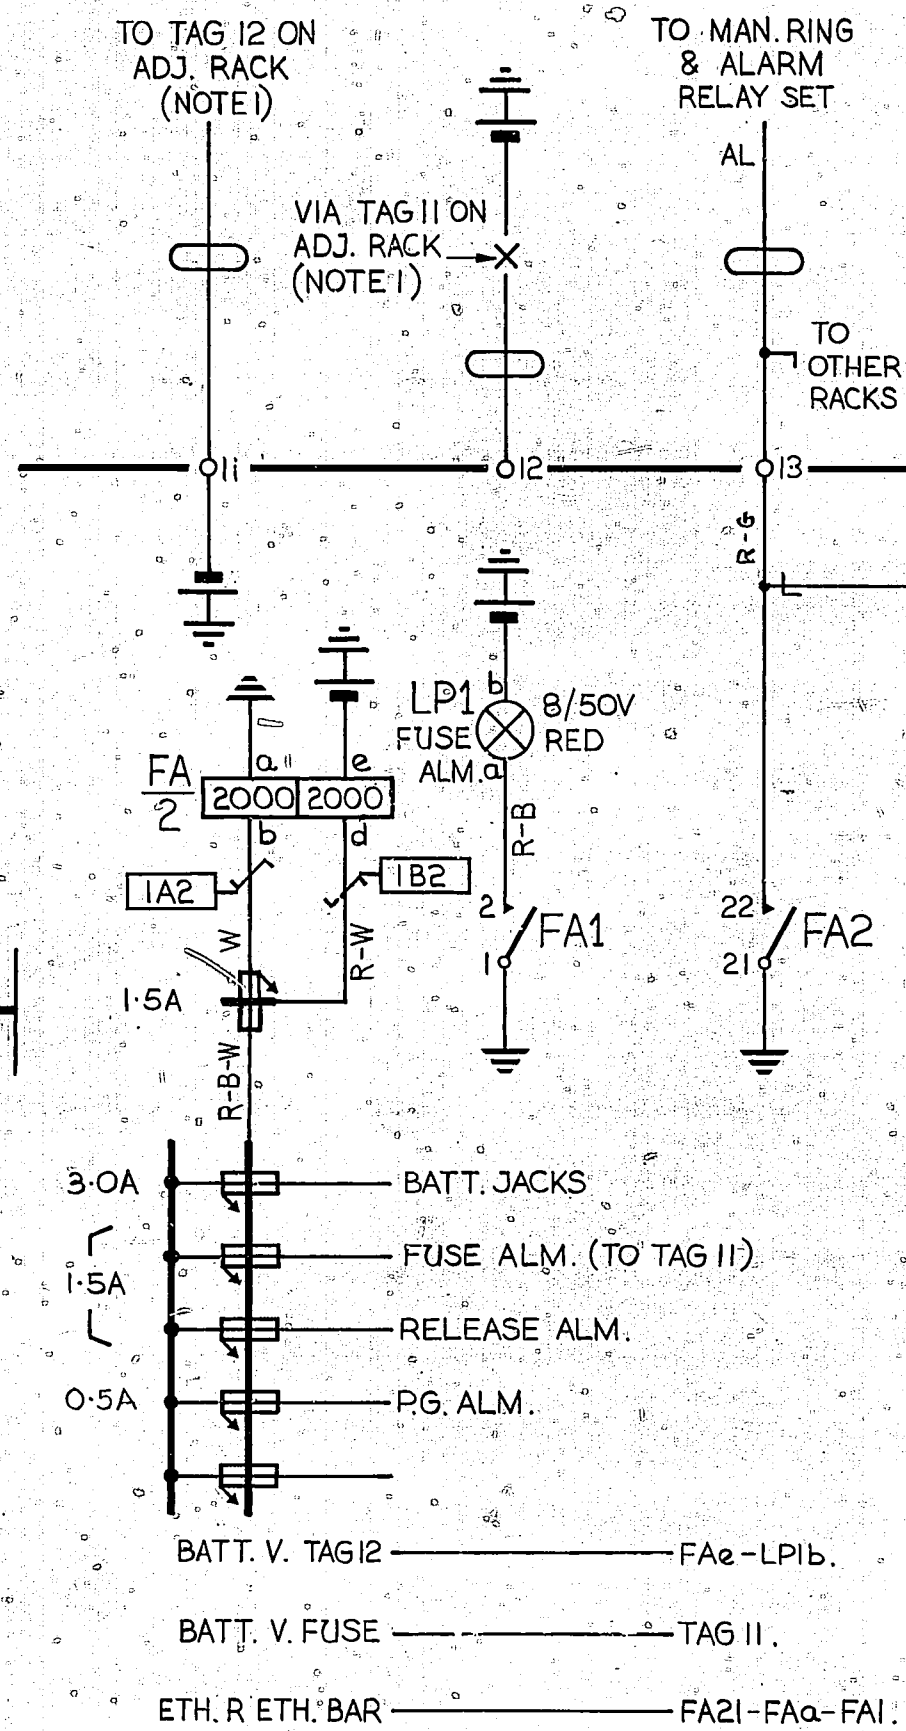


FIG.1B
1 PER RACK

FIG.2A
RELEASE ALM.
1 PER RACK

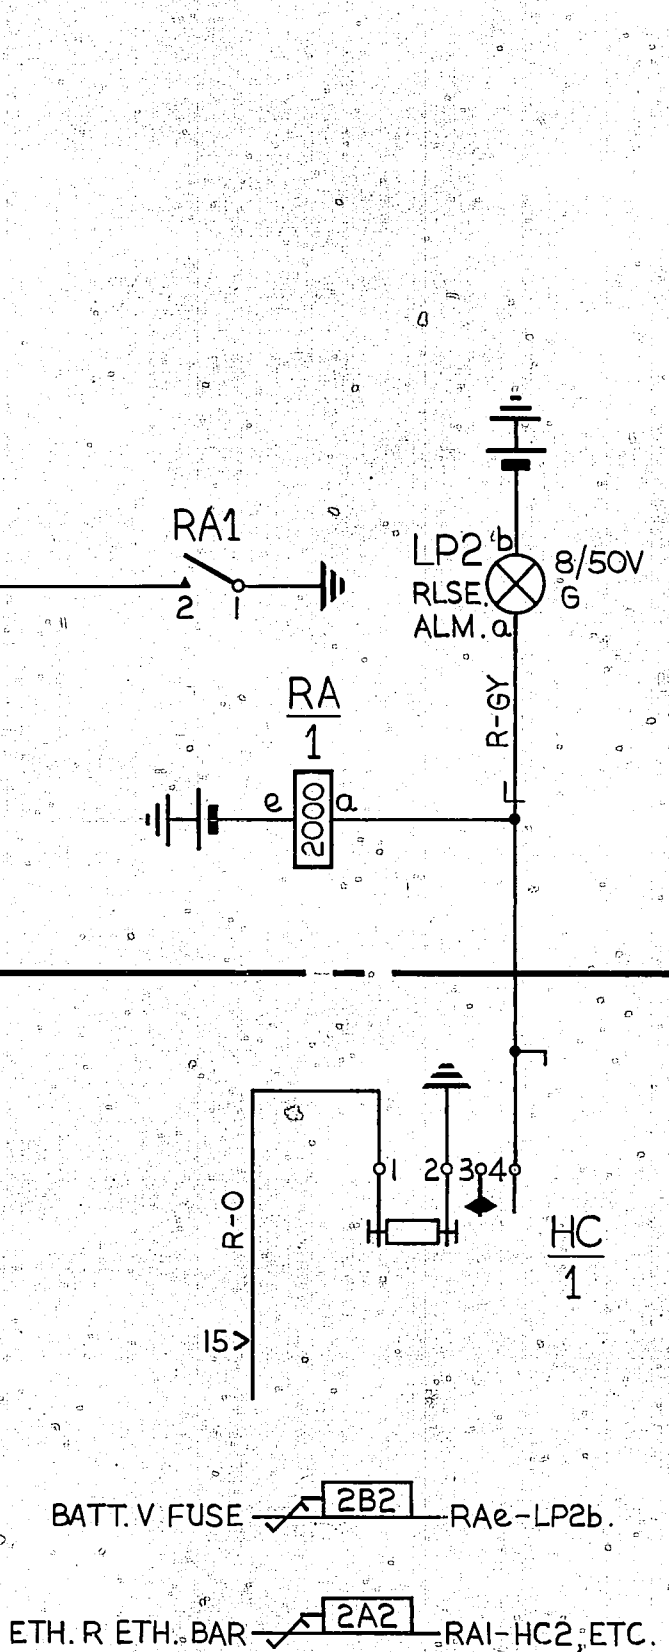


FIG.2B
1 PER SELECTOR

NOTES:

1. THE FA RELAY & LAMP ON THE 2nd, 4th, ETC, RACKS IN A SUITE SHALL BE SERVED BY THE FUSE ON THE 1st, 3rd, ETC, RACKS RESPECTIVELY. THE FA RELAY & LAMP ON THE 1st, 3rd, ETC, RACKS IN A SUITE SHALL BE SERVED BY THE FUSE ON THE 2nd, 4th, ETC, RACKS RESPECTIVELY. WHEN THERE IS AN ODD NUMBER OF RACKS IN A SUITE, THE FUSE ON THE LAST EVEN RACK SHALL SERVE THE LAST TWO ODD RACKS. WHEN THE ABOVE ARRANGEMENTS CANNOT BE FOLLOWED, THE FA RELAY & LAMP SHALL BE SERVED BY THE FUSE ON THE NEAREST RACK IN THE SUITE. IN THE CASE OF AN ISOLATED RACK, THE FA RELAY & LAMP SHALL BE SERVED BY A FUSE IN AN ADJACENT SUITE.
2. UNLESS OTHERWISE SHOWN, ALL WIRING BEARING A COLOUR CODE TO BE 0.7mm. SWITCHPLATE WIRING TO BE 0.5mm.
3. UNLESS OTHERWISE SHOWN, ALL TAGS ARE ON RACK MISC. STRIP CONN.
4. WHEN FIG.8 SERVES INCOMING 1st SELECTORS, THE TEST JACK SHALL BE WIRED IN SERIES WITH THOSE OF THE LOCAL 1st SELECTORS.

A2 A3	DRAWN CKD. BWH	ENGR. CCT	COMMON SERVICES RACK WIRING 2ND OR I/C. GRP. SELR. RACK 50/1200 LINE P.A.B.X.	REFERENCES	50V W
				NZPO	SIZE M
0 5 10 20 Centimetres AMENDMENT ISS DATE APPD			GBW 14390 SHT.13		

FIG.3A
PG. ALARM

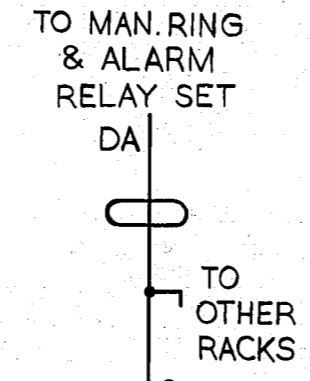


FIG.3B
1 PER RACK

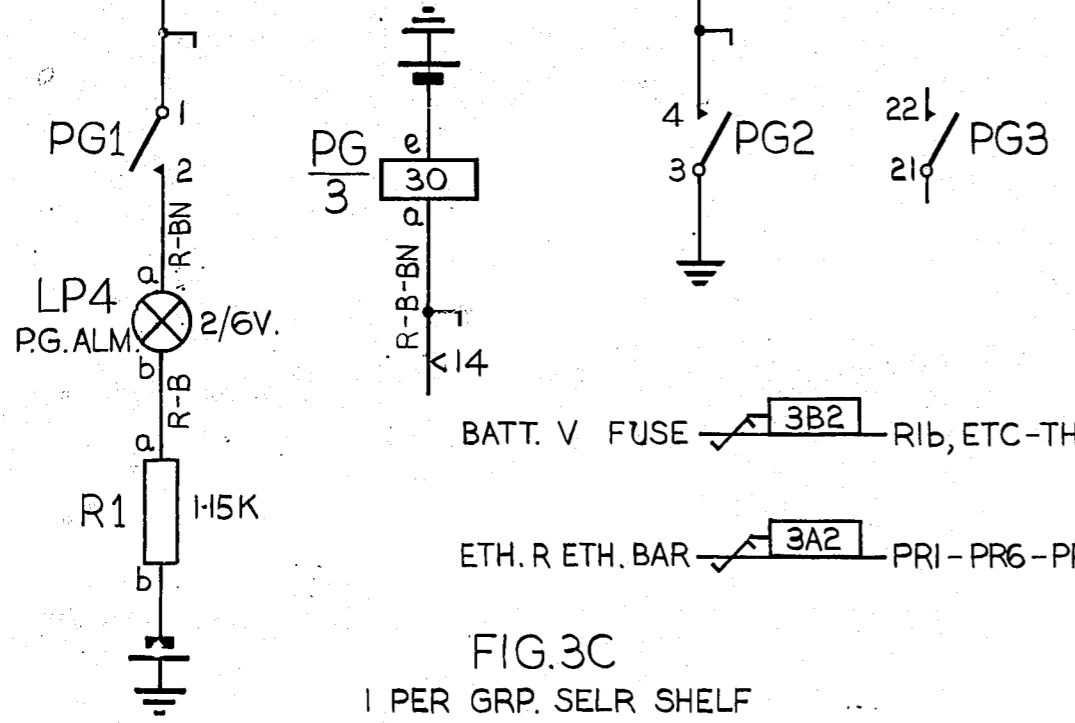
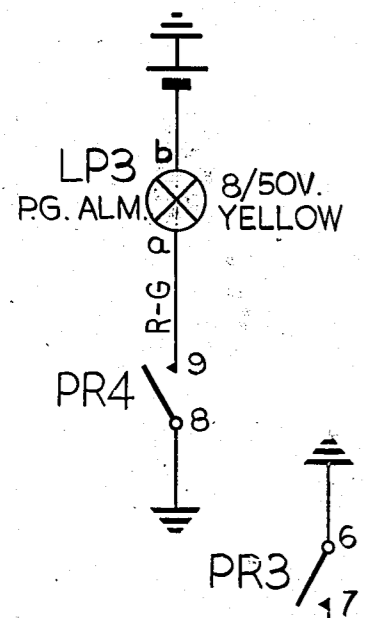
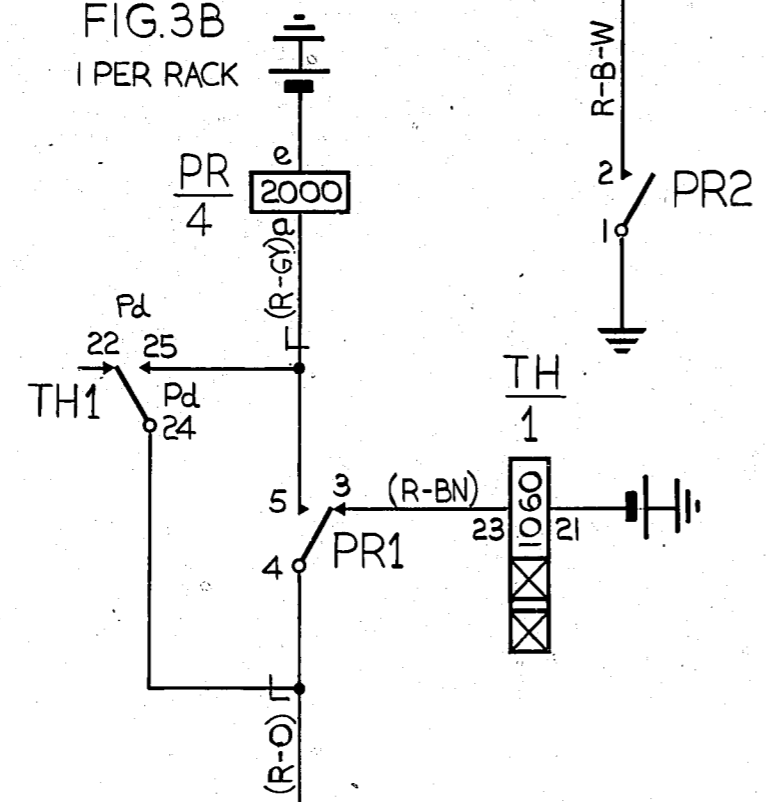


FIG.3C
1 PER GRP. SELR SHELF

FIG.4
BATT. JACKS
1 PER RACK



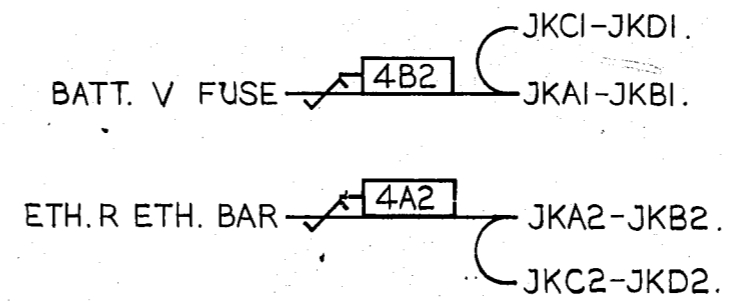


FIG.5A
BUSY TONE (ETH) DISTN.
TO PULSE REL. SET

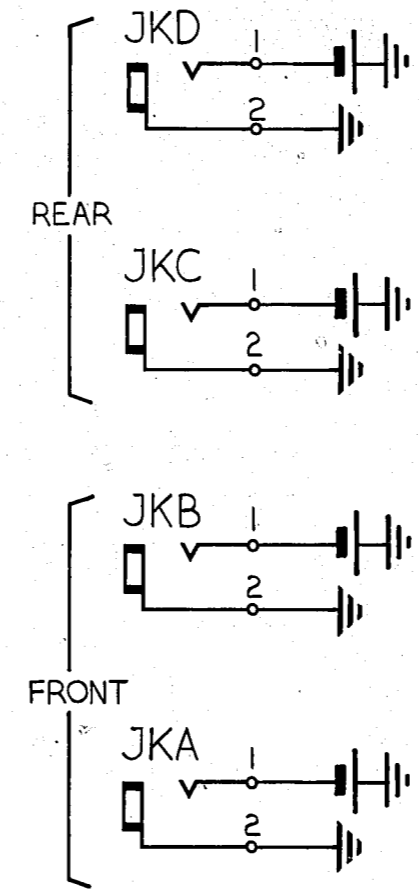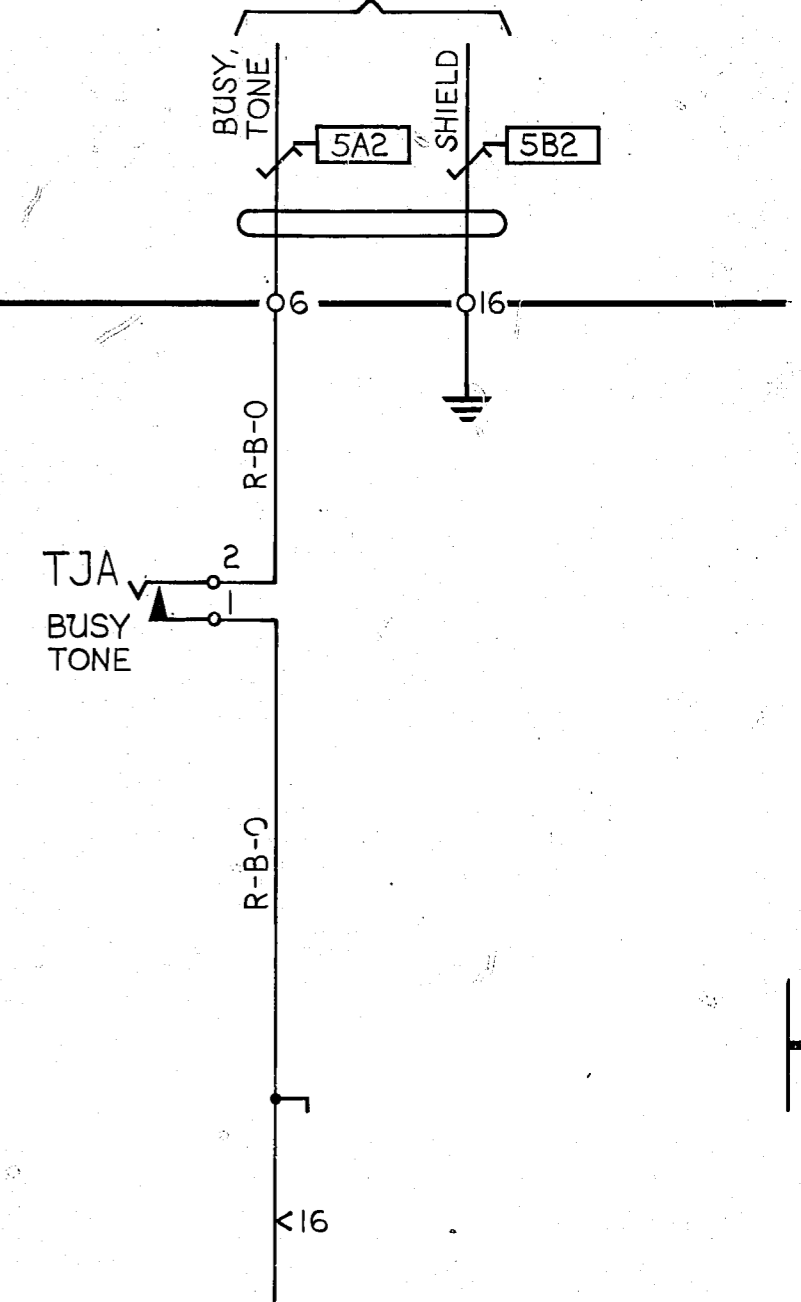

ETH. R ETH. BAR ——— TAG 16-TAG18 FIG.6B

FIG.5B
1 PER RACK

A2	DRAWN	ENGR.
	CKD.	CCT.
A3		

COMMON SERVICES
RACK WIRING
2ND. OR I/C. GRP. SELR. RACK
50/1200 LINE P.A.B.X.

REFERENCES	50V W
NZPO	SIZE M

GBW 14390 SHT.2


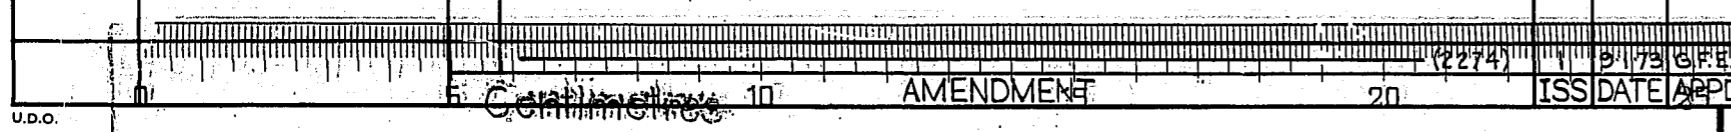


FIG. 6A
DIAL TONE (EARTH)
DISTRIBUTION

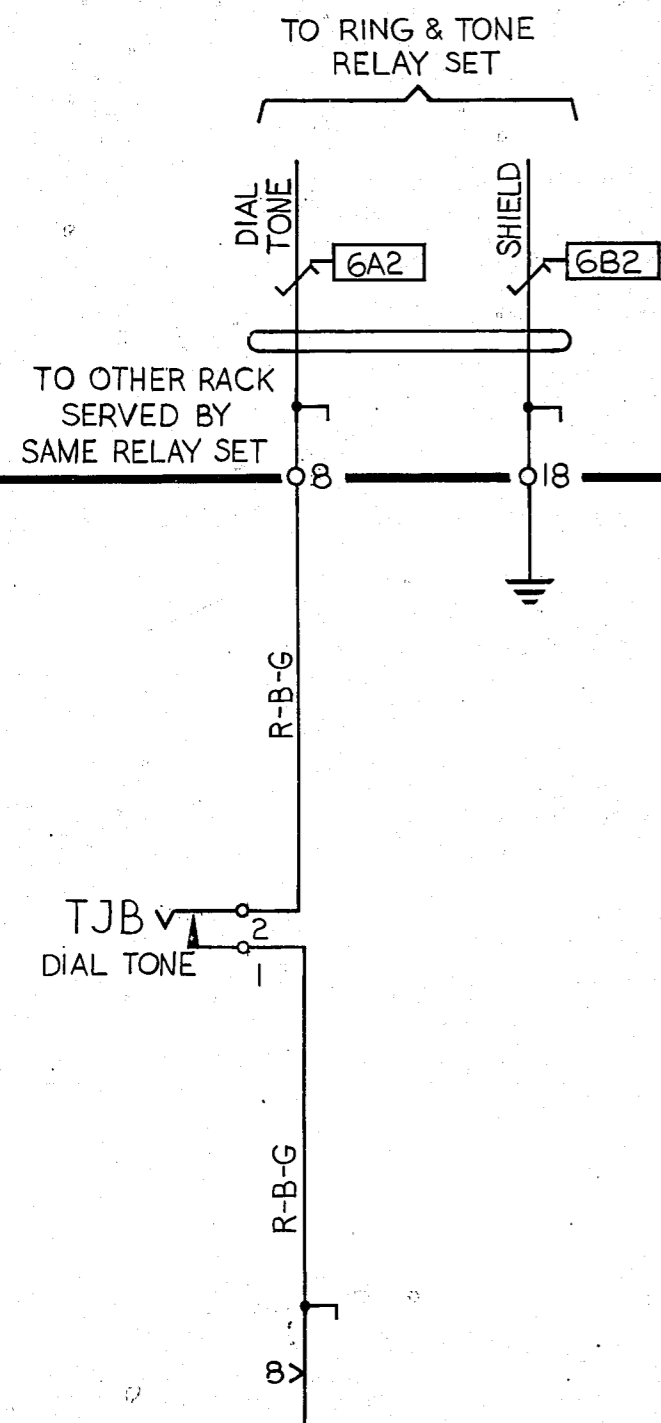

ETH.— SEE FIG. 5B.

FIG. 6B
1 PER RACK

FIG. 7A
RING START

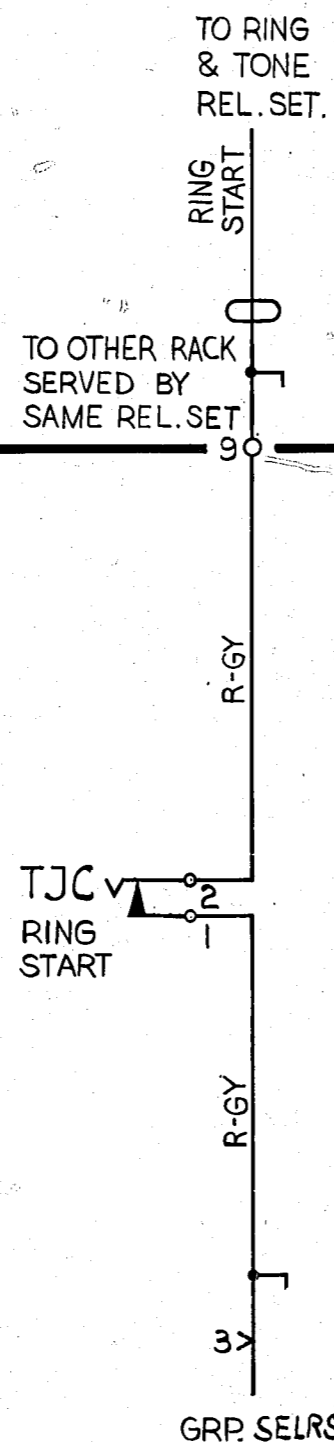


FIG. 7B
1 PER RACK

FIG. 8
GRP. SELR. ROUTINE TEST JACK,
1 PER RACK

ALL WIRING IN THIS FIGURE TO BE 0.5mm.
TO NEXT RACK.
(NOTE 4)




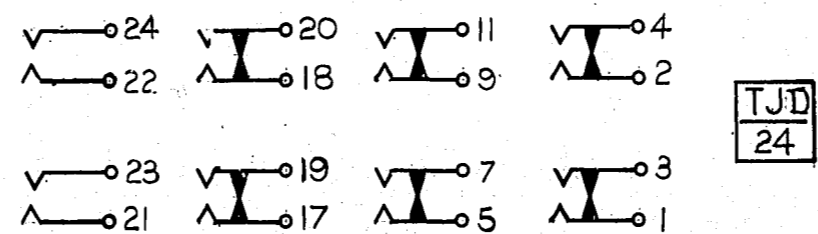


FIG. 9
METHOD OF WIRING
TEST JACKS IN SERIES
WIRING OF 20H SHOWN
20+, 20- & 20L TO BE
WIRED SIMILARLY.

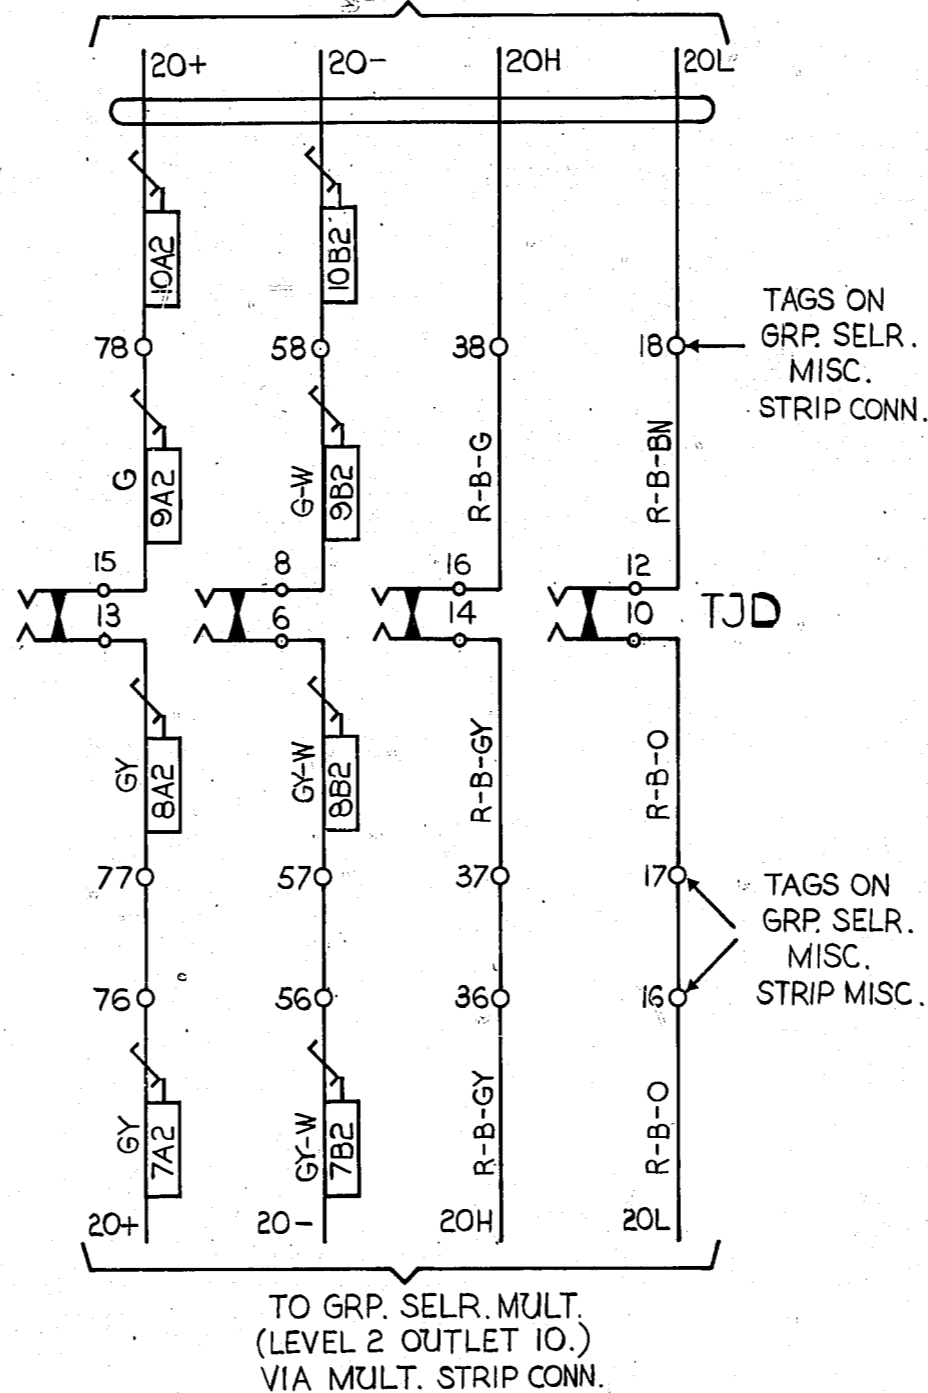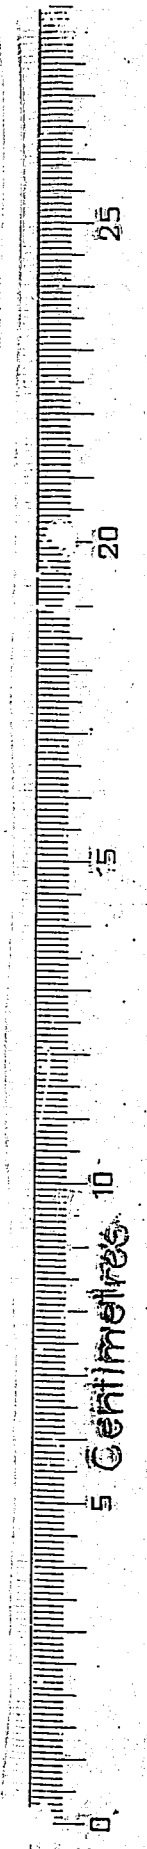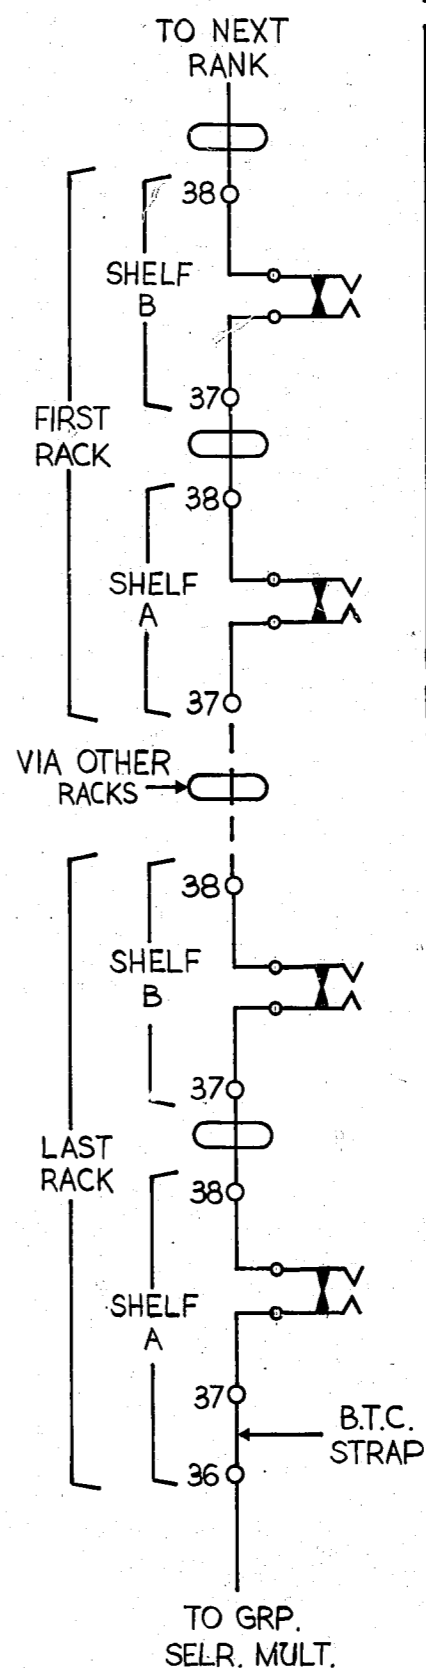

A2	DRAWN B.W.H. CKD.	ENGR. V.H.R. CCT
A3		
DM 5		

AMENDMENT		(2274)	1	9-1-73	G.F.E.
				ISS.	DATE/APPD

COMMON SERVICES
RACK WIRING
2ND OR I/C. GRP. SELR. RACK
50/1200 LINE P.A.B.X.

REFERENCES	50V W
NZPO	SIZE M
GBW 14390 SHT.3	