NOTES:-

1 FUSING 1·5A PER CCT. FIGS.(1&2)

2 FINDER BANK OUTLETS 1-6 ARE CONNECTED TO FINAL SELECTOR CIRCUITS 1-6 RESPECTIVELY.

3 ALL WIRE UNLESS OTHERWISE SPECIFIED TO BE 23 S.W.G. LOCAL PLATE & BANK WIRING TO BE 25 S.W.G.

4 SHELF JACK U POINTS 9 & 11 MAKE CONTACT WHEN RELAY SET IS REMOVED.

5 ø FOR WIRING SEE

N.Z.P.O. NOTE

A. WHEN THIS RELAY SET IS USED IN A REMOTE N.Z.13R OR N.Z.13RM U.N.T TO TERMINATE AN INCOMING, UNIDIRECTIONAL OR BOTHWAY JUNCTION, EARTH IS TO BE CONNECTED TO U POINT 8 AND THE LINK REMOVED FROM TJ13 AND 14.

FIG. 1

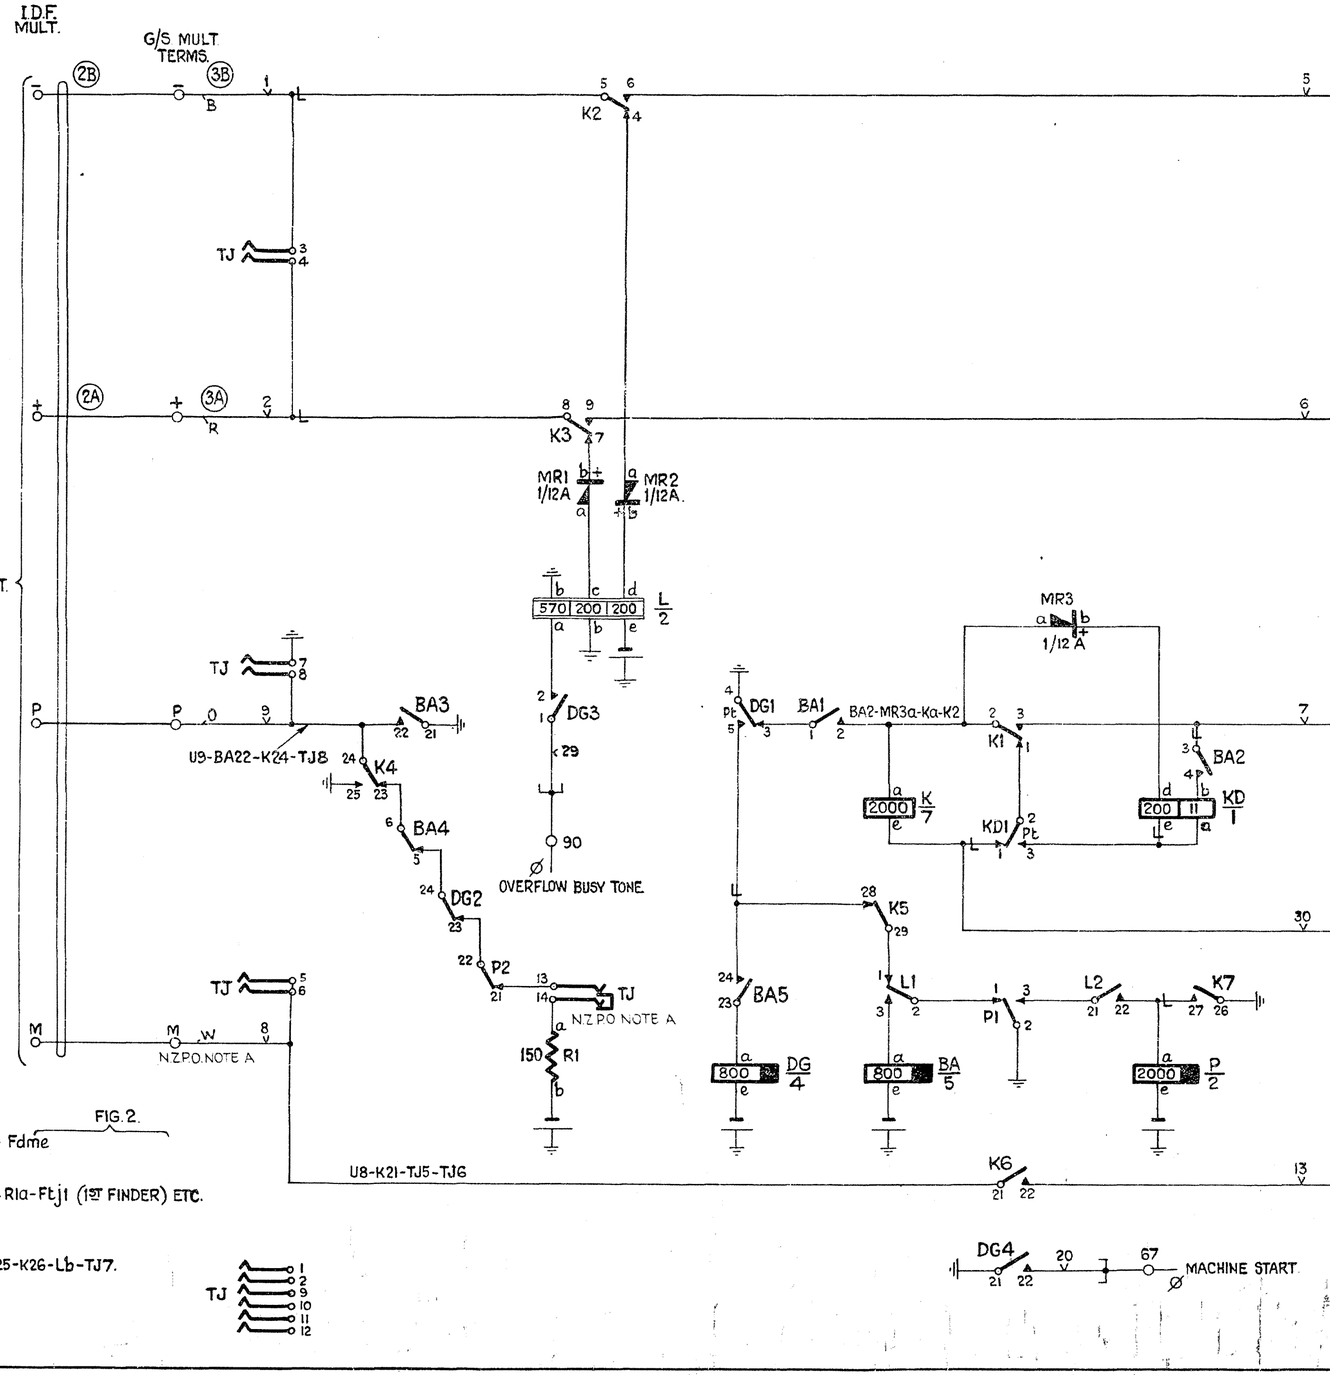

FIG. 2.

SUPERSEDED BY GBW.13680 FOR NEW WORK.

NZPO	AMENDMENT PARTICULARS	ISSUE	DATE	APPD
	N.Z.P.O. NOTE A ADDED (13939) (66261)	1	1A 82·256	17·770 CAH JCW

SLOW RELEASE

SLOW OPERATE

INCOMING JUNCTION RELAY SET CIRCUIT U.AX. N.Z. 13 R.

GEC 705019 SIZE: M 50V C

GBW 14500

GBW 14500