


5 Centimeters 10 15 20 25 30 35 40 45 50 55

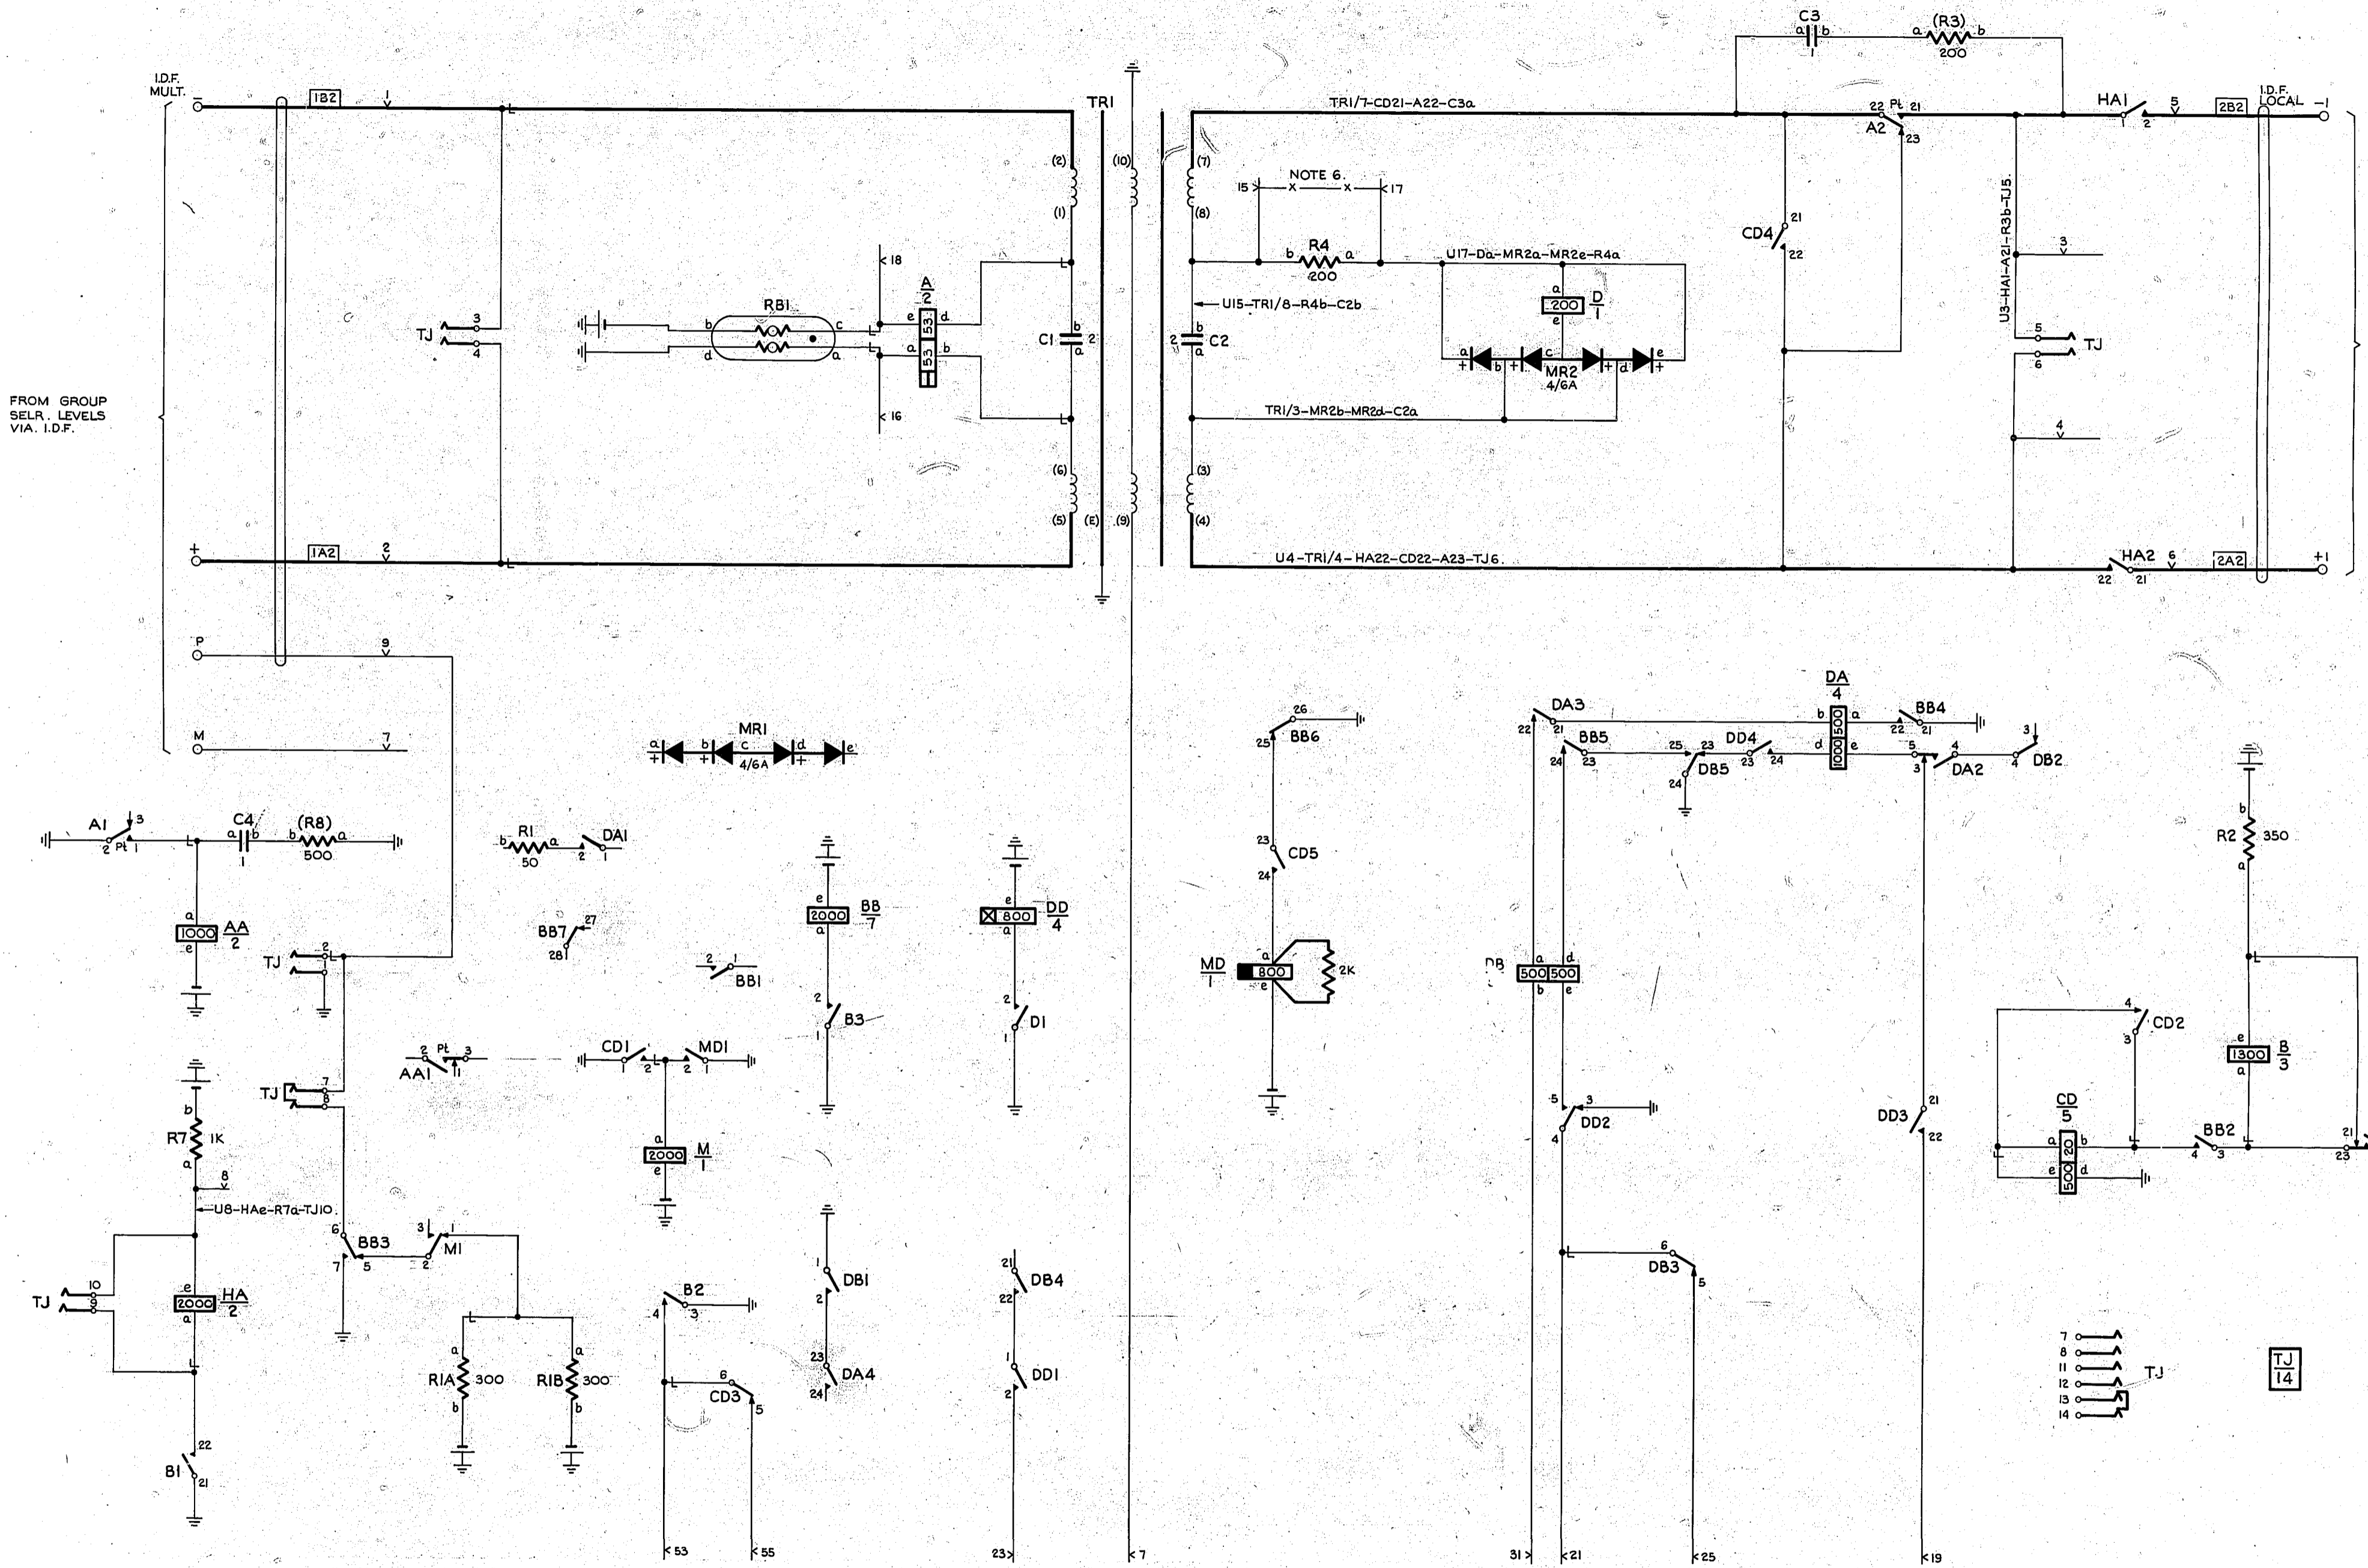

FROM GROUP SELR. LEVELS VIA I.D.F.

TO JUNCTION OR GROUP SELR. AS REQUIRED.

NOTES:-

1. FUSING 1.5A PER RELAY SET
2. JACK POINTS U9 & U11 MAKE CONTACT WHEN THE RELAY SET IS REMOVED.
3. ALL WIRING TO BE 25 SWG. UNLESS OTHERWISE STATED.
4. CUT STRAP—X—WHEN THE JUNCTION RESISTANCE IS LESS THAN 200Ω.

BATT. BK FUSE 22 SWG 3B2 UI2  
ETH. R. ETH. BAR 3A2 UI1

BATT. W UI2-Me-MDe-DDe-BBe-AAe-R2b-RB1b-RIAa-R1Ba-R7b.

EARTH R. UI1-TRI/IO-TRI/E-DB24-DB1-MDI-DI-DD3-Cdd-CD1-BB7-BB21-BB26-B21-B1-B3-AA22-AA3-A2-R8a-RB1d-TJ1.

MOD. FOR USE AS GBW 16831

SLOW RELEASE
  SLOW OPERATE

AUTO-AUTO RELAY SET  
UAX TO UAX  
UAX TO PARENT EXCHANGE  
SUBSCRIBERS DIALING

PREPARED FROM GBW 14610 ISS. 3 OF 1622	735
TITLE CHANGED. (68482)	
AMENDMENT PARTICULARS.	ISSUE DATE APD. REF: ESIC2 PARA. 8.0 SIZE A1 50v. W
NZPO	DRAWN CHECKED WIRING CIRCUIT
14610 MOD.A GBW	