

FIG. 1A
M.A.R. CONTROLLED EXCHANGE

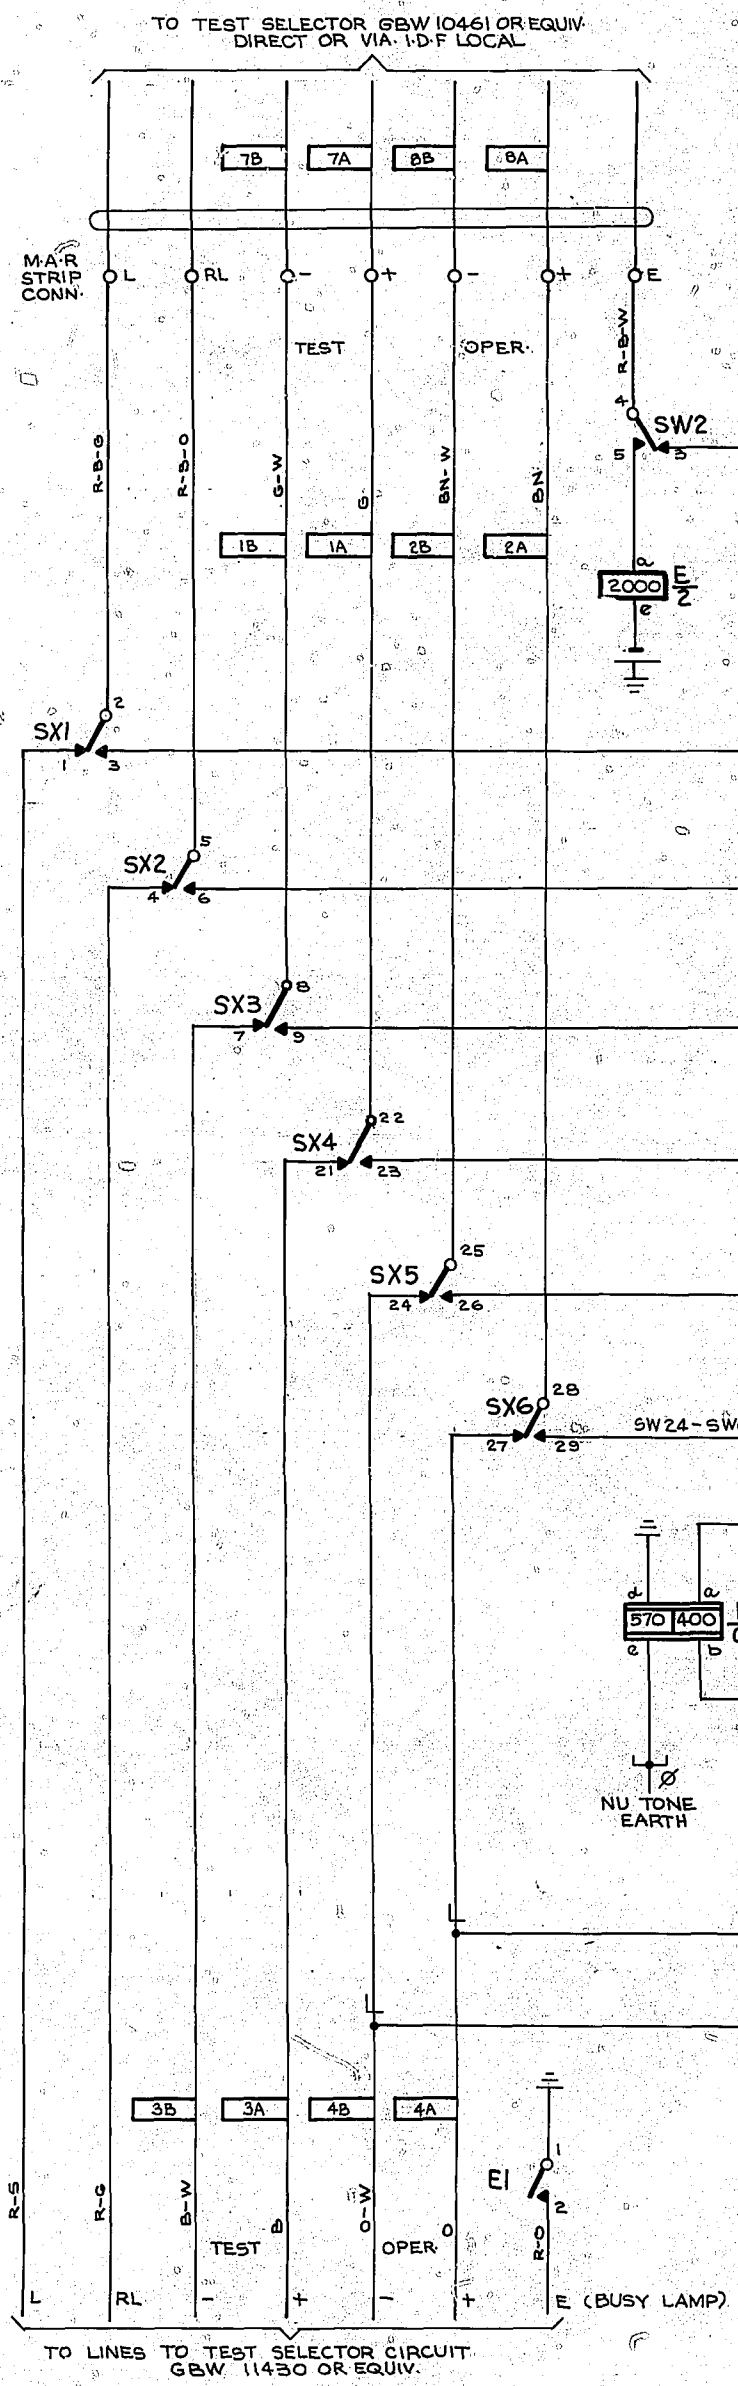


FIG. 1B
TEST DESK OR TEST RACK

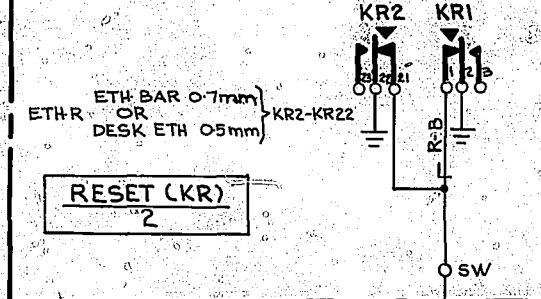


FIG. 2A
M.A.R. INTERMEDIATE CONTROLLING EXCHANGE



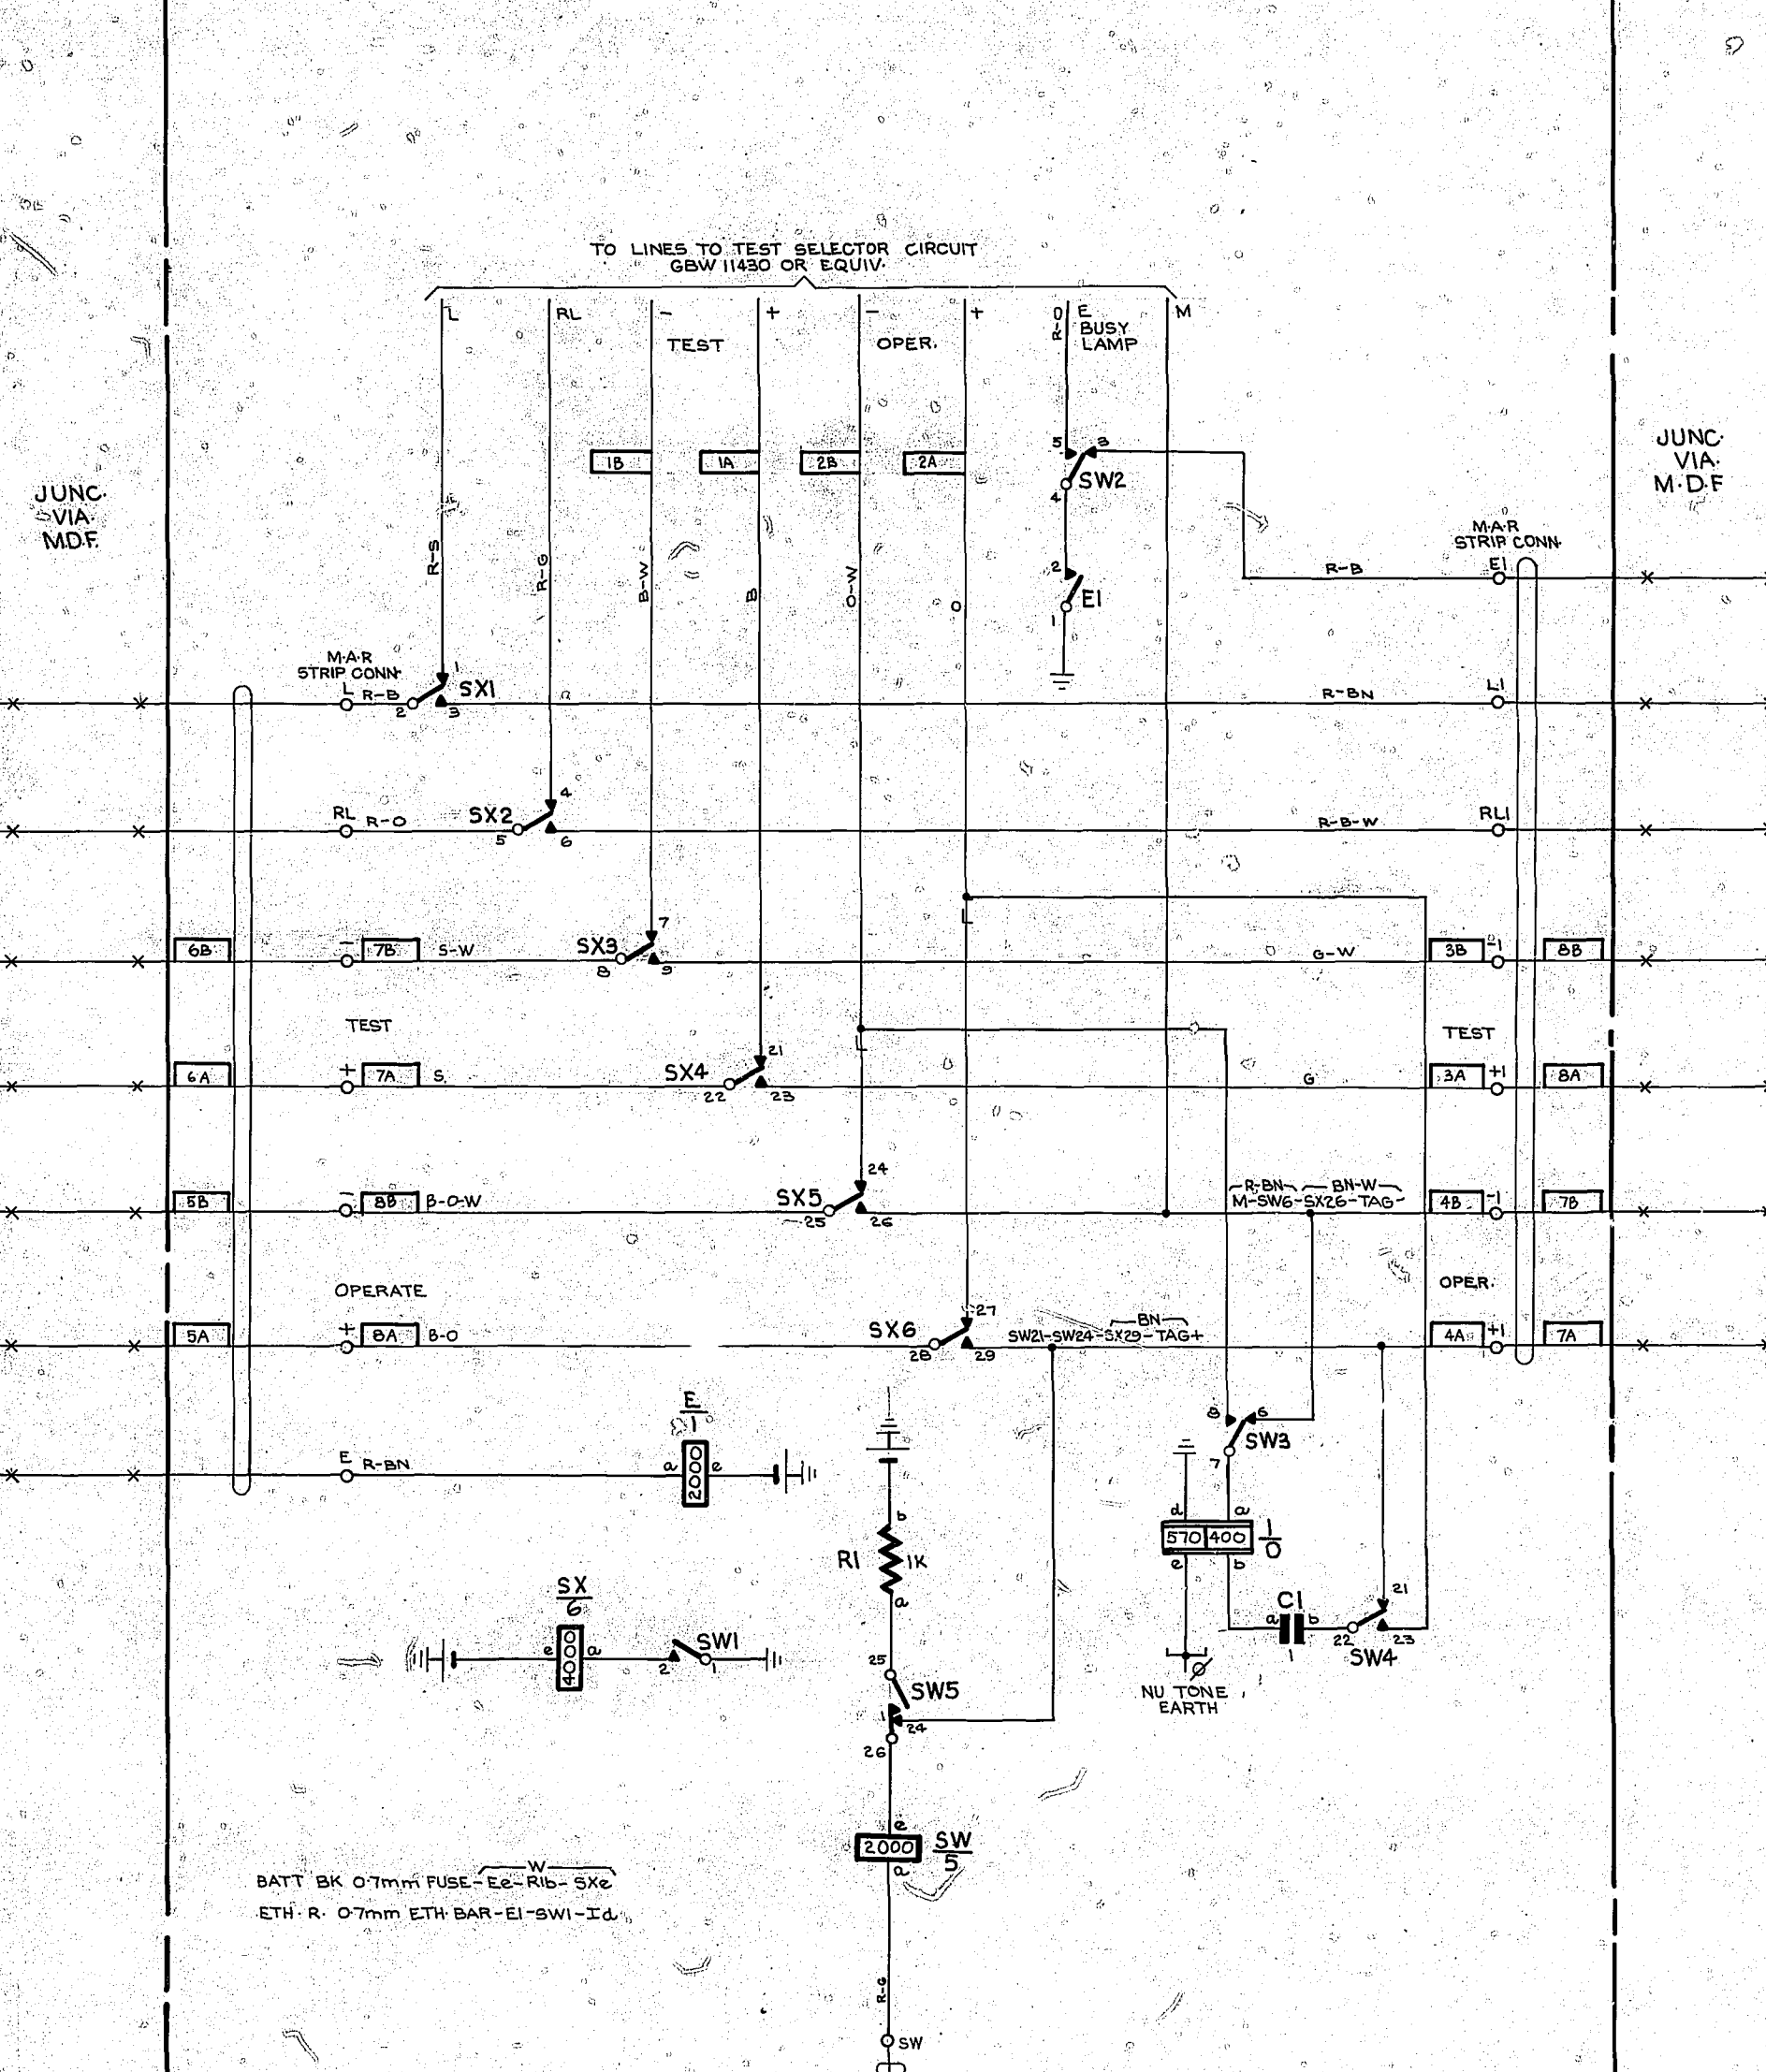


FIG. 3
M.A.R. TERMINAL CONTROLLING EXCHANGE

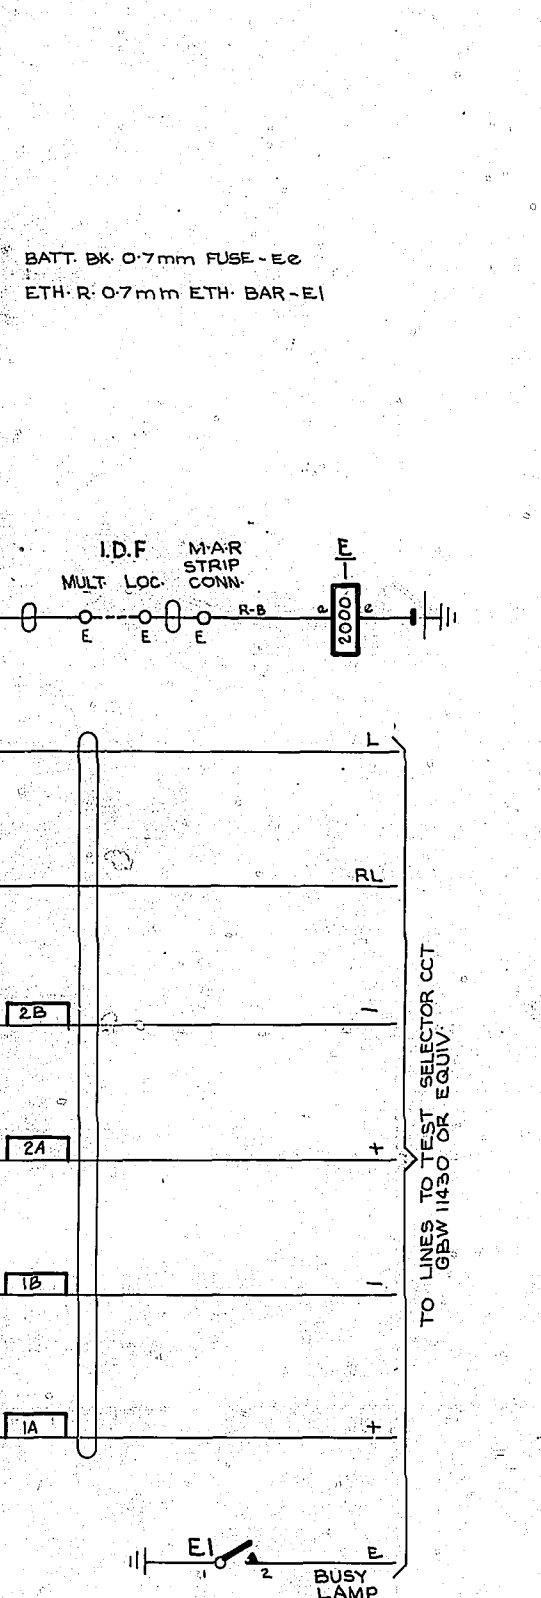

NOTES:
1. FUSES: FIG. 1A, FIG. 2A & FIG. 3 FUSED WITH ASSOCIATED LINES TO TEST SELR. CCT.
2. Ø FOR WIRING SEE GBW 10690 OR EQUIV.
3. ALL WIRING TO BE 0.5mm UNLESS OTHERWISE SPECIFIED.

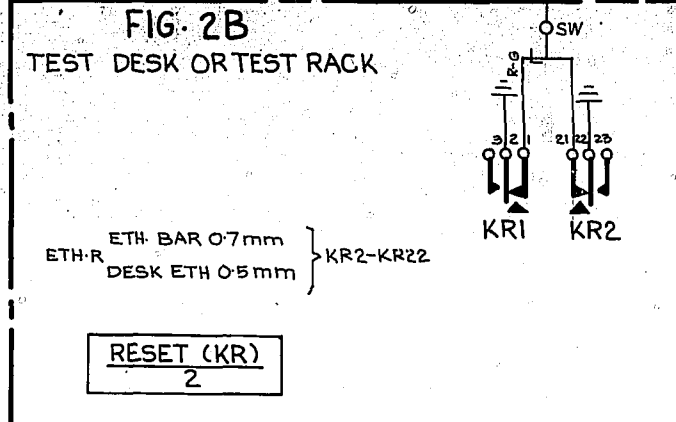

SWITCHING FOR TRANSFER OF CONTROL OF TEST SELECTOR TO INTERMEDIATE OR CENTRAL EXCHANGE

PROOF

50V M	ISS	DATE	DEL	DC	ORDER	CKD	APP	CHANGE
DRN: T-EQPT	CKD	ORIGIN: T-EQPT						
TCD: M-K	APPD	STANDARD: ATW 22001						
ENGINEER-IN-CHIEF, WELLINGTON								
SHT 1 OF 1		GBW 15320						
SIZE A1								

UD 237

Centimetres