

40

35

30

25


20

15

10

5

Centimetres

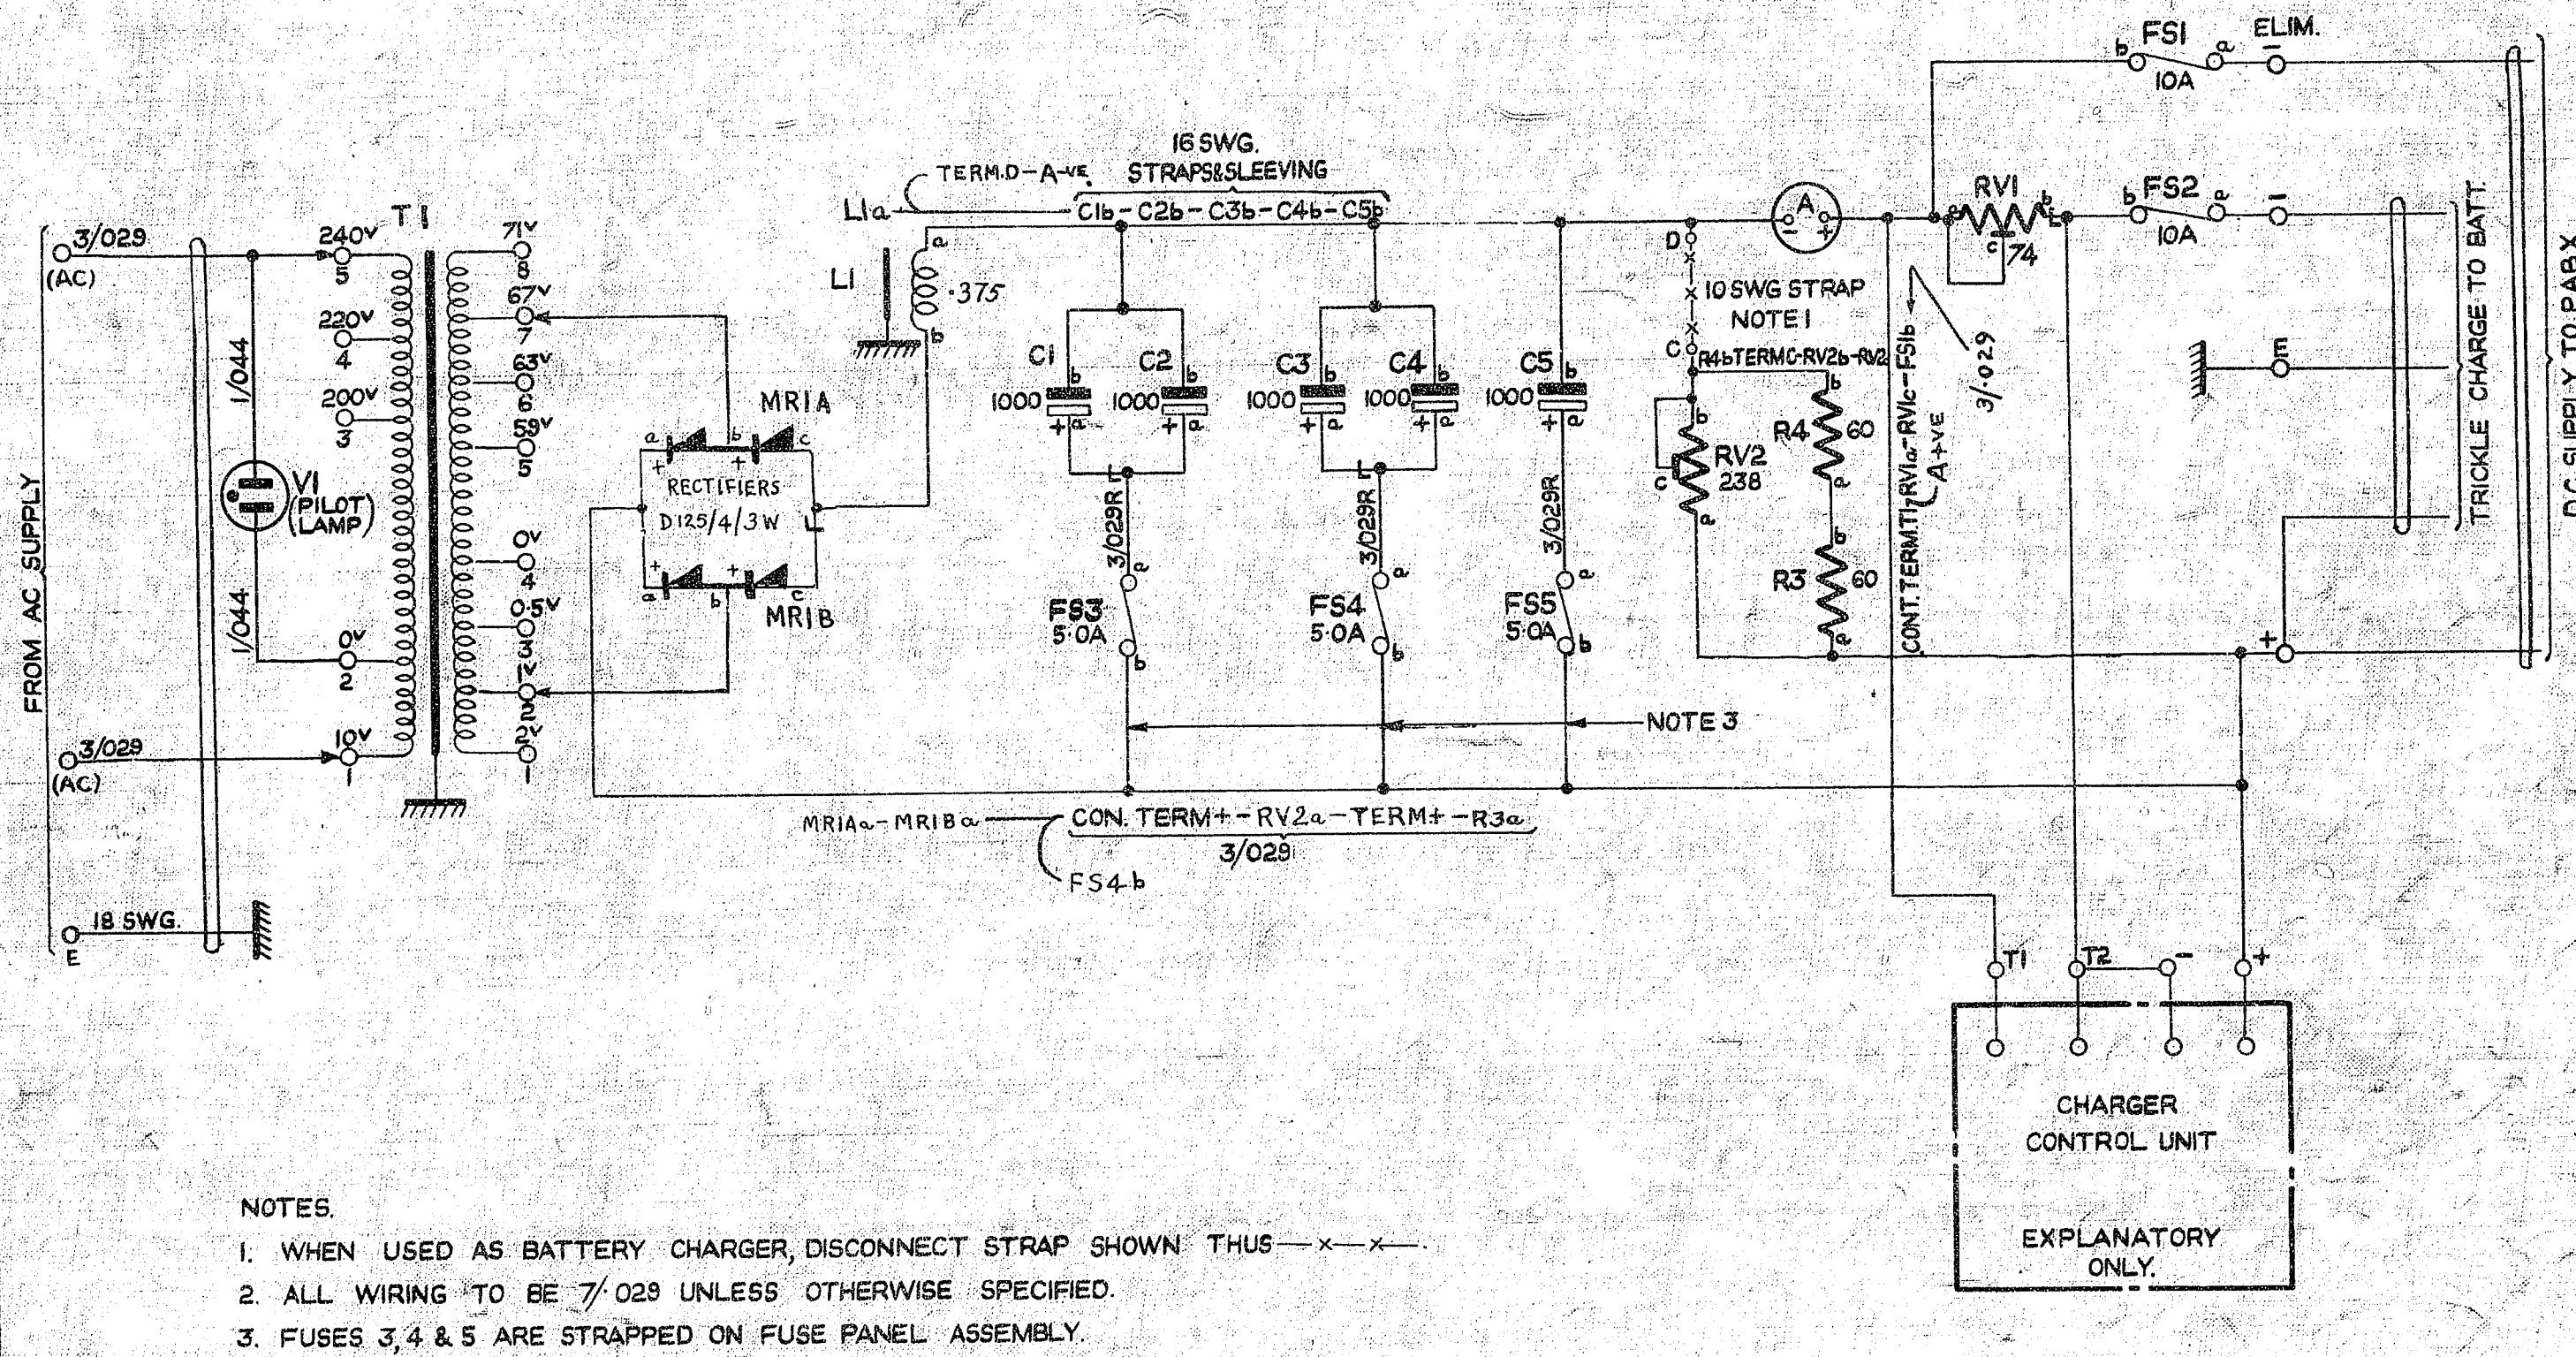

SUPERSEDES GBW 15470  
SUPERSEDED BY GBW 15490

7.5 AMP.  
BATTERY ELIMINATOR  
FOR 120A AND 135A TYPE  
P.A.B.X.S

(3321)	I	18.3.60	J.C.
AMENDMENT	PARTICULARS	ISSUE DATE	APPD REF.-22 LFE 1387A 50V W
NZPO	DRAWN CHECKED	WIRING CIRCUIT	SIZE : S
			GBW 15480