


0
5 Centimetres
10
15
20
25
30

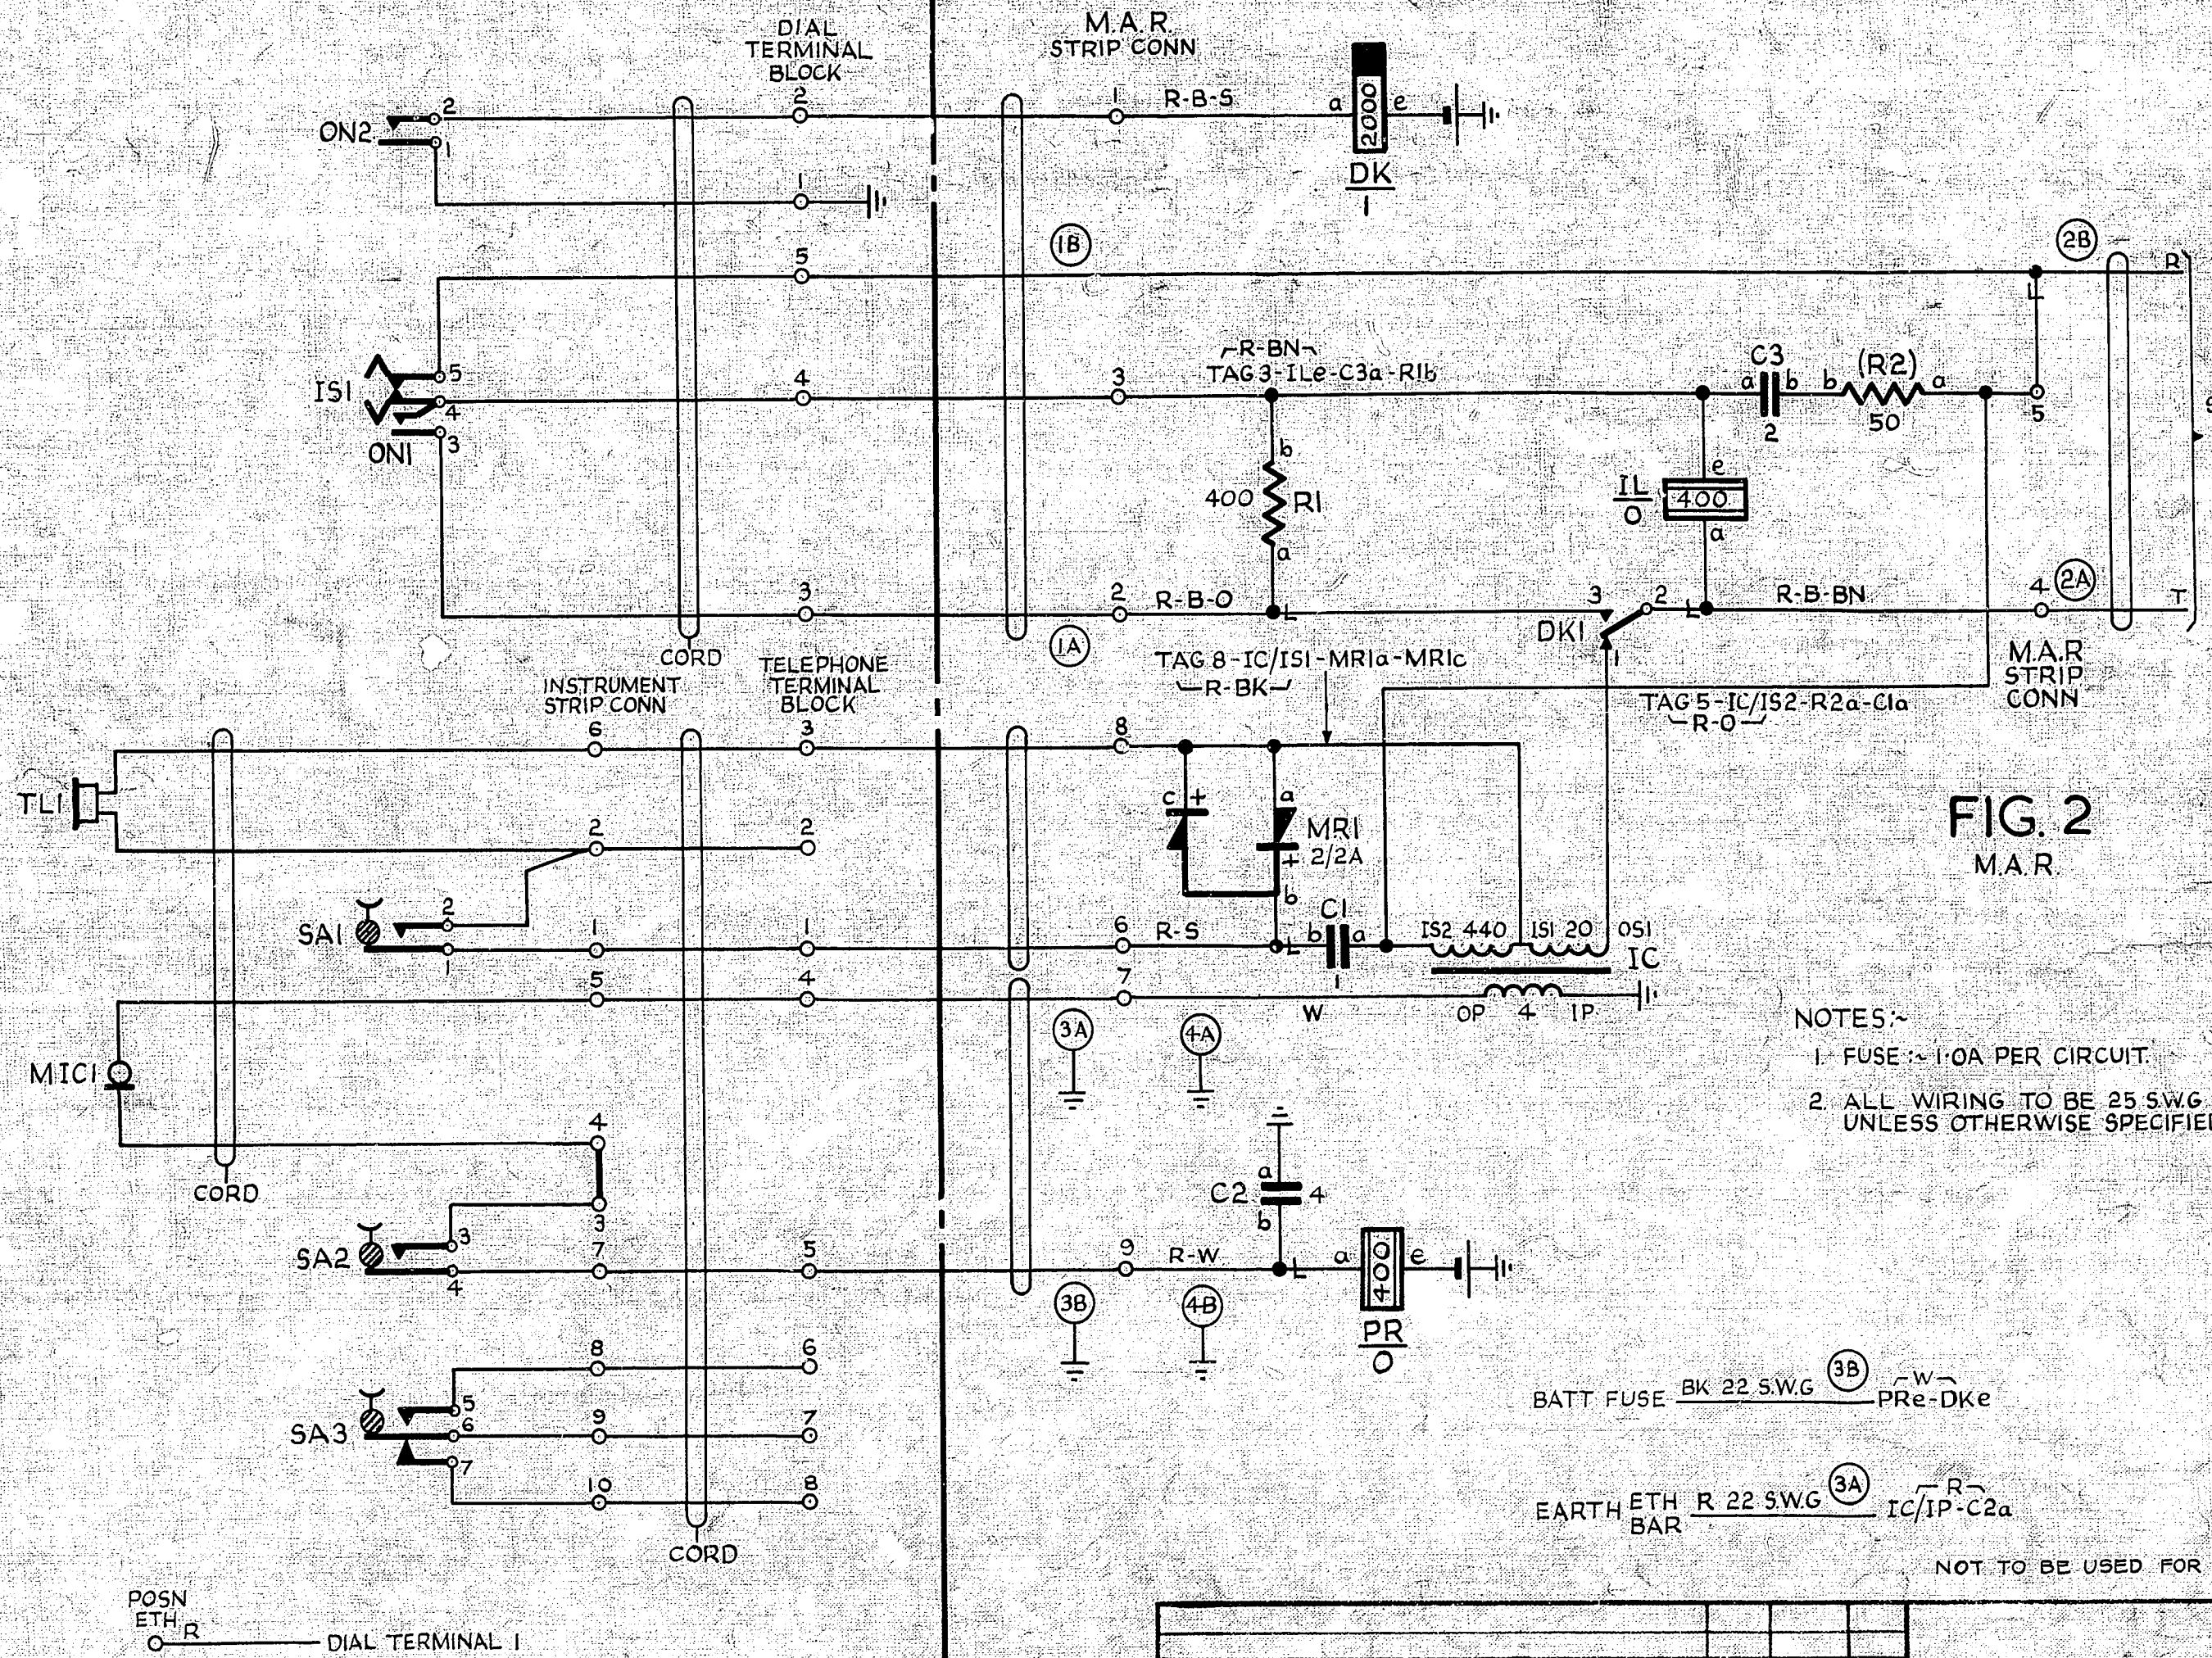

TO SUPERVISOR'S DESK
GBW/12960
FIG. 1
OR EQUIV.

FIG. 2
M.A.R.

- NOTES:-
1. FUSE :- 1.0A PER CIRCUIT.
 2. ALL WIRING TO BE 25 SWG UNLESS OTHERWISE SPECIFIED.

BATT FUSE BK 22 SWG (3B) $\overline{R-W}$ PRe-DKe

EARTH ETH BAR R 22 SWG (3A) \overline{R} IC/IP-C2a

NOT TO BE USED FOR NEW WORK

FIG. 1
TELEPHONE CIRCUIT
SUPERVISOR'S DESK
OR EQUIV

				SUPERVISORS DESK POSITION CIRCUIT	
NOTE RE "NOT TO BE USED FOR NEW WORK" ADDED (4870)				2	9.2.62
(4870)				1	25.1.62
AMENDMENT PARTICULARS			ISSUE	DATE	APPD REF.
N.Z.P.O.			GS	N.P.A. 26/1/61	N.P.A.
			DRAWN	CHECKED	WIRING CIRCUIT
			GS	N.P.A. 26/1/61	N.P.A.
GBW/15950					SIZE: S
					50' H