


ID.F
MULT OR LOCAL
(WHEN SPEC'D)

ID.F
LOCAL

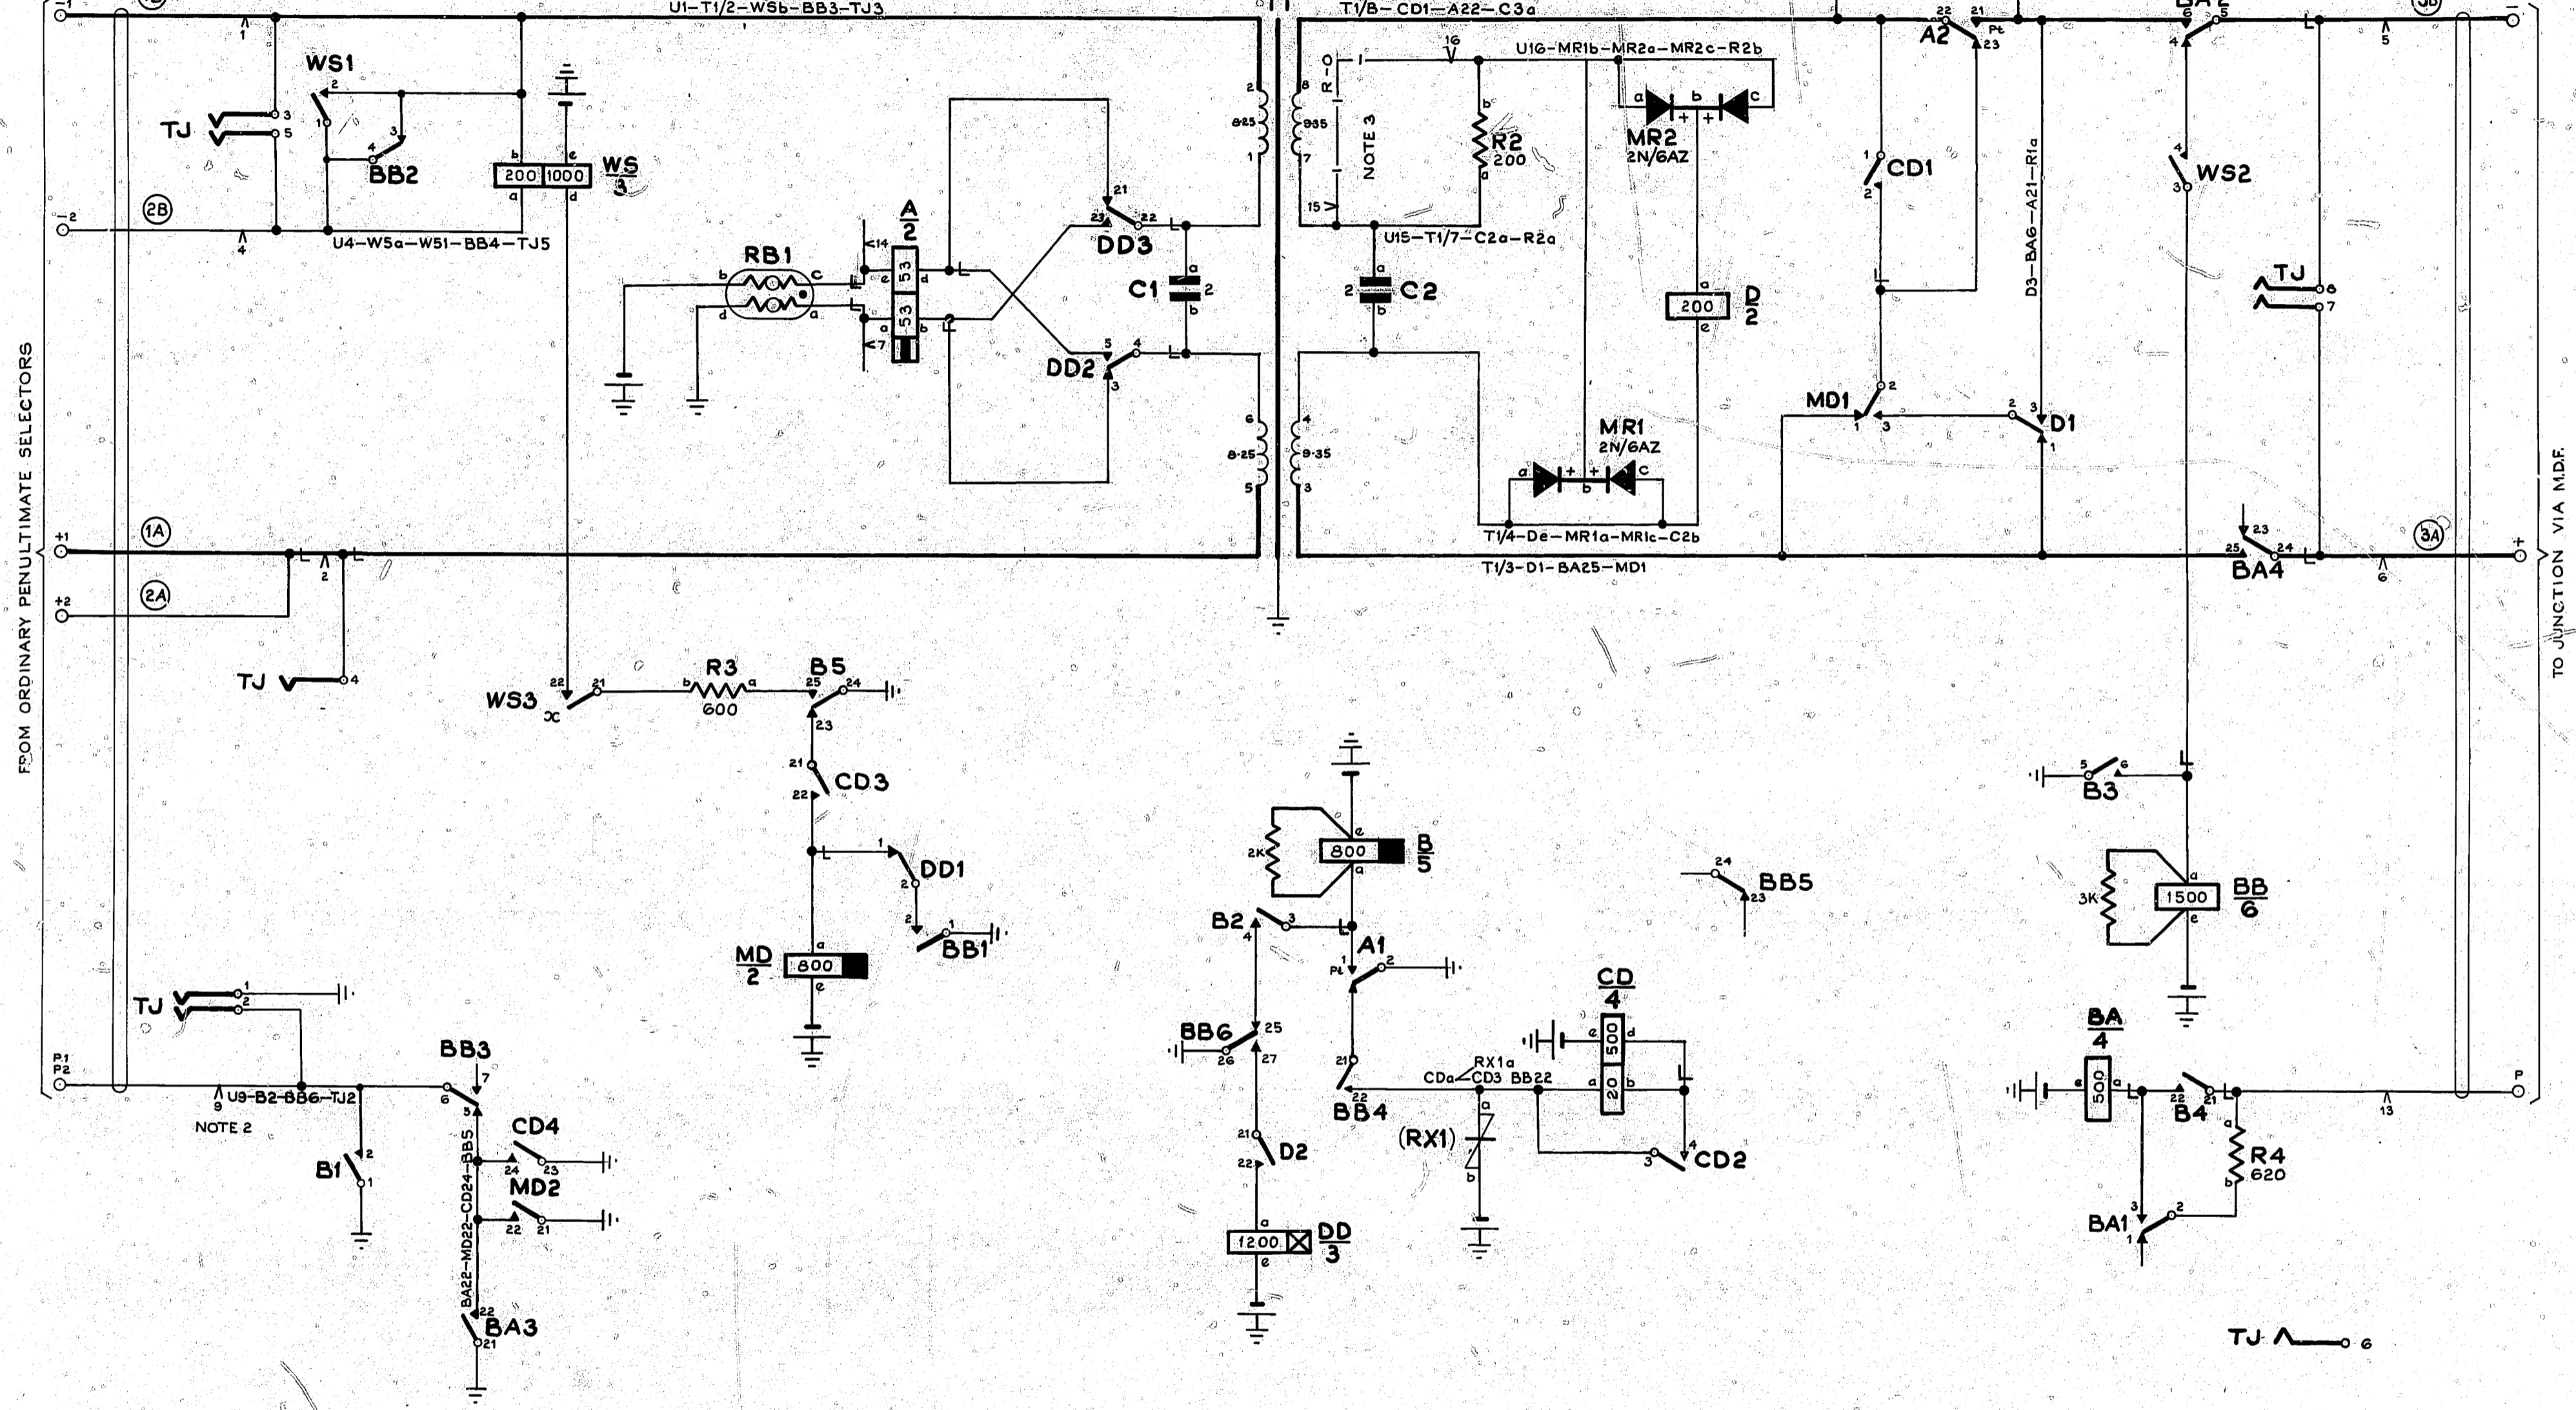

FROM ORDINARY PENULTIMATE SELECTORS

TO JUNCTION VIA MDF.

NOTES:

1. FUSING 1.5A PER CCT.
2. SHELF JACK U POINTS 9&11 MAKE CONTACT WHEN RELAY SET IS REMOVED.
3. WHEN JUNCTION RESISTANCE IS LESS THAN 200Ω REMOVE STRAP SHOWN
4. ALL WIRING TO BE 0.5mm SWG UNLESS OTHERWISE SPECIFIED.

BATT. BK 0.7mm SWG FUSE ⁴⁹U12
 ETH. R 0.7mm SWG. ETH. BAR ^{4A}U11
 BATT. W U12-Bc-BAe-MDe-RB1b-W5e-DOe ^{RX1b}CDe-BBe
 EARTH R U11-T1E-B24-B1-B5-BA21-MD21-CD23-BB26-
 BB1-A2-RB1d-TJ1

TJ
8

PROOF

				AUTO TO AUTO RELAY SET OUTGOING TO SATELLITE EXCHANGE ORDINARY FINAL SELECTOR 2000 TYPE			
RETRACED FROM ISS 1 OF 7-12-62		(17003)	1A	3-12-79			
		(50511)	1	7-12-62		DBH	
AMENDMENT PARTICULARS				ISS	DATE	ADD	RO. DGM
				20186			SIZE: A2 50 V E
N.Z.P.O.		DRAWN		CHECKED		WIRING	
		E.U.				CIRCUIT	
GBW 16250							