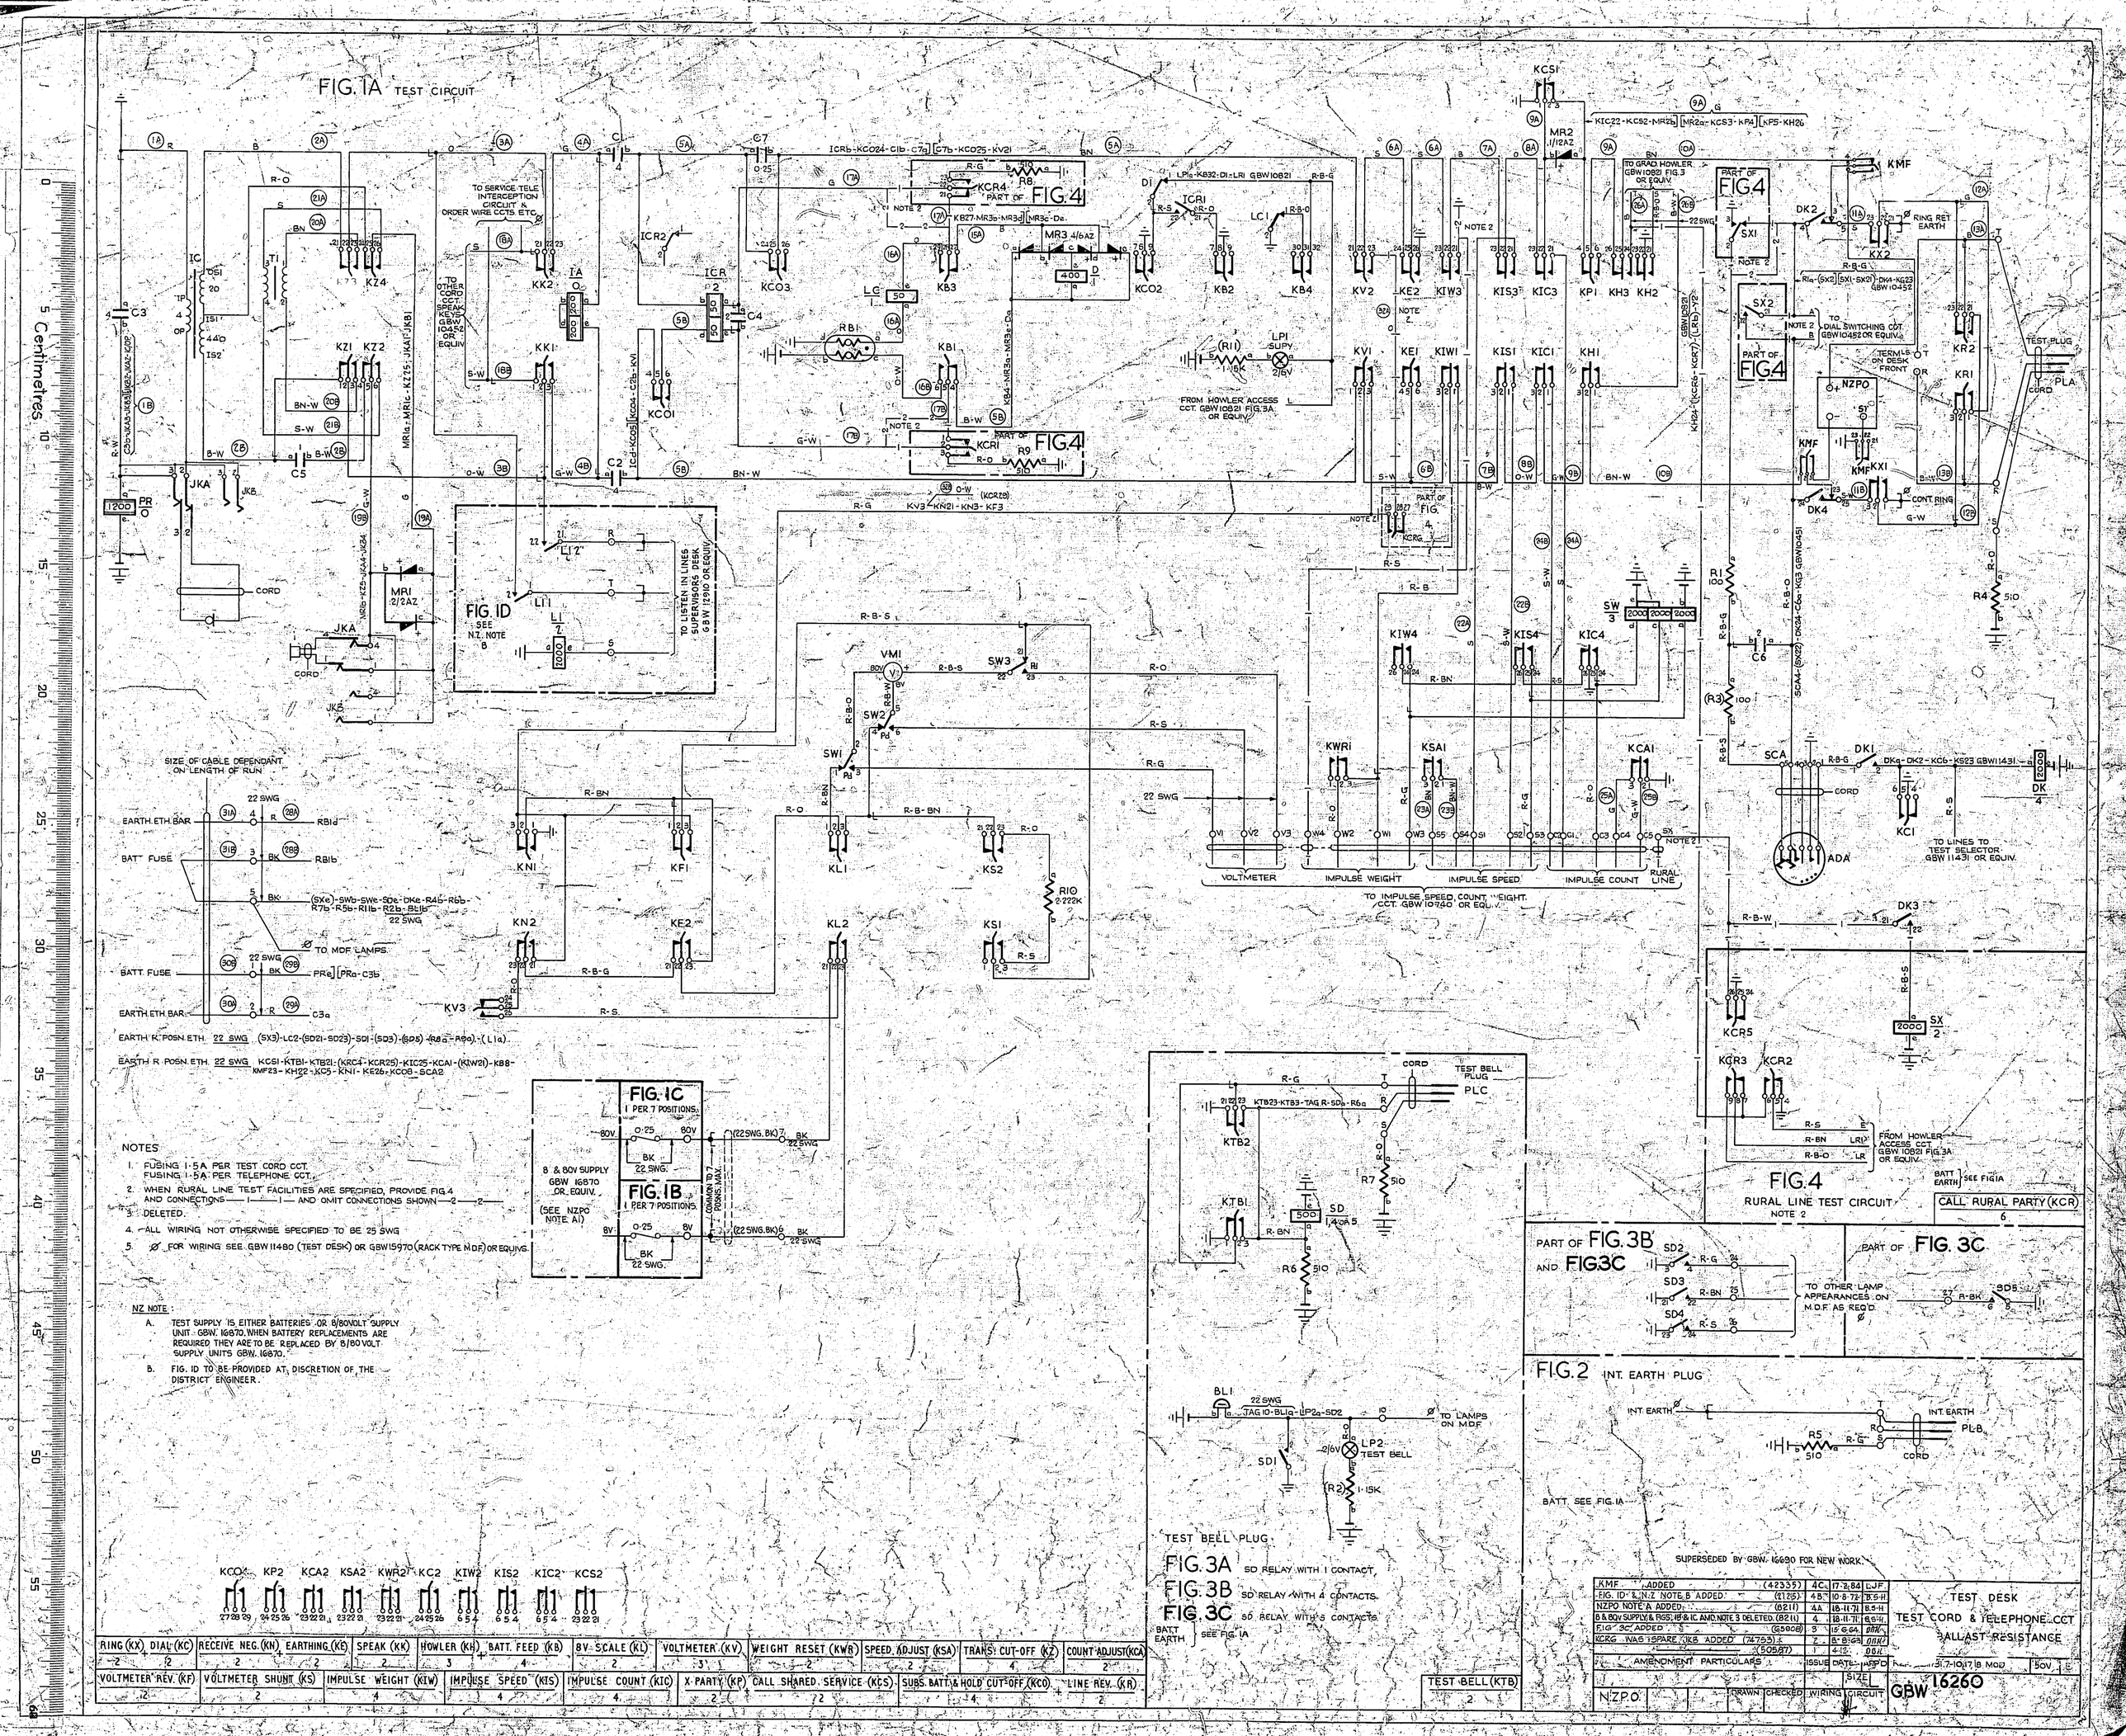
FIG.1A TEST CIRCUIT
FIG.1B
FIG.1C
FIG.1D
FIG.2 INT. EARTH PLUG
FIG.3A SD RELAY WITH 1 CONTACT
FIG.3B SD RELAY WITH 4 CONTACTS
FIG.3C SD RELAY WITH 5 CONTACTS
FIG.4 RURAL LINE TEST CIRCUIT
NOTES
1. FUSING 1·5A PER TEST CORD CCT. FUSING 1·5A PER TELEPHONE CCT.
2. WHEN RURAL LINE TEST FACILITIES ARE SPECIFIED, PROVIDE FIG.4 AND CONNECTIONS —1—1— AND OMIT CONNECTIONS SHOWN —2—2—
3. DELETED.
4. ALL WIRING NOT OTHERWISE SPECIFIED TO BE 25 SWG
5. Ø FOR WIRING SEE GBW11480 (TEST DESK) OR GBW15970 (RACK TYPE M.D.F.) OR EQUIVS.
NZ NOTE:
A. TEST SUPPLY IS EITHER BATTERIES OR 8/80VOLT SUPPLY UNIT GBW. 16870. WHEN BATTERY REPLACEMENTS ARE REQUIRED THEY ARE TO BE REPLACED BY 8/80 VOLT SUPPLY UNITS GBW. 16870.
B. FIG. ID TO BE PROVIDED AT DISCRETION OF THE DISTRICT ENGINEER.
TEST DESK
TEST CORD & TELEPHONE CCT
GBW 16260