

FIG. 1. M.A.R.

NOTE 3


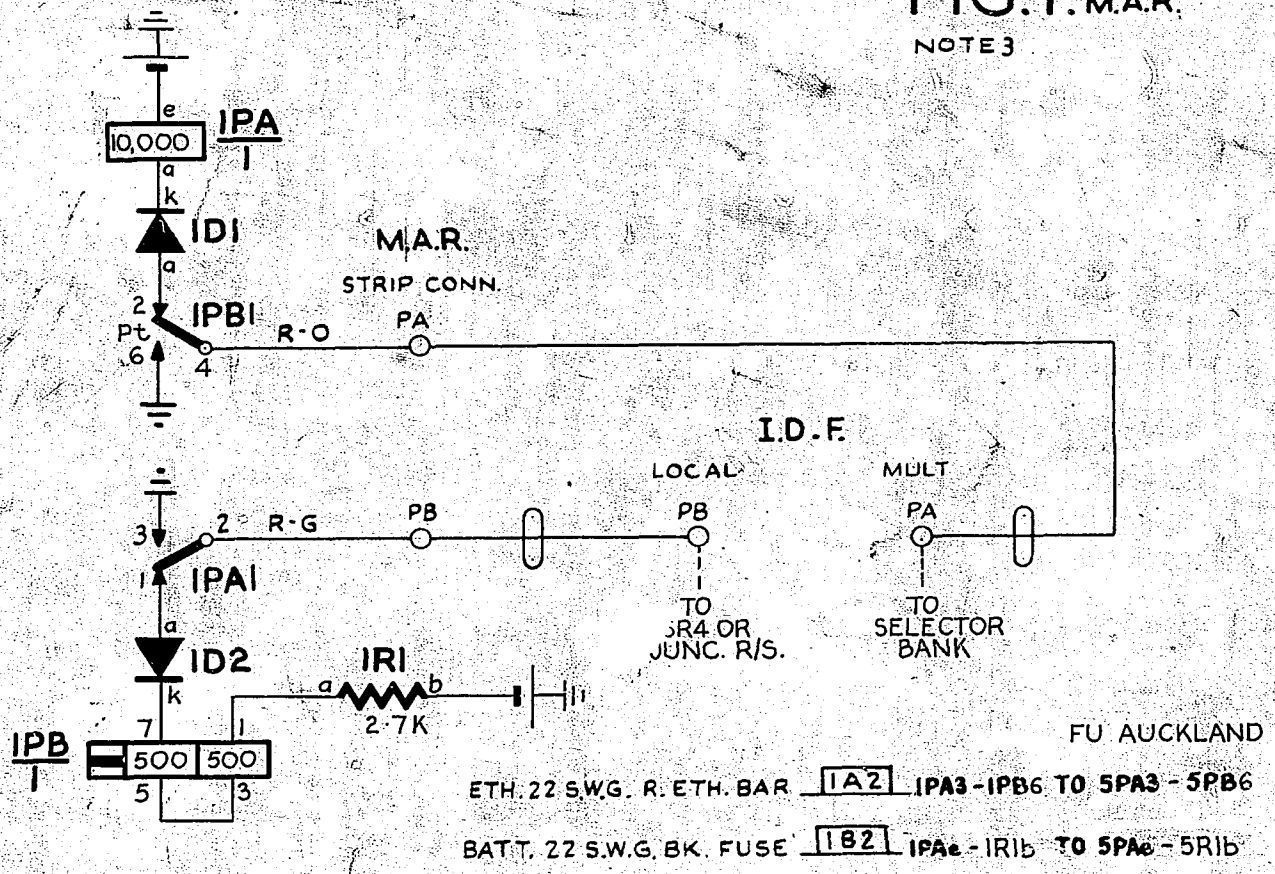


FIG. 2. R.S.R.

NOTE 3.

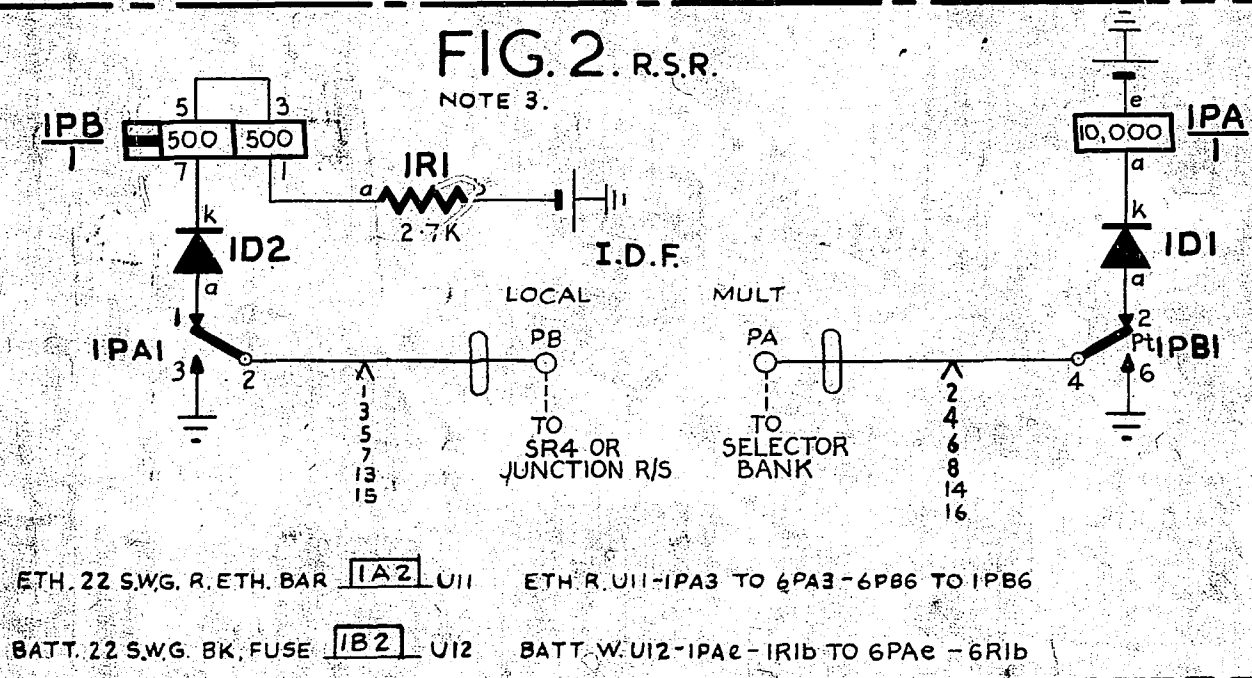

NOTES.

1. FUSING:- FIG. 1 1.5A PER 5 CCTS.  
FIG. 2 1.5A PER 6 CCTS.
2. ALL WIRING TO BE 25 SWG UNLESS OTHERWISE SPECIFIED.
3. WHEN STRIP MOUNTED EQUIPMENT IS SPECIFIED USE FIG. 1, FOR JACKED IN EQUIPMENT USE FIG. 2.

					P-WIRE REPEATER EARTH TESTING SELECTORS NON-METERING	
					(85466)	A
					25.11.68	[Signature]
AMENDMENT PARTICULARS			ISSUE	DATE	APP	SIZE F
						REF - NZ PO DGM 2970 SHT. 1.50V 15
- NZPO -			DRAWN	CHECKED	WIRING	CIRCUIT
			138			GBW 16680 MOD. A