

NZPO NOTES.
 A. WHEN USED WITH DIGIT ABSORPTION RELAY SET NZPO 34139 OR EQUIV. PROVIDE CONNECTIONS SHOWN—3 (PROVIDES IMMEDIATE BUSY TO PABX'S)



- NOTES.**
1. FUSING:- 1.5A PER CIRCUIT.
 2. SHELF JACK U PTS U9+U11 TO MAKE CONTACT WHEN RELAY SET IS REMOVED.
 3. Ø FOR WIRING SEE GBW 10640 OR EQUIV.
 4. STRAP U POINTS 3+10, 12+10, 11+4, 4+B AS REQUIRED.
 5. ALL WIRING TO BE 0.5mm UNLESS OTHERWISE SPECIFIED.
 6. ON SOME EARLY EQUIPMENT BATTERY COLOURS WERE BK OR W.

BATT. V. 0.7mm 5B2 U12
 BATT. R. 0.7mm ETH. BAR 5A2 U11
 BATT. V. U12- RB1b-LSe-Be-BAe-R1b.
 ETH. R. U11- RB1d-LSb-LS1-B1-B3-B5-BA24-D1-TJ1.

PROOF

NOT TO BE USED FOR NEW WORK

DIRECT OR VIA I.D.F. MULT AS REQUIRED NZPO NOTE.

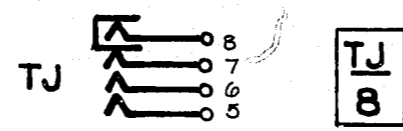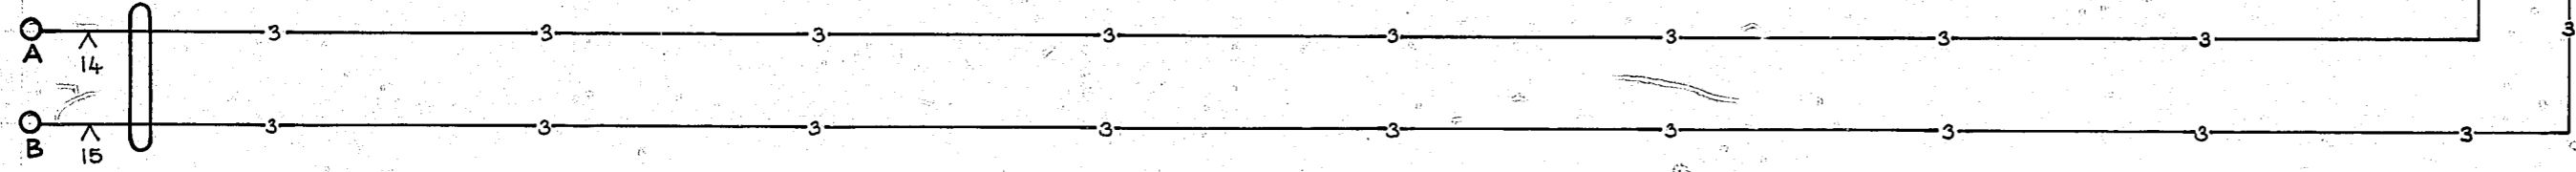

**SELECTOR LEVEL R/S
RINGDOWN WORKING
SPECIAL SERVICES**

2	6-3-81 MWO	17009		RETRACED + METRICATED
1	9-3-72	30271	8-5H	NZPO NOTE A ADDED
50v	S	ISS	DATE DEL DC ORDER CKD APPD	CHANGE
DRN	B.S.	CKD	ORIGIN: TEL-EQUIP.	
TCD	MWO	APPD	STANDARD: ATW 22001	
NZPO ENGINEER - IN - CHIEF, WELLINGTON.				
SHT 1 OF 1		GBW 10610		
SIZE A2				

UD 236

