


- NOTES:-
- FUSING-1.5A PER CIRCUIT.
  - ALL WIRE TO BE 0.5mm. UNLESS OTHERWISE SPECIFIED.
  - Ø FOR WIRING SEE GBW 13730 OR EQUIVALENT.
  - CAPACITORS TO BE CONNECTED AS REQUIRED TO ENABLE PU RELAY TO PULSE AT 10 P.P.S. APPROX.
  - OUTLETS 0-9 ON DS2 BANK CORRESPOND TO THE THIRD DIGIT DIALLED  
(a) STRAP TAG SCA19 TO THE CORRESPONDING TAG ON DS2 WHEN DIGIT IS BARRED  
(b) STRAP TAG SCA18 TO THE REMAINING TAG ON DS2.
  - OUTLETS 0-9 ON DS1 BANK CORRESPOND TO THE SECOND DIGIT DIALLED  
(a) STRAP TAG SCA13 TO THE CORRESPONDING TAG ON DS1 WHEN DIGIT IS BARRED  
(b) STRAP TAG SCA12 TO THE REMAINING TAGS ON DS1 EXCEPT WHEN THIRD DIGIT DISCRIMINATION IS REQUIRED  
(c) STRAP TAG SCA14 TO THE CORRESPONDING TAG ON DS1 WHEN DISCRIMINATION IS REQUIRED ON THE THIRD DIGIT DIALLED.
  - RELAY PU IS DIFFERENTIALLY CONNECTED.
  - WHEN REQUIRED FOR NORMAL U.A.X. NZ13 WORKING USE FIGS 1A, 1B & 1D. WHEN REQUIRED FOR REMOTE U.A.X. NZ13 'M' OR 'R' WORKING USE FIGS 1A, 1C AND 1E.

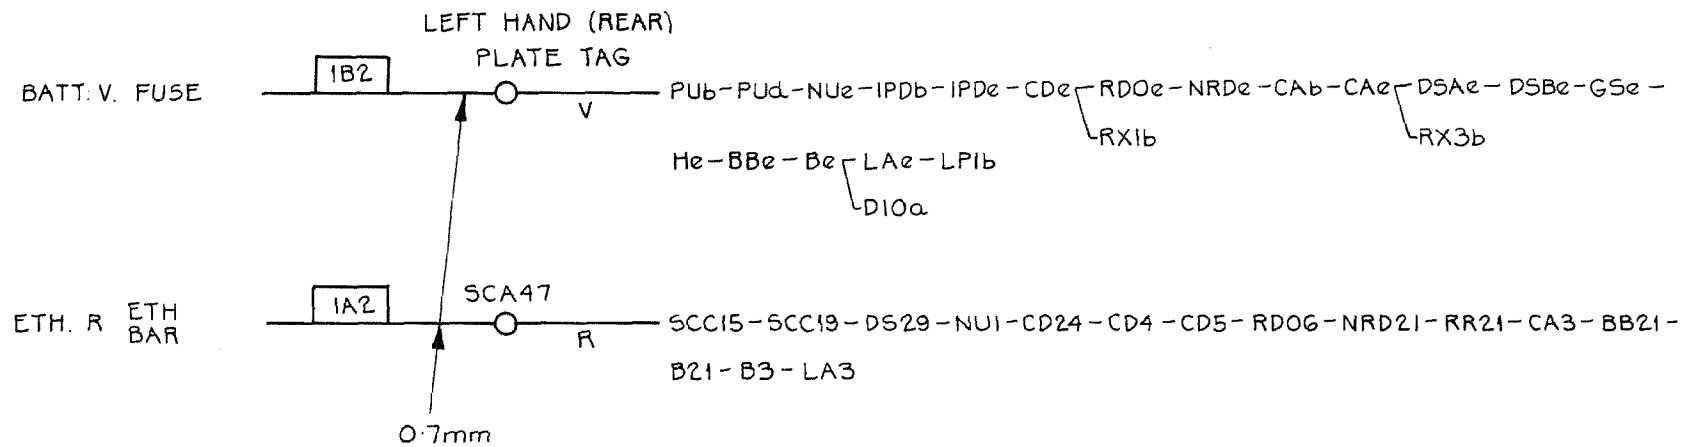

|                                  |  |          |        |          |   |
|----------------------------------|--|----------|--------|----------|---|
| RETRACED & METRICATED            |  | (183009) | 25     | 3.12.79  | U.A.X No NZ13<br>CCB LINE ROUTE<br>RESTRICTION CIRCUIT WITH<br>DISCRIMINATING FACILITIES<br>(PULSE GENERATION TYPE) |
| D11 & D12 ADD BBG SPARE (NZM-QH) |  | (129476) | 2A     | 23.11.77 |   |
| RETRACED NOTE 8 AMENDED          |  | (16234)  | 2      | 23.11.70 |   |
| AMENDMENT PARTICULARS            |  | ISS      | DATE   | APP      | SIZE A1   50V   C   |
| DRAWN                            |  | CHECKED  | WIRING | CIRCUIT  | <b>GBW 16900</b>  |
| N.T.                             |  |          |        |          |   |

KRF2  
21 22 23  
RELEASE FAIL (KRF)  
2