

FIG 1 NP FOR SPARE LINES


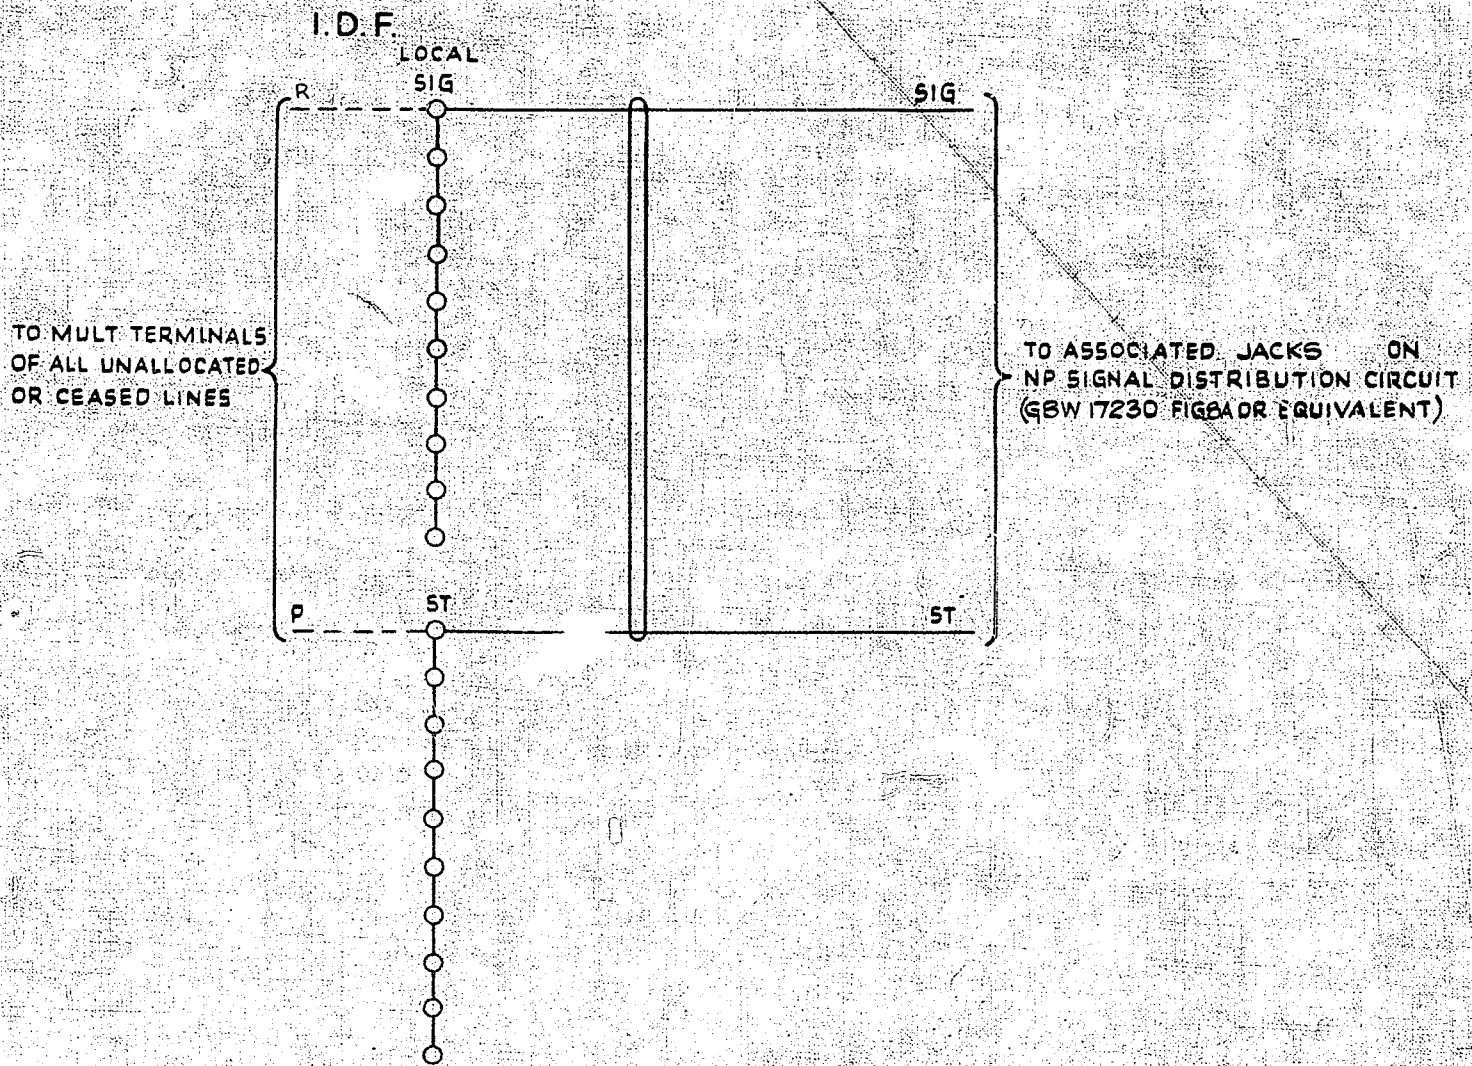


FIG 2 HUNTING BATTERY (PX) FOR GROUPS OF AUXILIARY STATION LINES

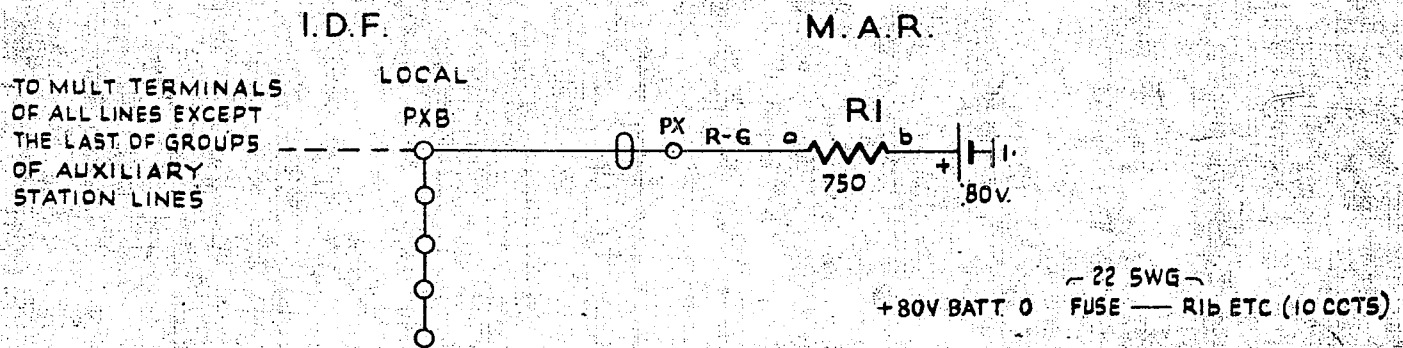

NOTES

1. FUSING
FIG 2 +80V 1.5A PER 10 CIRCUITS
2. WIRING NOT OTHERWISE SPECIFIED TO BE 25 SWG.

AUTOMATIC TELEX SYSTEM NP FOR SPARE LINES AND HUNTING BATTERY (PX) FOR GRPS OF AUXILIARY STATION LINES					
			(7050)	27-3-63	
AMENDMENT PARTICULARS			ISSUE DATE	APPS	SIZE F 50V E
NZPO			DRAWN	CHECKED	WIRING CIRCUIT

GBW 17080

0
5 Centimetres
10
15
20
25
30