




**FIG. 1A.**  
FUSE ALARM

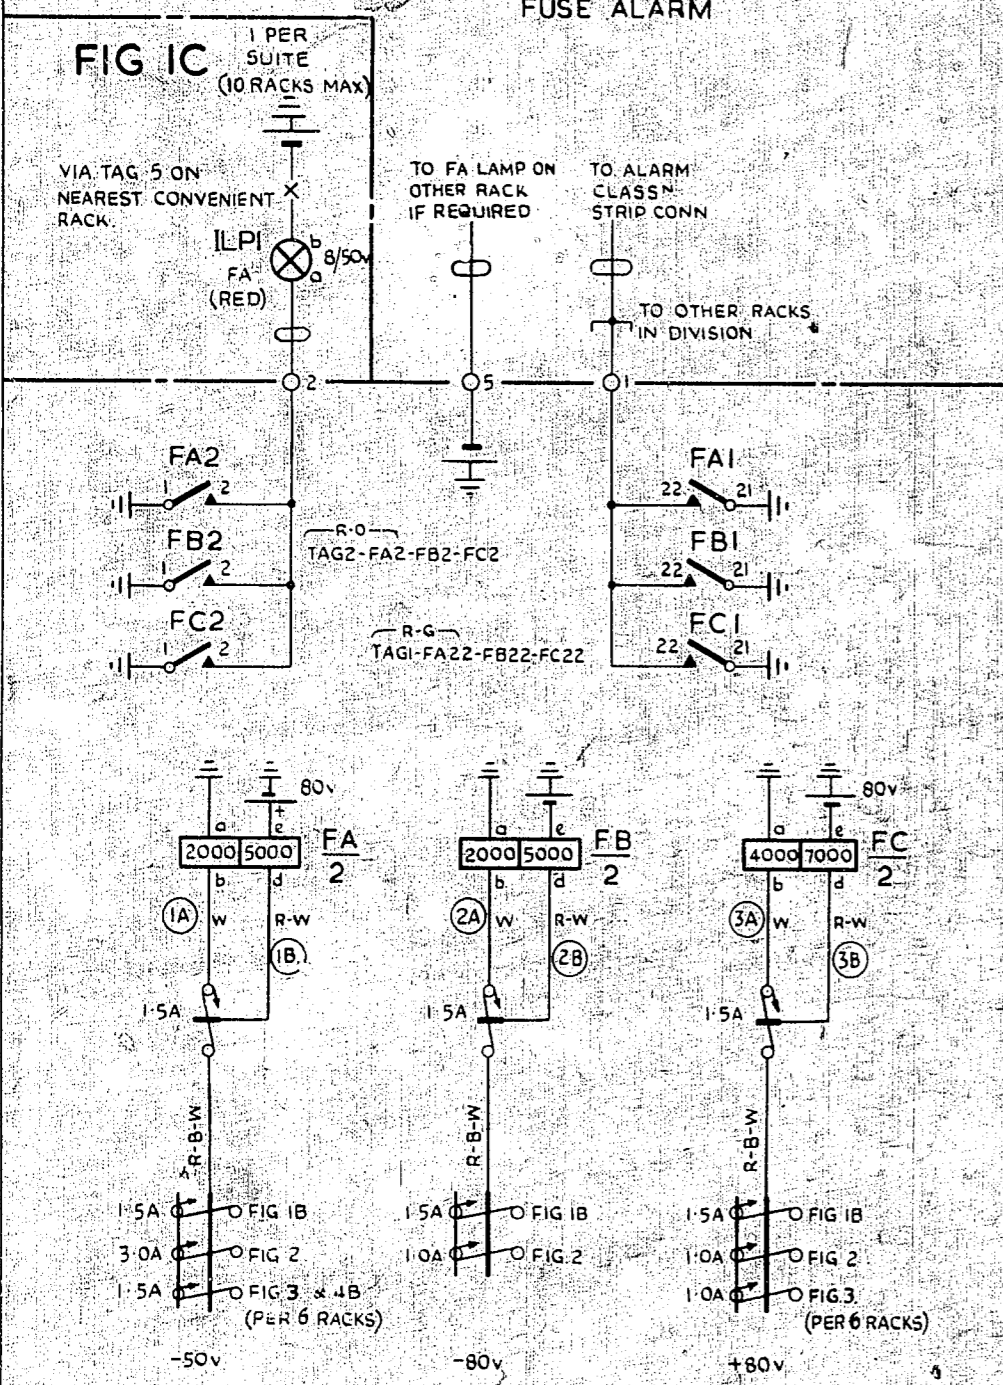


**FIG. 1B**  
1 PER SUITE (10 RACKS MAX)

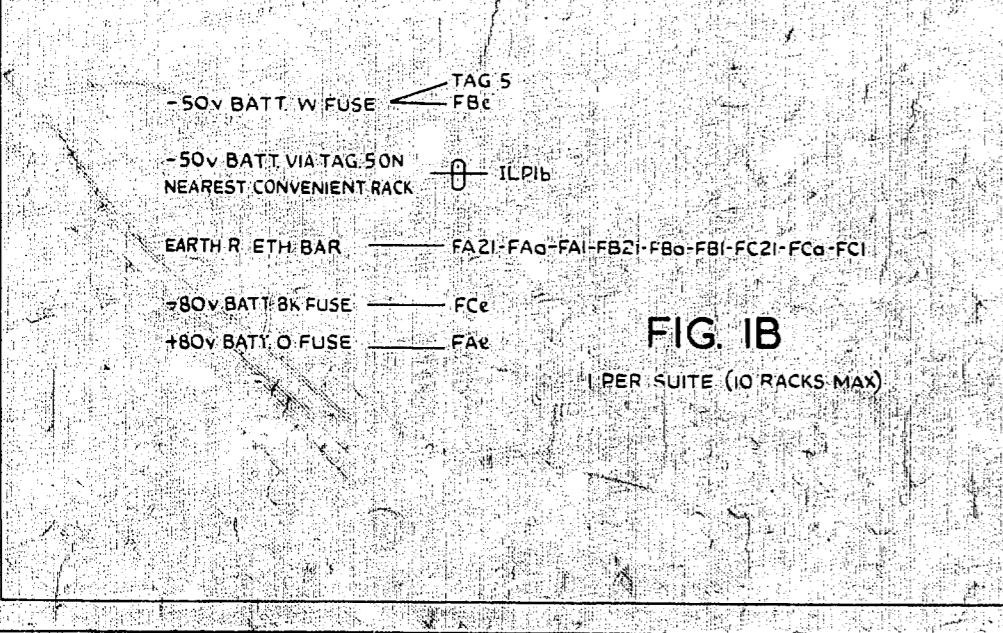


**FIG. 2.**  
BATTERY JACKS  
1 PER 2 RACKS

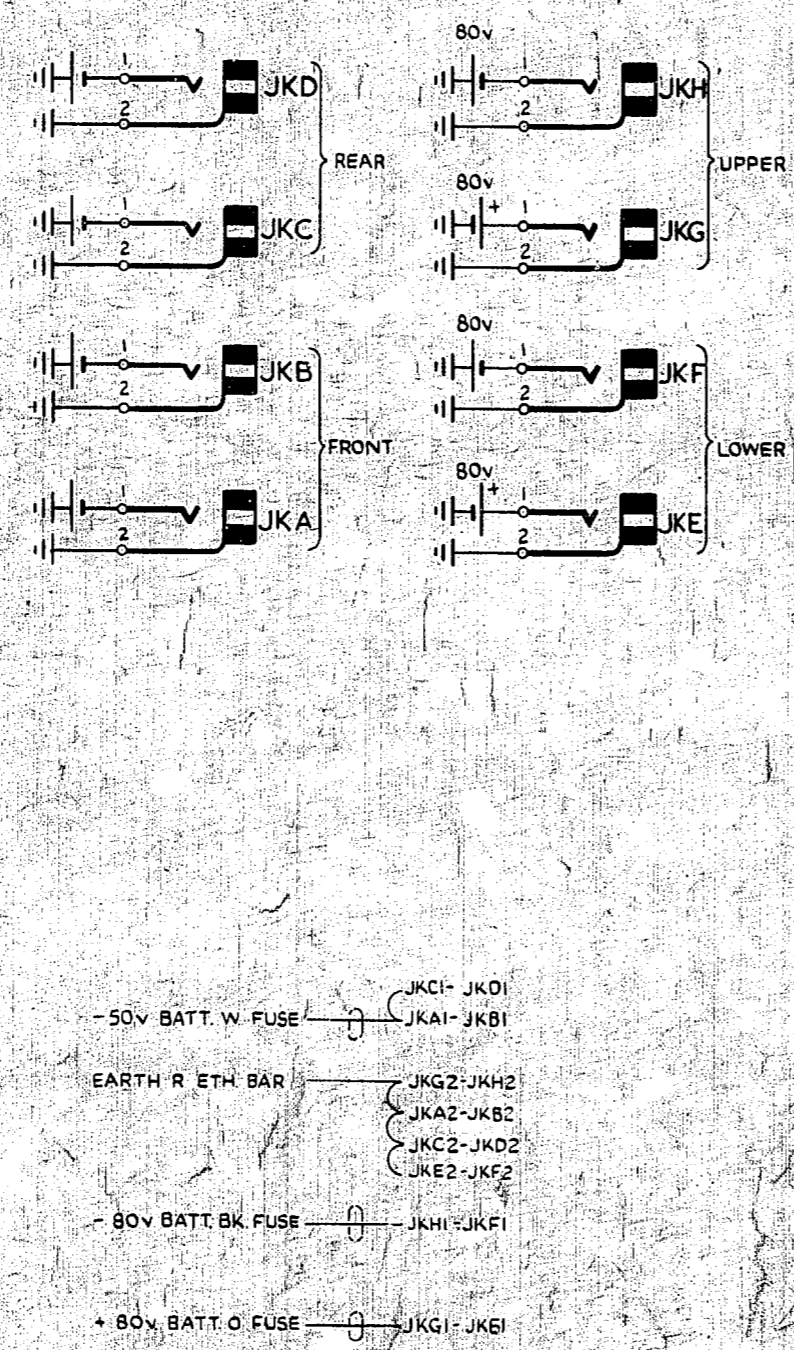


**FIG. 3**  
SUBSCRIBERS METER  
ROUTINE TESTER JACK  
1 PER RACK

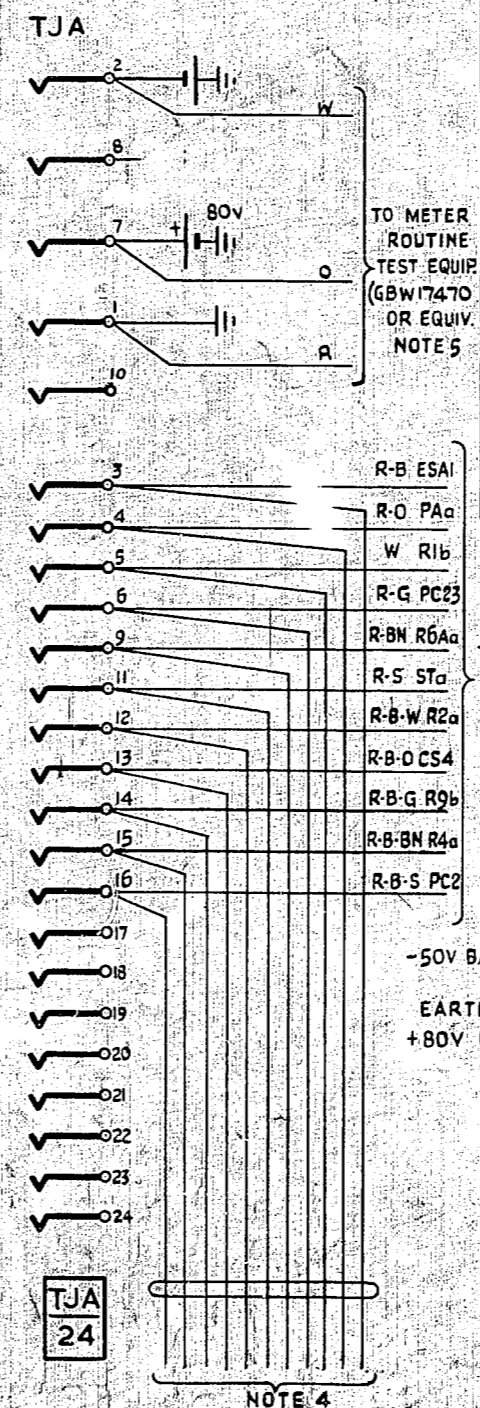

**FIG. 4A**  
TEST FINAL SELECTOR ACCESS JACKS

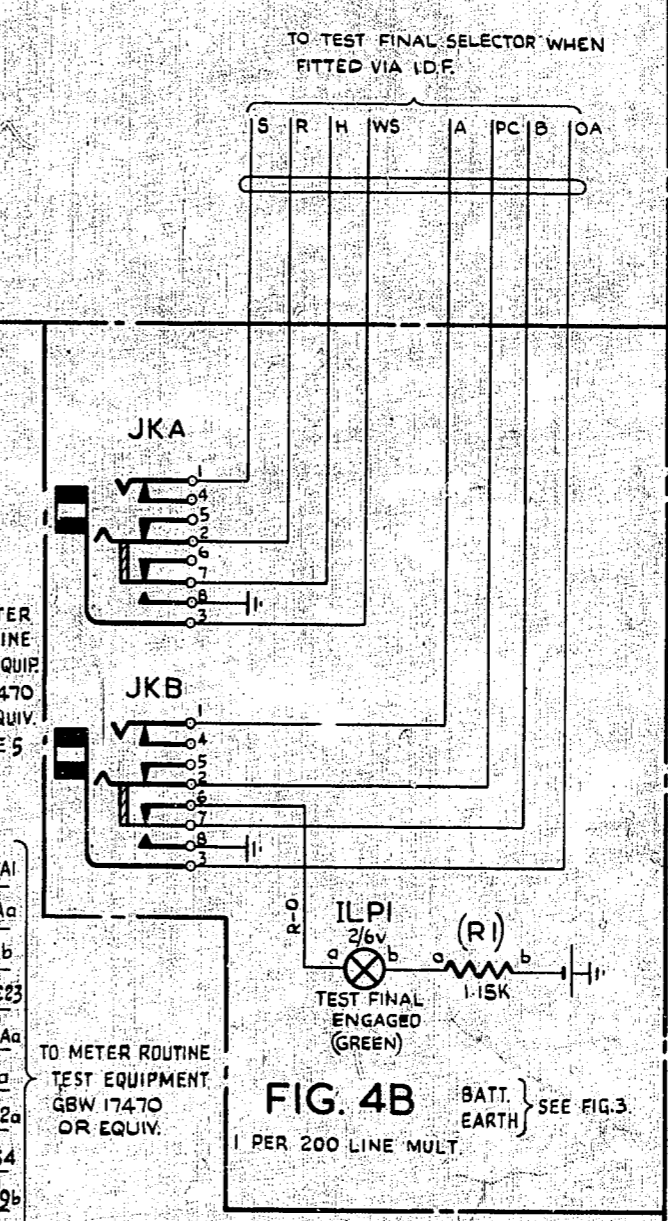

**FIG. 4B**  
1 PER 200 LINE MULT

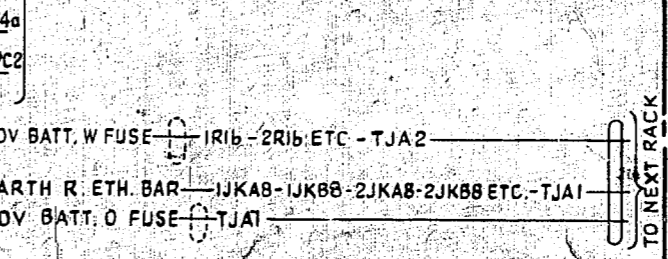

ALLOCATION OF TAGS ON RACK MISC. STRIP CONN

TAG	SERVICE	TAG	SERVICE
1	FUSE ALARM	11	
2		12	
3		13	
4		14	
5	FUSE ALARM LP. BATT.	15	
6		16	
7		17	
8		18	
9		19	
10		20	

- NOTES**
- UNLESS OTHERWISE SPECIFIED TAGS ARE ON RACK MISC. STRIP CONN.
  - WIRING NOT OTHERWISE SPECIFIED TO BE 22 SWG.
  - FIGS 1A, 1B AND 1C ARE ONLY REQUIRED WHEN FUSE PANELS ARE FITTED ON THE METER RACK. WHEN FUSE PANELS ARE NOT FITTED, EQUIPMENT TO FIGS 2, 3 & 4B IS FUSED ON THE M.A.R.
  - COMMONED TO A MAXIMUM OF 5 OTHER METER RACKS.
  - THESE CONNECTIONS ARE ONLY REQUIRED WHEN EQUIPMENT TO GBW 17470 (OR EQUIV.) IS PROVIDED ON THE SAME RACK.

AUTOMATIC TELEX SYSTEM  
RACK COMMON SERVICES  
SUBSCRIBERS METER RACK

(70672) 1 19-4-63

AMENDMENT PARTICULARS	ISSUE	DATE	APPD.	SIZE M	50V
NZPO	DRAWN	CHECKED	WIRING	CIRCUIT	GBW 17390