

PART OF PERIODIC METER PULSE GENERATOR RELAY SETS GBW 17650 OR EQUIV. EXPLANATORY ONLY

GBW 17660

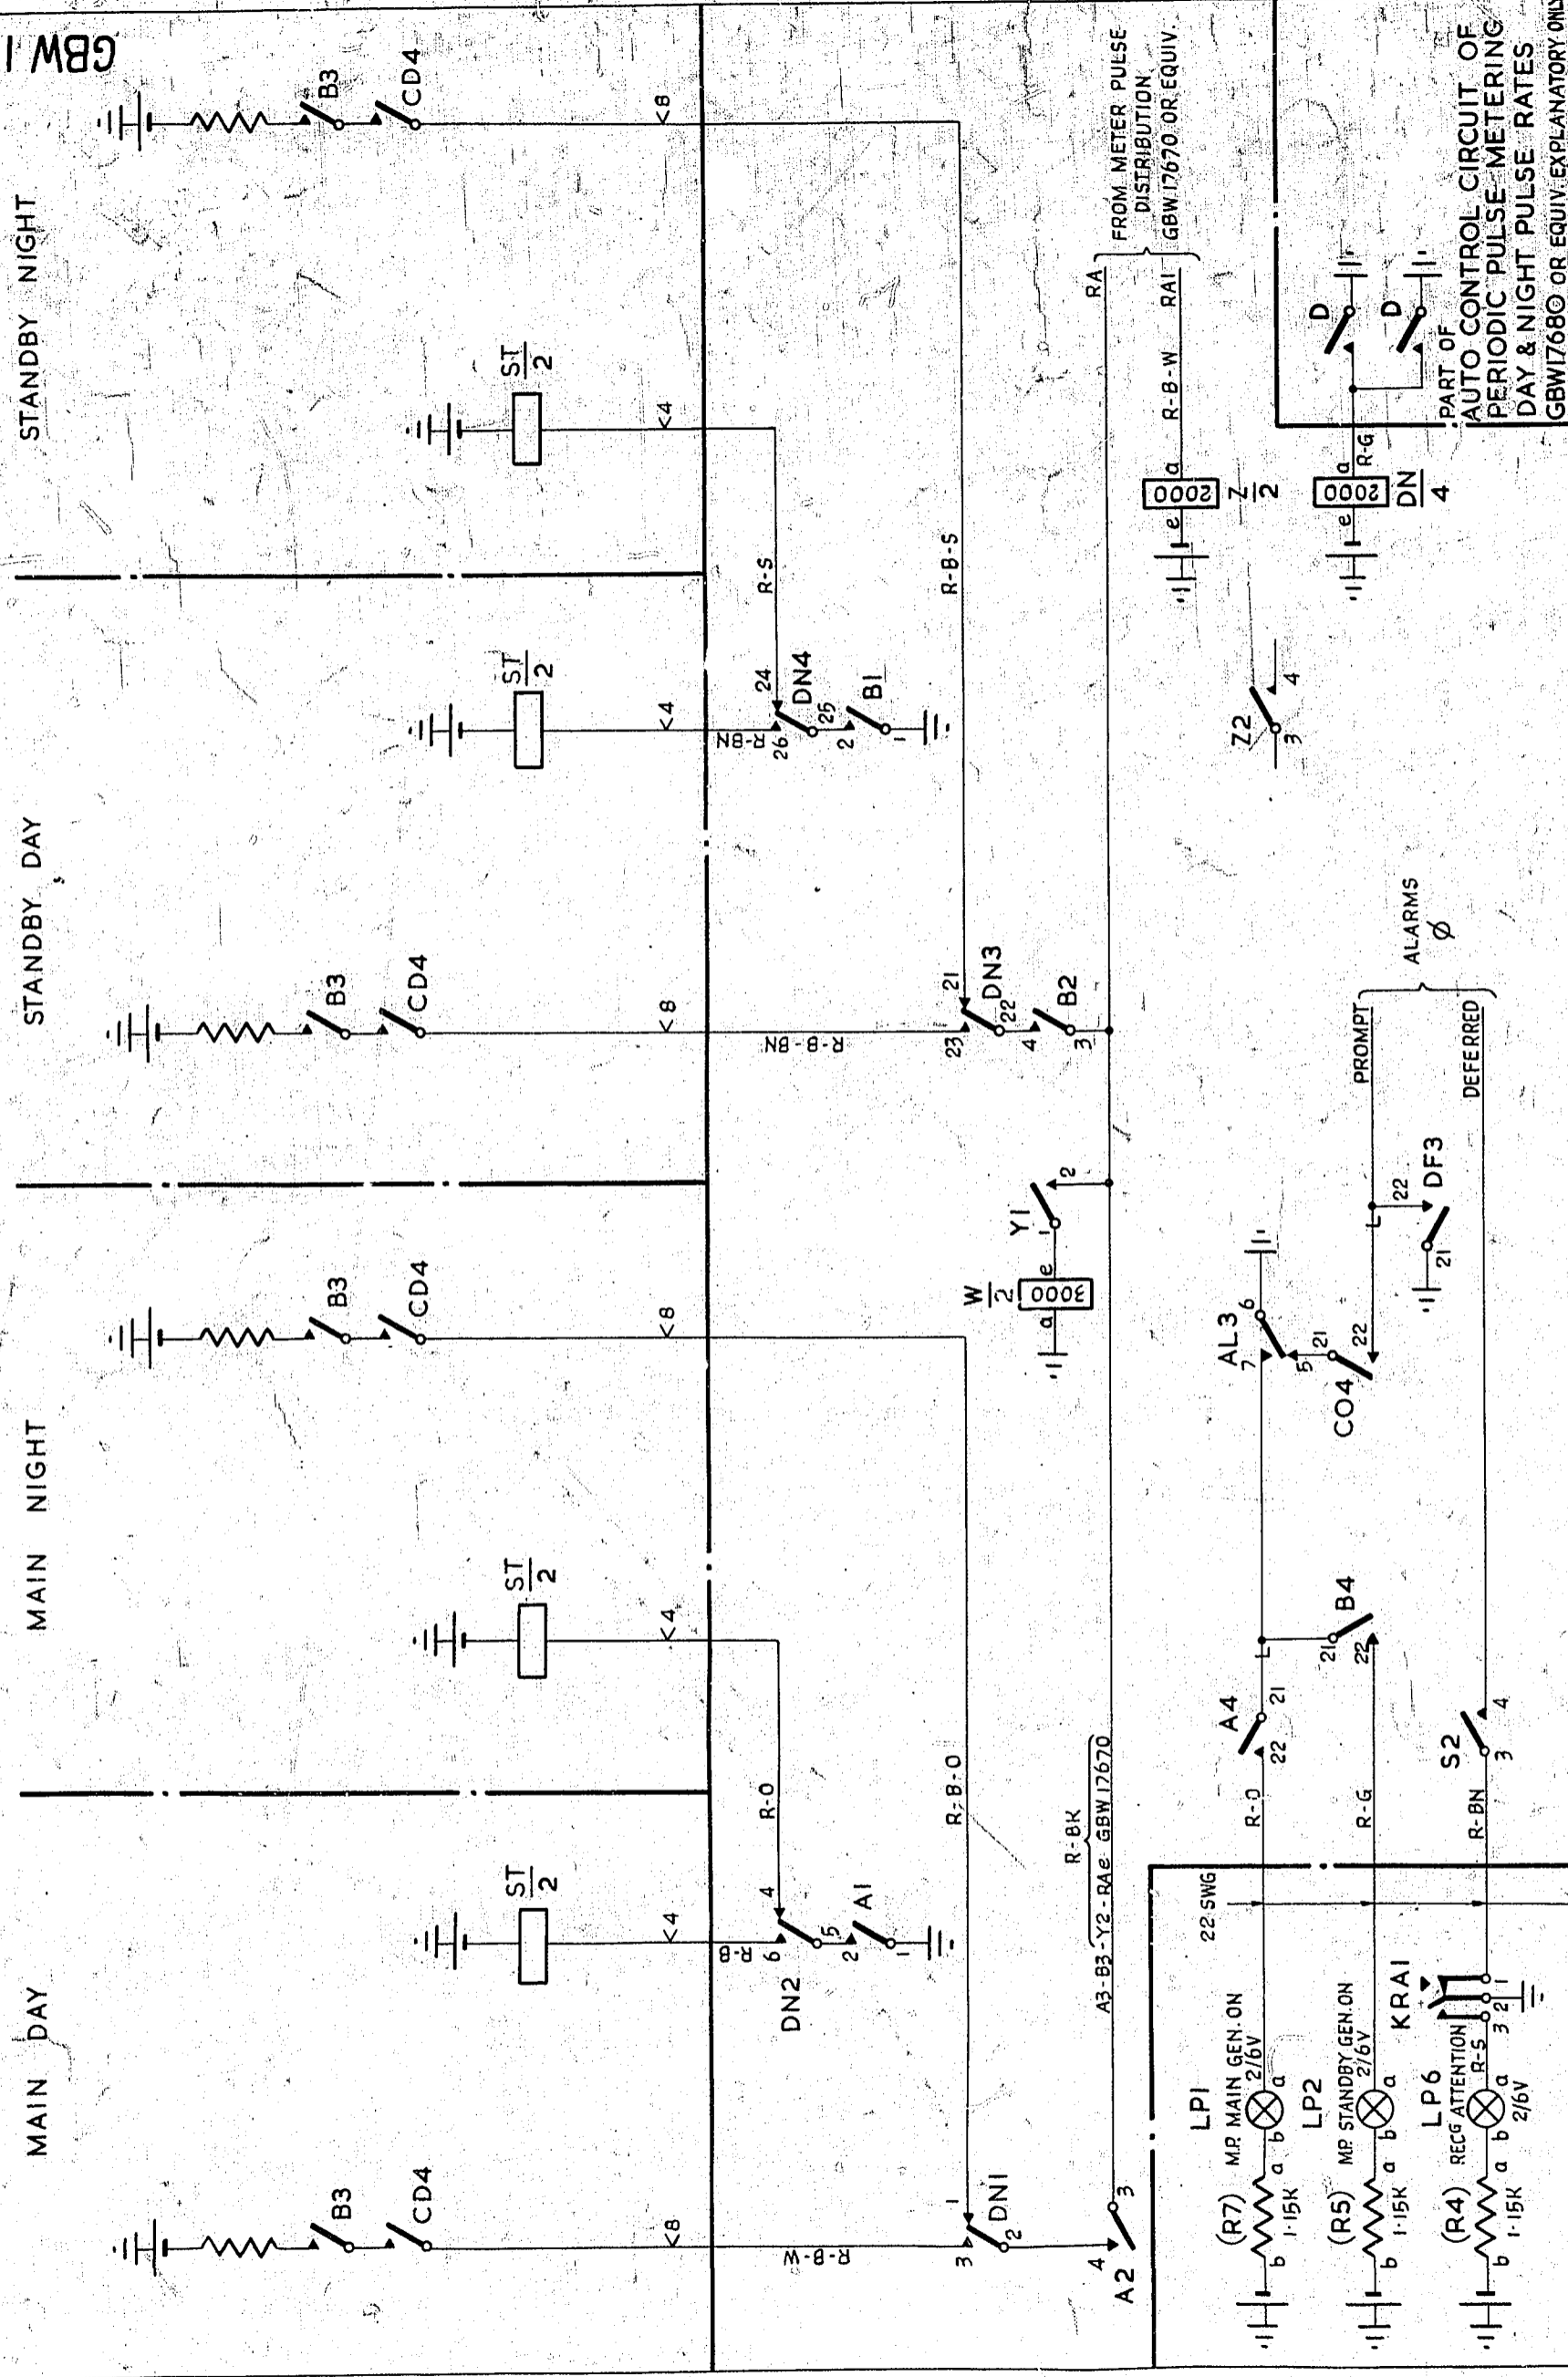


FIG. 1

FIG. 2

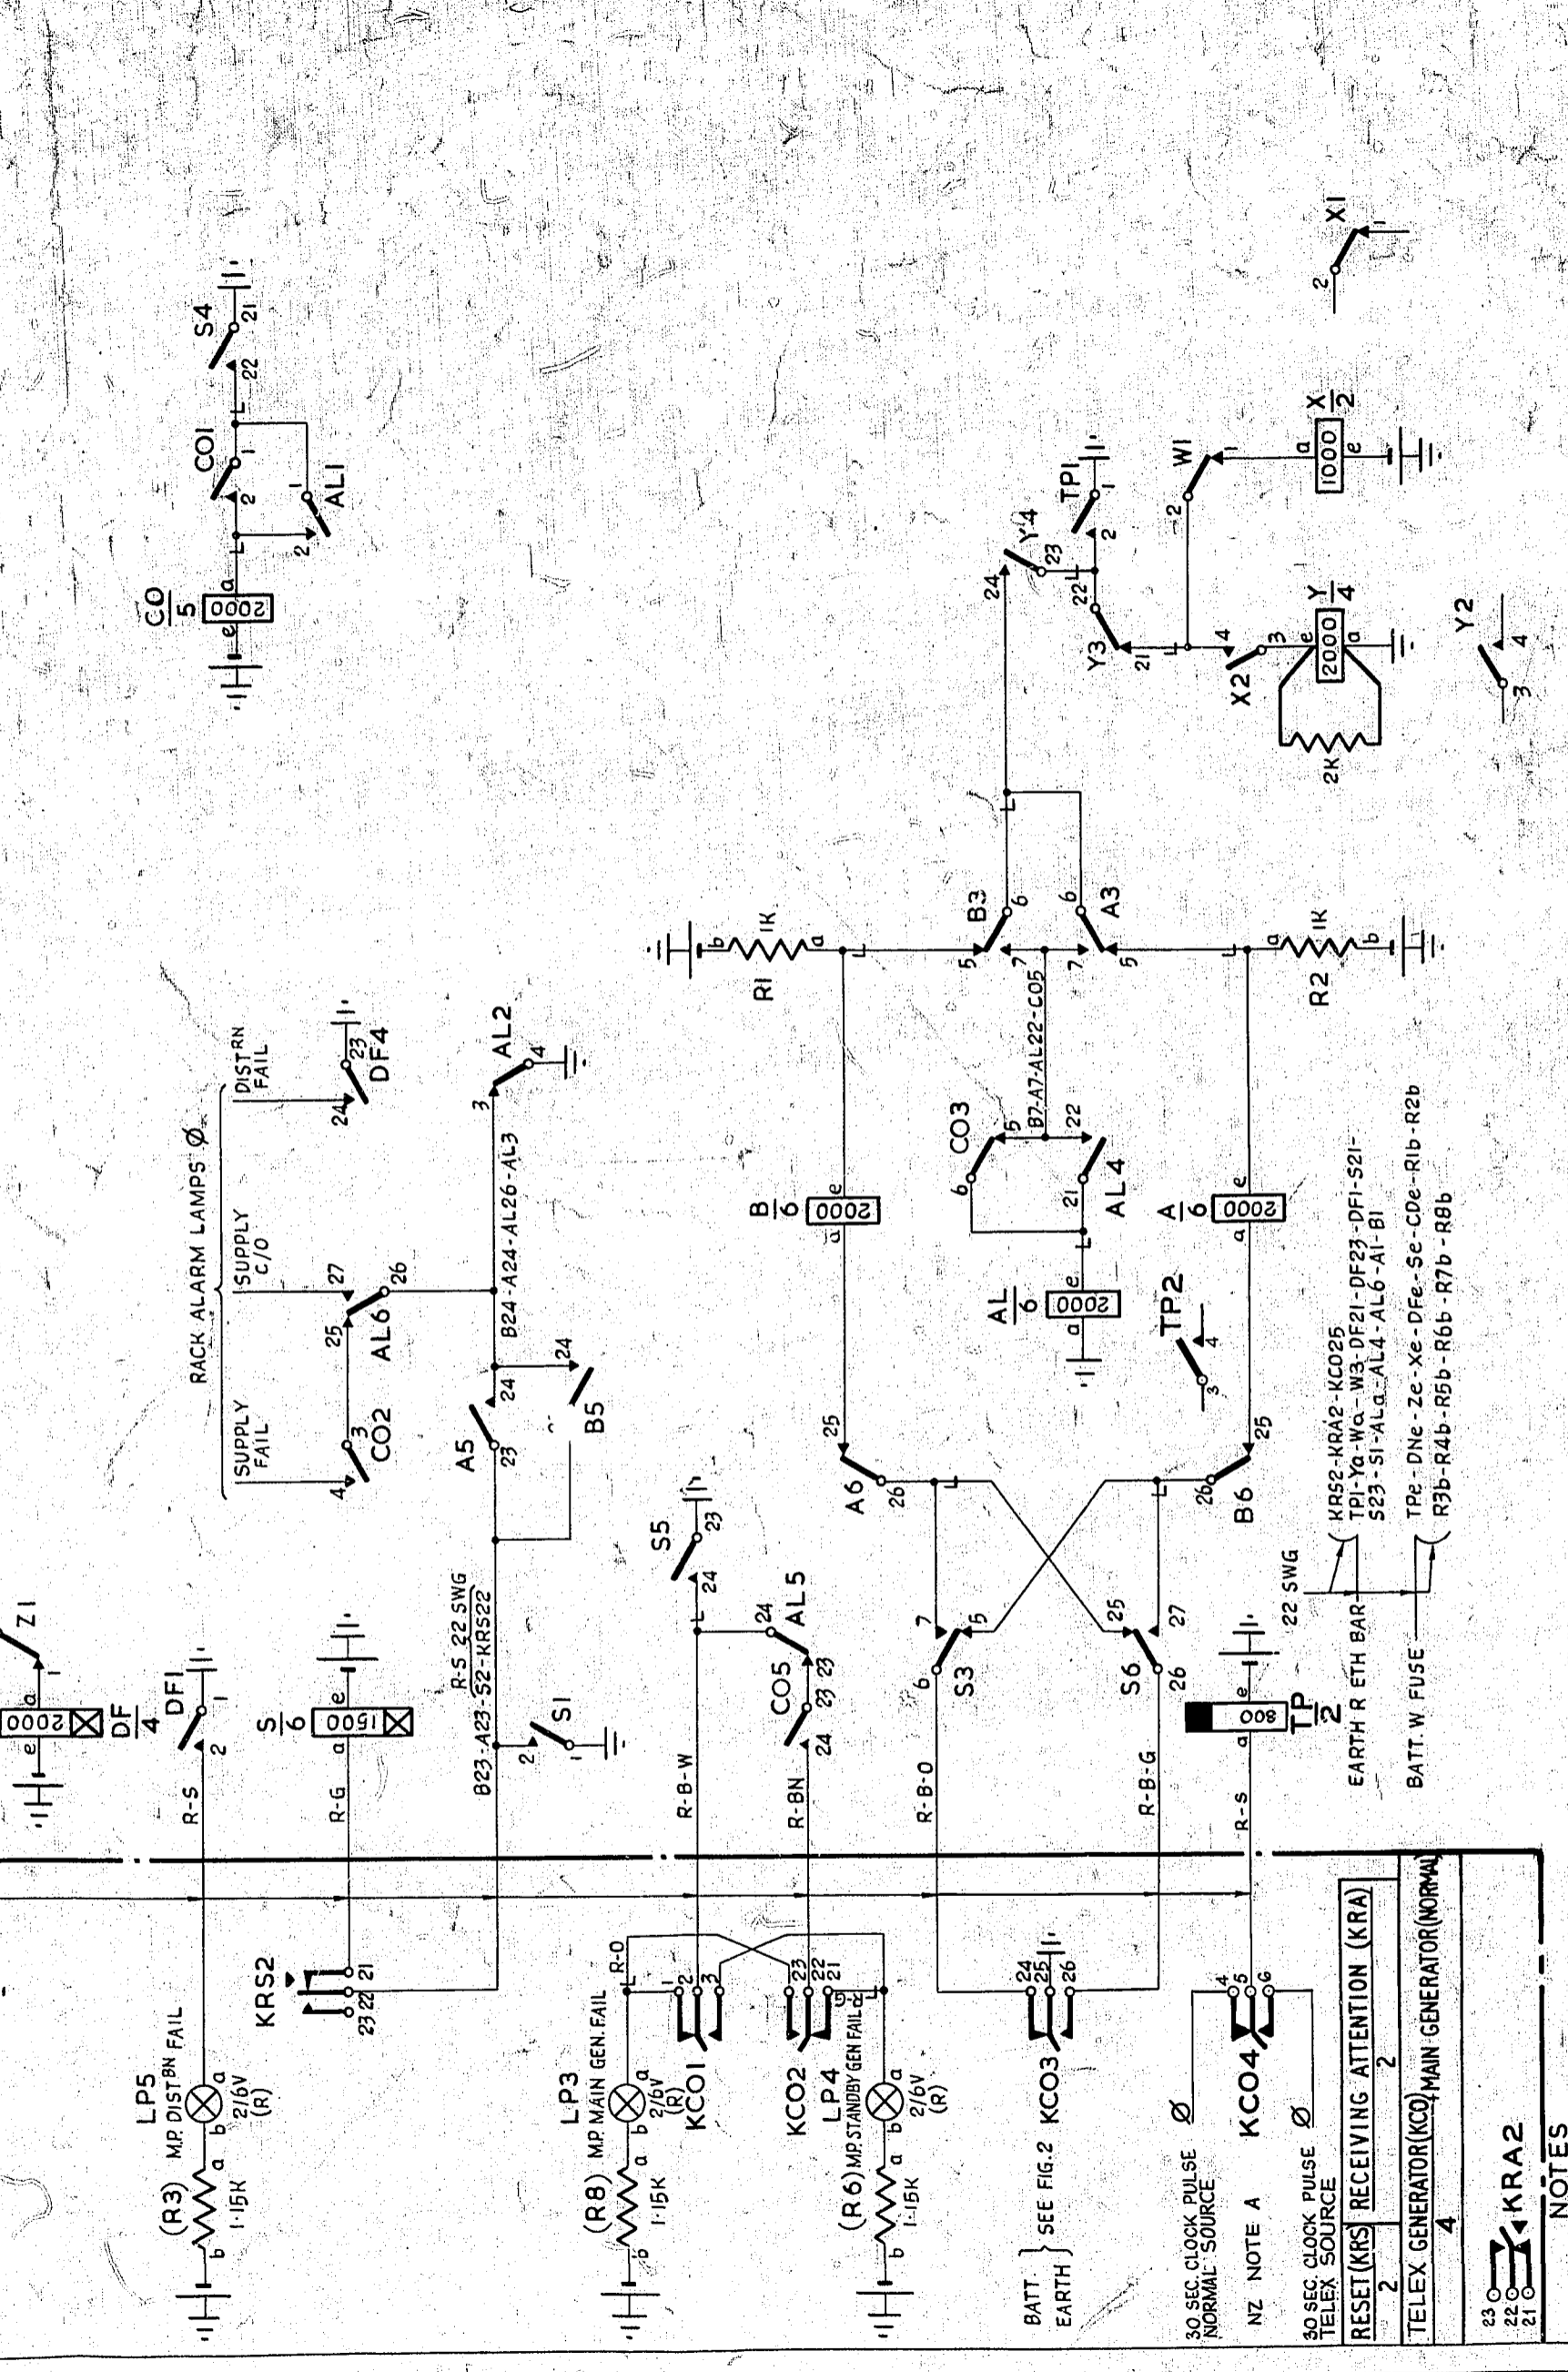


FIG. 2

- NOTES
1. FUSING 1.5A PER CIRCUIT
  2. ALL WIRING TO BE 25 SWG UNLESS OTHERWISE SPECIFIED
  3. Ø FOR WIRING SEE GBW17390 OR EQUIV

NZ. NOTES:-  
 A. WITH 'KCO IN' NORMAL POSITION, CLOCK PULSE SOURCE MUST BE OTHER THAN TELEX GENERATOR.

AMENDMENT PARTICULARS		ISSUE DATE	APPRD.
1		2.5.65	
2		17.5.67	J.W.E.
2A	(122403)	14.11.74	J.W.E.

NZ.P.O.	DRAWN	CHECKED	WIRING	CIRCUIT

GBW 17660

AUTOMATIC TELEX SYSTEM  
 PERIODIC METER PULSE GENERATOR  
 CHANGE-OVER, CONTROL AND  
 ALARM CIRCUIT

SIZE M 50W E1