

FIG. IA M.A.R.

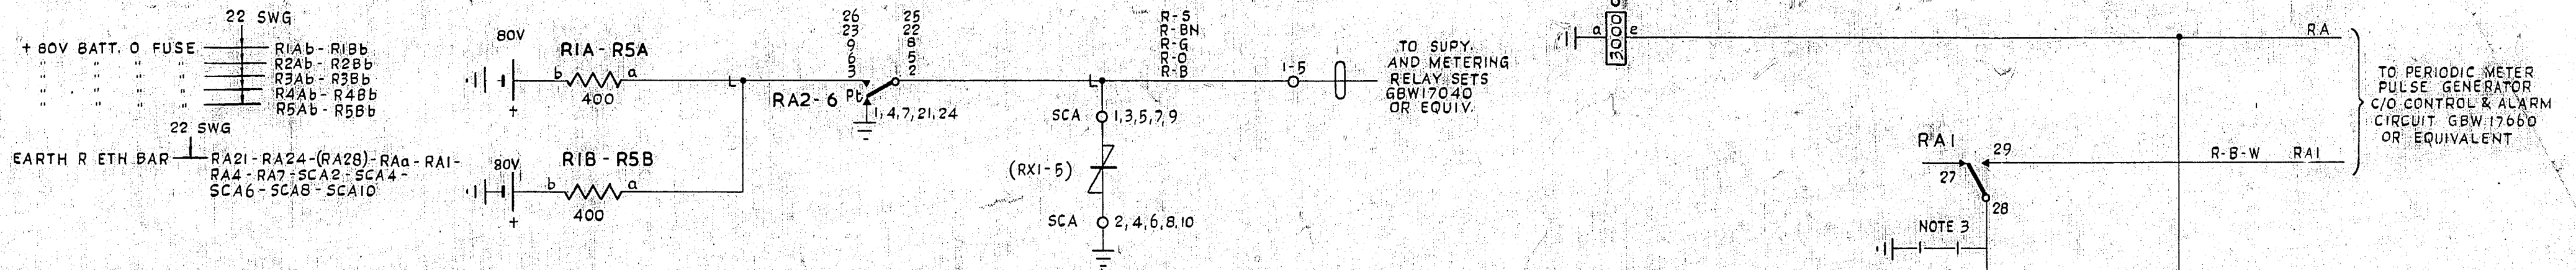


FIG. IB M.A.R.

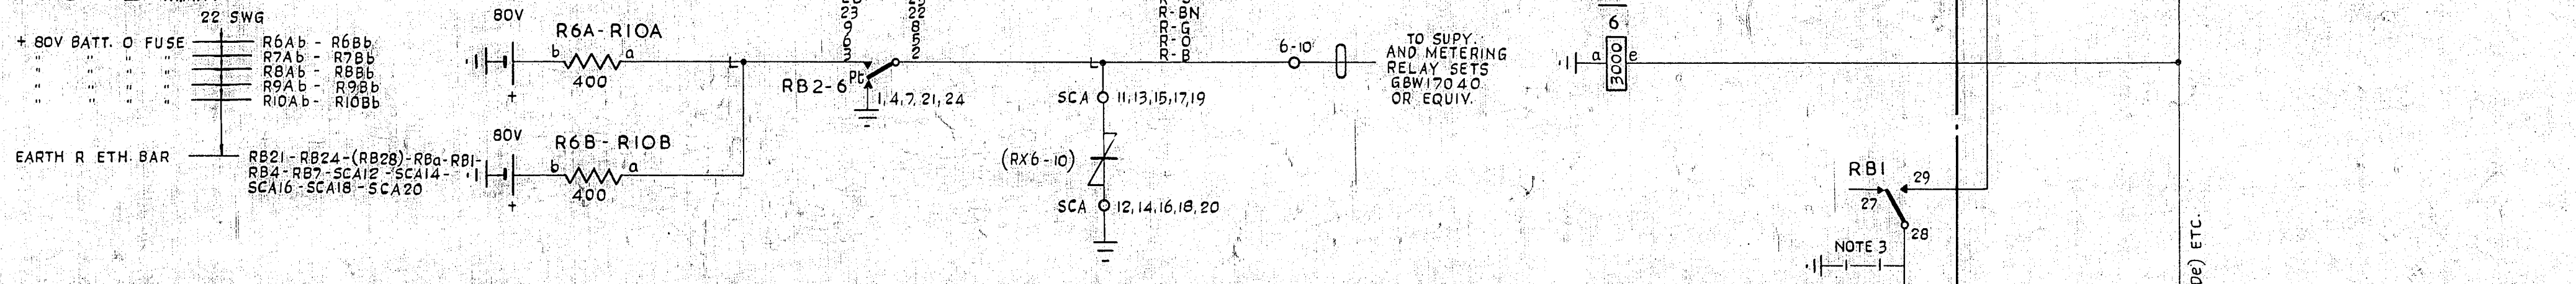


FIG. IC M.A.R.


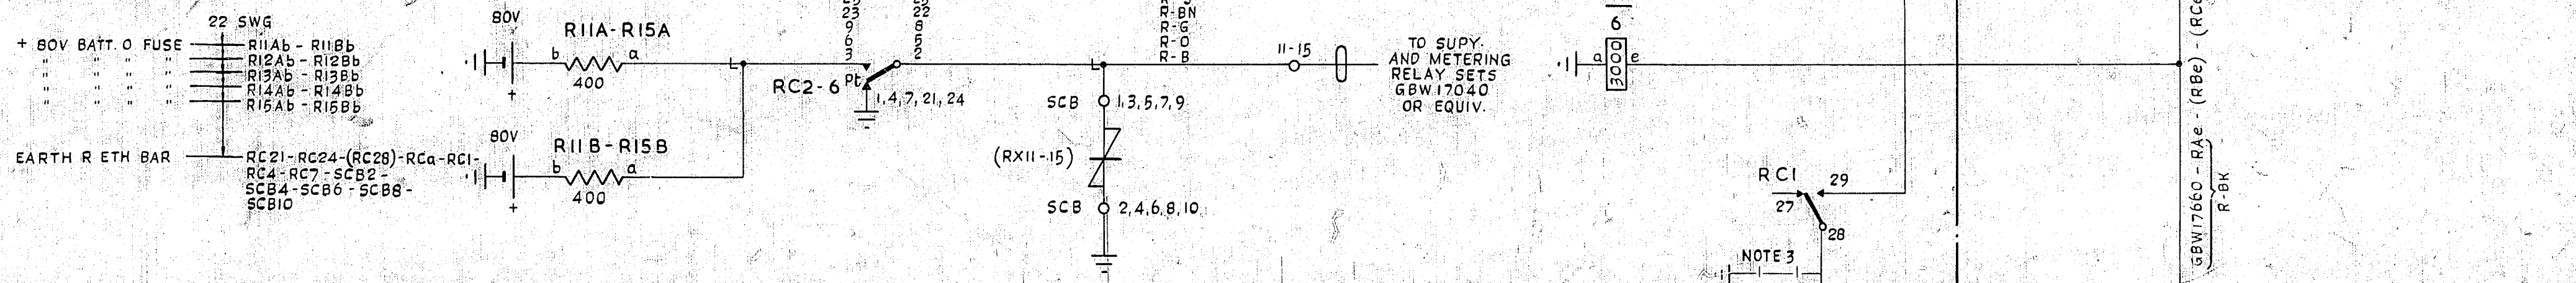


FIG. ID M.A.R.

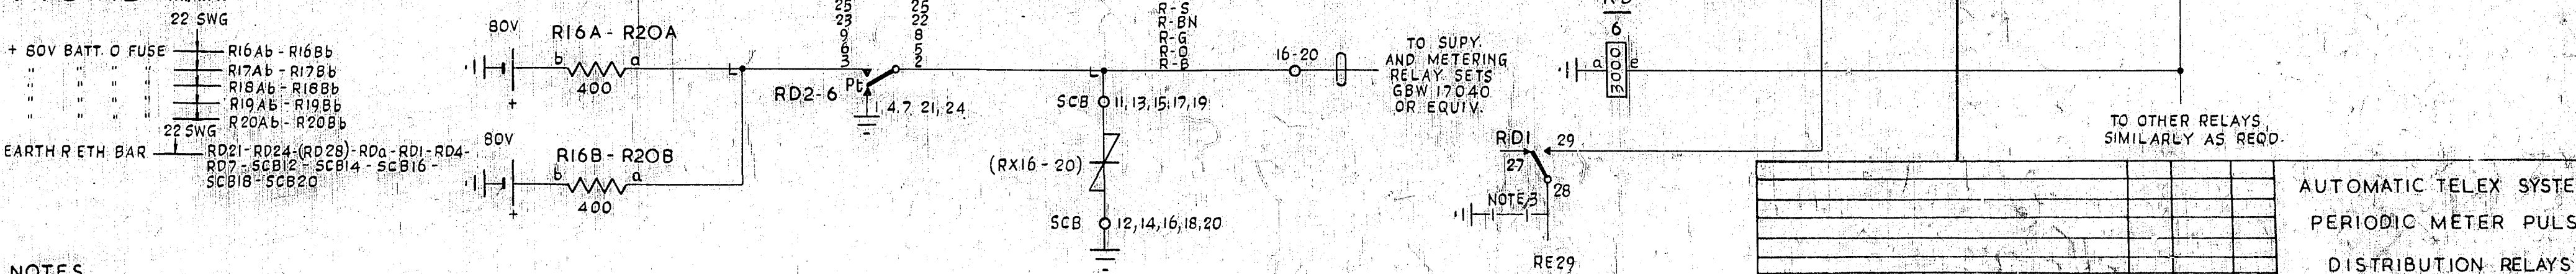

NOTES

1. FUSING - + 80V 0.5A PER METER PULSE LEAD.
2. ALL WIRING TO BE 25 SWG UNLESS OTHERWISE SPECIFIED.
3. EARTH TO BE CONNECTED TO SPRING 28 OF LAST RELAY IN CHAIN

AUTOMATIC TELEX SYSTEM			
PERIODIC METER PULSE			
DISTRIBUTION RELAYS			
(71762)	1	2-5-63	ae
AMENDMENT PARTICULARS	ISSUE	DATE	APPD
NZ.P.O.	DRAWN	CHECKED	WIRED
	ENGINEER		
GE 17670			SIZE M 50V E

