


TO LINE VIA TEST JACK PANEL GBW 17730 OR EQUIVALENT

TO LINE VIA TEST JACK PANEL GBW 17730 OR EQUIVALENT

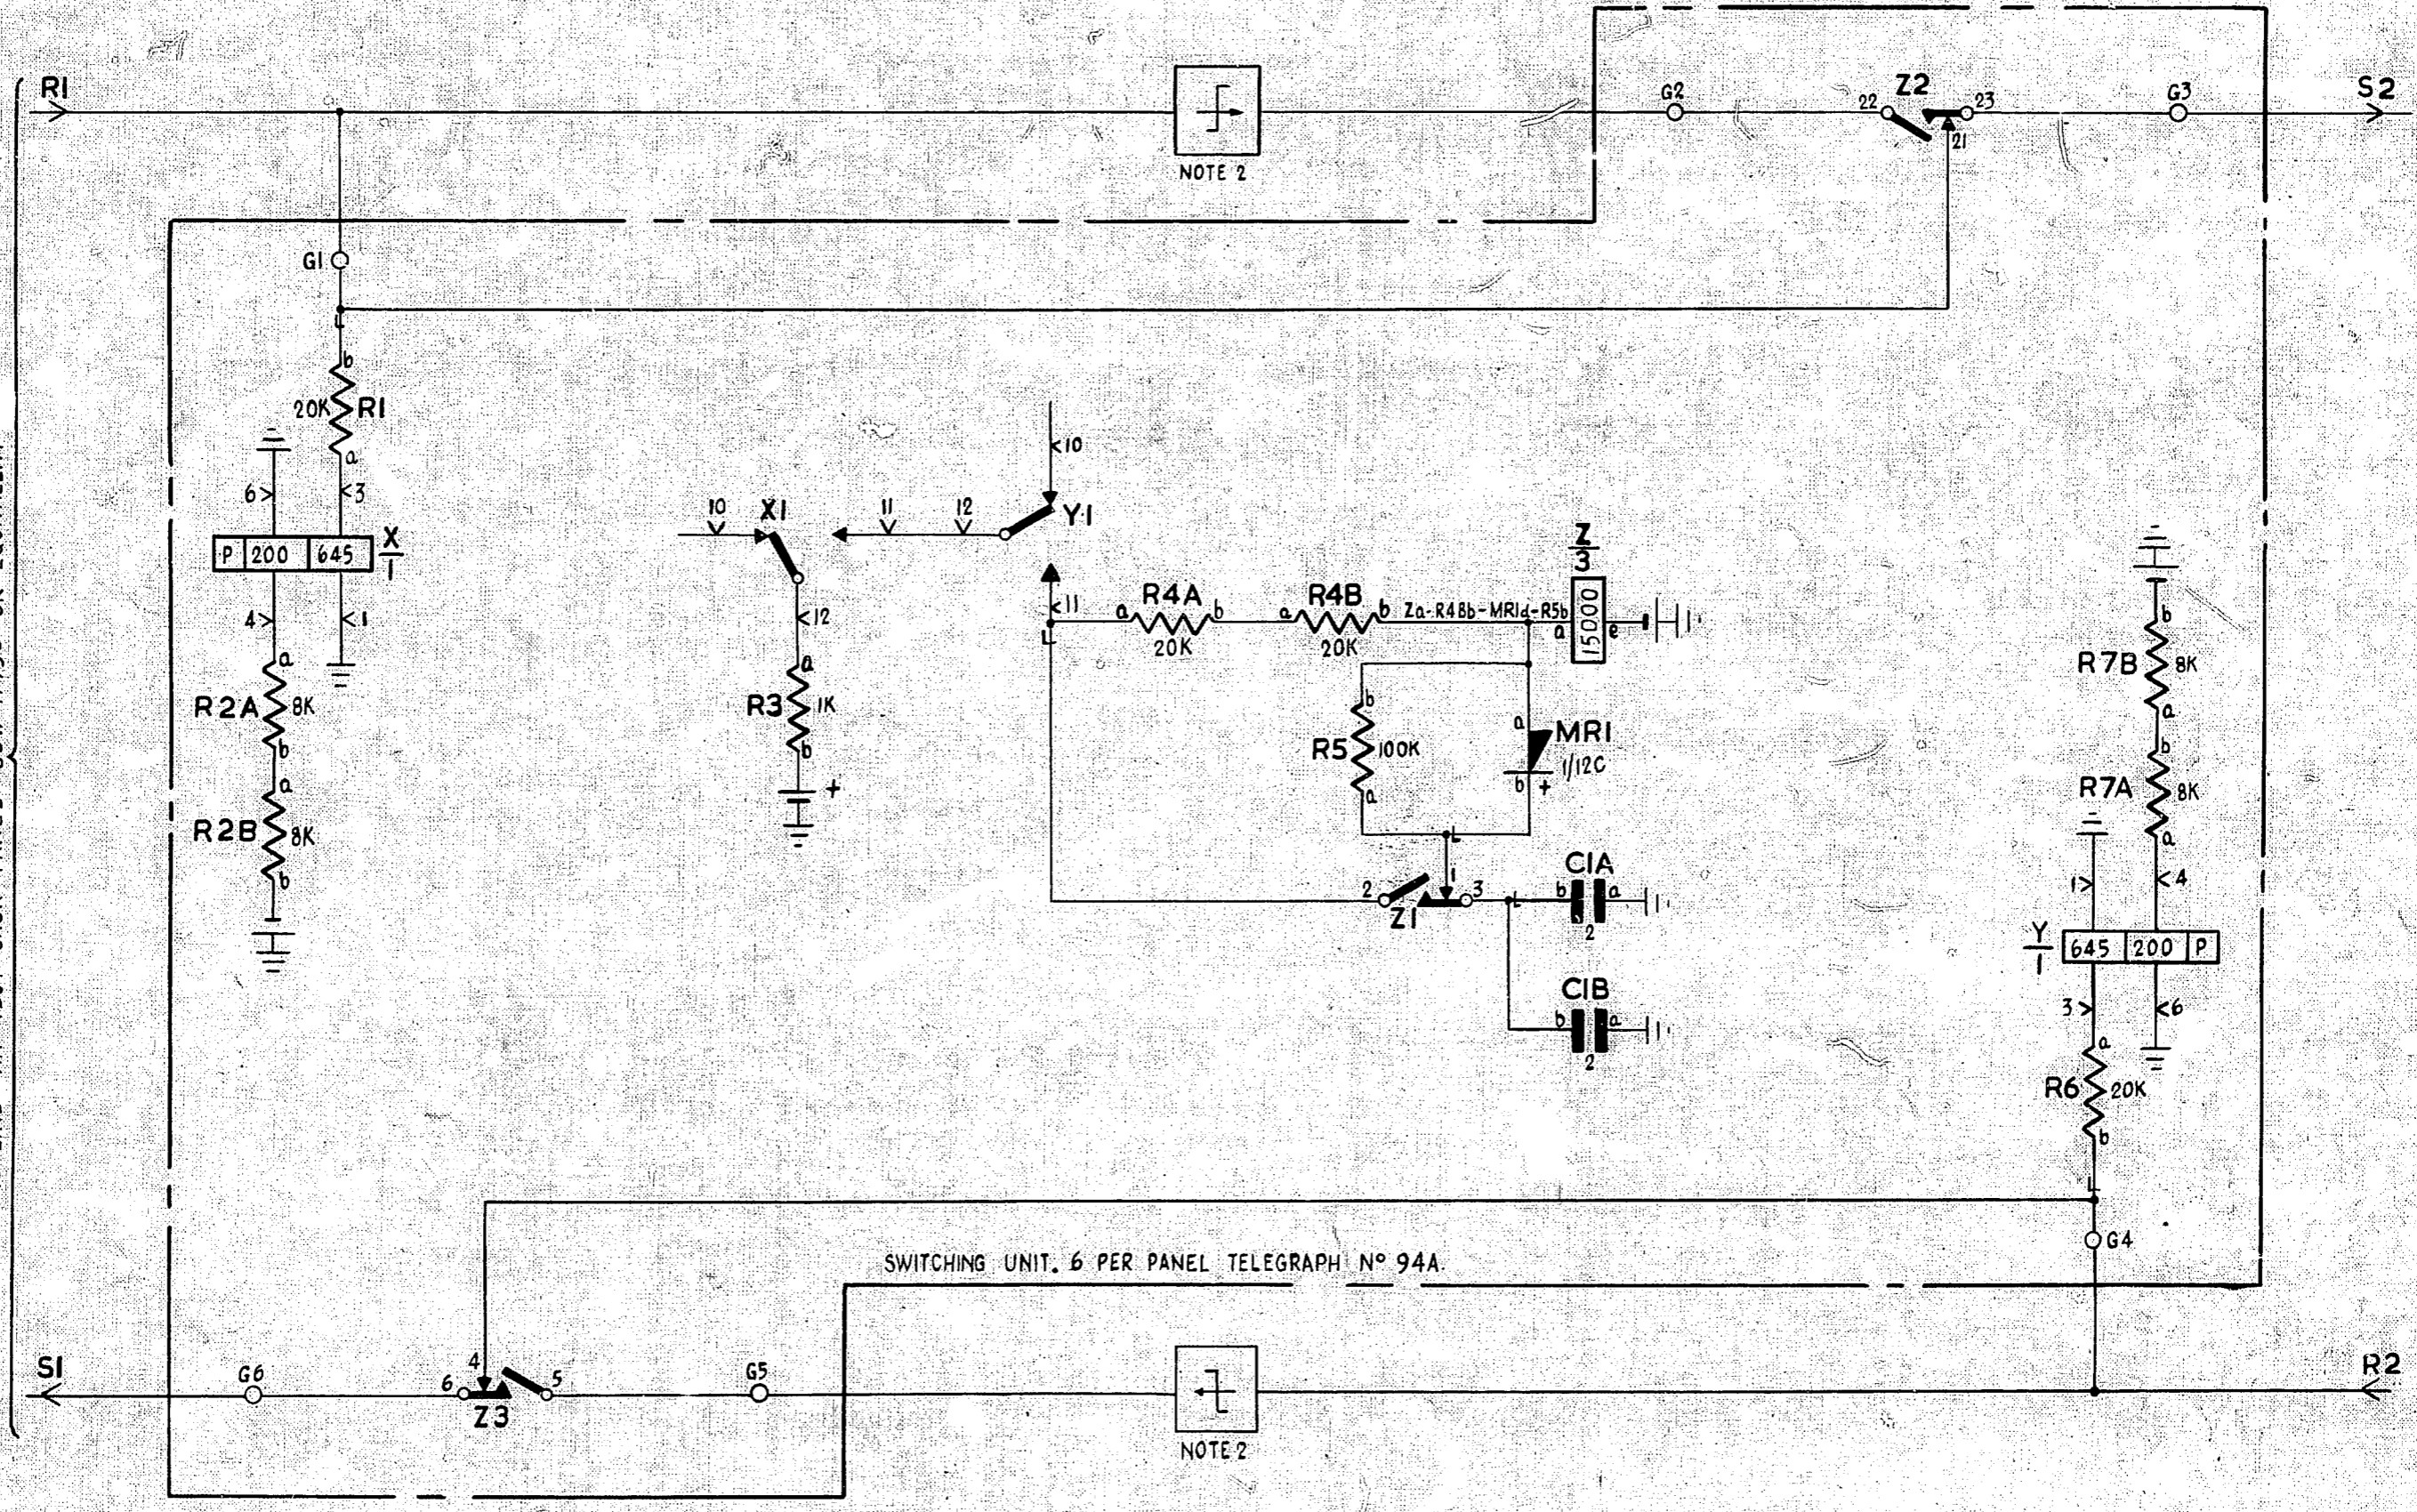

NOTES

1. ALL WIRING TO BE 25 SWG UNLESS OTHERWISE SPECIFIED
2. THE ARRANGEMENT SHOWN HERE WITH A REPEATER IN EACH TRANSMISSION PATH IS TYPICAL ONLY. FOR OTHER POSSIBLE ARRANGEMENTS SEE OGM GBW 17730 SHT 2-2.

+80V. 20SWG. R TAG G28-6R3b-5R3b-4R3b ETC. TO 1R3b

-80V. 20SWG. BK TAG G30-6R7b-6R2b-6Ze-5R7b-5R2b-5Ze ETC TO 1R7b-1R2b-1Ze

SIG ETH. 20SWG R-B TAG G29-6C1Ba-6C1Aa-6Y1-6Y6-6X1-6X6 ETC. TO 1C1Ba-1C1Aa-1Y1-1Y6-1X1-1X6

				ELECTRONIC REGENERATIVE TELEGRAPH REPEATER SWITCHING UNIT PANEL PANEL TELEGRAPH N° 94A			
				SIZE: S 80V E			
				GBW 17710			
AMENDMENT PARTICULARS		ISSUE	DATE	APPP			
		(79962)	1	14.6.63			
N.Z.P.O.	DRAWN	CHECKED	WIRING	CIRCUIT			

